

# Report

## Long Term Development Statement (LTDS)

### Data Exchange Specifications

**Publication date:** 14 July 2023

**Team:** Digitalisation and Decentralisation;  
Energy Systems Management and  
Security

**Email:** [flexibility@ofgem.gov.uk](mailto:flexibility@ofgem.gov.uk)

This document outlines the information model, profile and serialisation requirements for the data exchanges of the proposed LTDS Common Information Model (CIM) revision.

It is part of a package of technical documentation that sets out the outputs delivered by the LTDS reforms working group. We are publishing these documents to ensure all interested parties have full visibility of the outcomes of this programme of work, which is intended to form the basis of a future consultation on a proposed implementation of the Common Information Model (CIM) for the LTDS data. As such, the guidance offered in this document is not mandatory at this stage and will be subject to consultation before any changes to this data requirement are mandated.

© Crown copyright 2023

The text of this document may be reproduced (excluding logos) under and in accordance with the terms of the [Open Government Licence](#).

Without prejudice to the generality of the terms of the Open Government Licence the material that is reproduced must be acknowledged as Crown copyright and the document title of this document must be specified in that acknowledgement.

Any enquiries related to the text of this publication should be sent to Ofgem at:  
10 South Colonnade, Canary Wharf, London, E14 4PU.

This publication is available at [www.ofgem.gov.uk](http://www.ofgem.gov.uk). Any enquiries regarding the use and re-use of this information resource should be sent to: [psi@nationalarchives.gsi.gov.uk](mailto:psi@nationalarchives.gsi.gov.uk)

## Contents

<b>Executive Summary .....</b>	<b>4</b>
<b>1 Data Exchange Specifications .....</b>	<b>5</b>
1.1 Background .....	5
1.2 LTDS Information Model .....	6
1.3 LTDS Profiles .....	18
1.3.1 CIM grid model profiles .....	18
1.3.2 Approach to LTDS profile development .....	19
1.3.3 LTDS layered profiles in UML .....	22
1.3.4 Constraints .....	46
1.3.5 Creating CIM XML for LTDS and CGMES v3.0 .....	48
1.4 LTDS Serialisation .....	49
<b>2 Terms, definitions and abbreviated terms .....</b>	<b>61</b>
<b>3 List of LTDS Appendices .....</b>	<b>63</b>

## Executive Summary

The Long Term Development Statement (LTDS) requires Distribution Network Operators (DNOs) to provide publicly available network planning data mandated through their licence conditions (SLC25). The LTDS should be high value data that allows users to evaluate opportunities to connect to the network and also to enable flexibility services. The guidance in this document to modernise and digitalise the LTDS is a foundational step in enabling a net zero energy system.

In 2020, Ofgem set out the next steps for progressing the reforms of the LTDS.<sup>1</sup> The reforms commenced in August 2021 and aim to improve network visibility and support an effective connection regime for distribution level resources. Technical developments were delivered through the LTDS reforms Working Group (LTDS WG) of industry experts. Participants included representation across network operators, end users, software vendors and academics.

In April 2023, the LTDS WG concluded, delivering a proposed updated set of data standards implementing the Common Information Model (CIM) for the LTDS requirement on network planning data. The outputs from the LTDS WG development process are the following technical documents along with supporting artefacts:

- **LTDS Grid Modelling Guidelines:** these overview the grid modelling approach and detail the grid model data requirements of the LTDS CIM revision
- **LTDS Data Exchange Specifications (this document):** these outline the detailed information and requirements related to the exchange of LTDS grid model data using the CIM

The guidance provided in these documents is **not mandatory** at this stage, and LTDS data should continue to be provided as per the current Form of Statement.<sup>2</sup> Through consultation Ofgem intend to update the Form of Statement to mandate the additional requirement of grid model data using the CIM as detailed in the guidance documents.

---

<sup>1</sup> [Next steps on our reforms to the Long Term Development Statement \(LTDS\) and the Key Enablers for DSO programme of work | Ofgem](#)

<sup>2</sup> [Direction pursuant to paragraph 25.2 of the electricity distribution licence relating to the preparation and maintenance of the Long-Term Development Statement | Ofgem](#)

# 1 Data Exchange Specifications

This document provides the proposals for the detailed information and requirements related to the exchange of LTDS grid model data. It overviews the underlying information model and describes the LTDS profiles and serialisation requirements in detail. It is intended primarily as a resource for developers of data exchange interfaces. It may also be a useful reference for grid modellers interested in understanding exchanged data in more detail.

## 1.1 Background

When the CIM is used to support data exchange among applications, there are three levels of definition:

- The underlying canonical information model provides the data structure for all exchanges.
- Profiles define the structure of a specific type of data exchange. A profile is a subset of the classes, attributes and associations of the information model.
- Exchanged data is an instance of data conforming to a profile expressed using a specific serialisation method.

In line with those levels, this document is divided into three main sections:

- Section 1.2 LTDS Information Model describes the information model which underlies all LTDS data exchanges and outlines the approach used in its definition.
- Section 1.3 LTDS Profiles describes the profiles which define the content and structure of specific sets of LTDS grid model data and the approach used in their definition.
- Section 1.4 LTDS Serialisation provides information on the serialisation of LTDS grid model data into CIM XML (the serialisation method currently defined by the International Electrotechnical Commission (IEC) CIM standards).

Additional reference information is provided in a collection of Appendices.

The foundation of the proposed LTDS grid model data exchange is provided by the CIM and the IEC standards which leverage it. The CIM information model is described in IEC 61970-301<sup>3</sup>. CIM profile standards are defined by IEC 61970-452<sup>4</sup>, IEC 61970-453<sup>5</sup>, IEC 61970-

---

<sup>3</sup> [IEC 61970-301:2020+AMD1:2022 CSV | IEC Webstore](#)

<sup>4</sup> [IEC 61970-452:2021 | IEC Webstore](#)

<sup>5</sup> [IEC 61970-453:2014+AMD1:2018 CSV | IEC Webstore](#)


456<sup>6</sup>, 61970-457<sup>7</sup>, and IEC 61968-13<sup>8</sup>, along with IEC 61970-600-1<sup>9</sup> and IEC 61970-600-2<sup>10</sup>, which together are known as CGMES (Common Grid Model Exchange Standard).

The CIM information model and IEC CIM-based profiles, as well as the LTDS information model and LTDS profiles are expressed in a data modelling language call Unified Modelling Language (UML). More can be learned about the use of UML by CIM from Section 4 of EPRI’s Common Information Model Primer: Eighth Edition<sup>11</sup>.

## 1.2 LTDS Information Model

The CIM is an information model that defines a common industry structure for a broad range of data critical to electric utilities, including grid model data. It can be utilised for a number of purposes, but its primary purpose is to structure shared data. When used as the basis for a specific data exchange implementation, like LTDS, it typically needs to be extended to meet local requirements. A standard approach to defining information model extensions is described in the ENTSO-E CGMES Profiling User Guide v1.0<sup>12</sup> and has been followed in creating the LTDS information model.

Because ongoing alignment with the IEC 61970 family of standards is key to the long-term usefulness of LTDS data, several “layers” of extensions are employed in the definition of the LTDS information model:

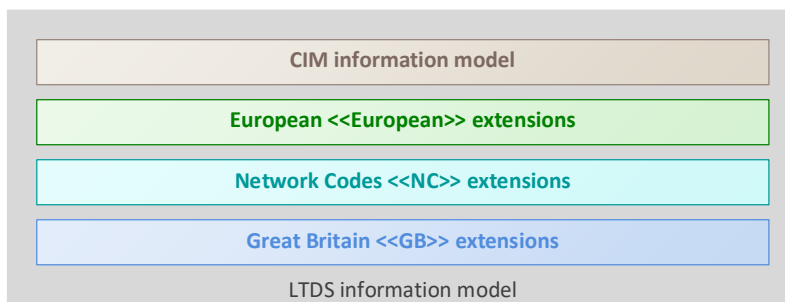

The CIM information model, expressed in UML, is maintained using a structured, collaborative process sponsored by UCA International<sup>13</sup> (UCAI). Its content is periodically snapshotted and

---

<sup>6</sup> [IEC 61970-456:2021 | IEC Webstore](#)

<sup>7</sup> [IEC 61970-457:2021 | IEC Webstore](#)

<sup>8</sup> [IEC 61968-13:2021 | IEC Webstore](#)

<sup>9</sup> [IEC 61970-600-1:2021 | IEC Webstore](#)

<sup>10</sup> [IEC 61970-600-2:2021 | IEC Webstore](#)

<sup>11</sup> [Common Information Model \(CIM\) Primer: Eighth Edition | EPRI](#)

<sup>12</sup> [CGMES profiling User Guide \(entsoe.eu\)](#)

<sup>13</sup> [Home - UCAIug](#)

published as the IEC 61970-301 standard, the current version of which is IEC 61970-301:2022. The CIM information model forms the base on which a set of extensions (the European <<European >> and Network Codes <<NC>> extensions) developed by the European Network Transmission System Operator for Electricity (ENTSO-E) are layered. Together those layers form the base for the Great Britain <<GB>> extensions required to support data exchanges in Great Britain, including (but not limited to) LTDS.

The scope of the CIM information model is broad and the grid model portion of CIM includes numerous classes not relevant to LTDS grid model data exchange. Those classes fall into the following general categories:


- Classes describing dynamic (sub-cycle) transient behaviours of generators, loads and protection equipment.
- Classes describing HVDC equipment
- Classes describing measurements and measurement values
- Classes which support the description of schedules

The UML class diagrams below cover the portions of the CIM information model relevant to LTDS. Each of the diagrams contains a group of related classes which model a particular type of grid equipment or a particular type of grid-related data. The diagrams appear in the following order:

- Diagrams of groups of classes describing the physical grid and its operating state:
  - Building block classes
  - General equipment, control and external modelling classes
  - Switch-related classes
  - Circuit-related classes
  - Transformer-related classes
  - Transformer tap changer-related classes
  - Load-related classes
  - Generation-related classes (2 diagrams)
  - Shunt and static VAr compensator-related classes
  - Limits-related classes
  - Containment-related classes (grouping of grid equipment by facility and region)
  - Geospatial location-related classes
  - System capacity and connection activity classes
- Diagrams of groups of classes describing the results of power flow analysis:
  - Classes describing grid topology (output of topology processing)
  - Power flow solution-related classes


- A diagram describing a set classes which support display layout definitions

Each diagram contains classes from the underlying CIM information model along with related European, Network Codes and Great Britain extension classes. The class colouring convention followed in the UML class diagrams is illustrated below:

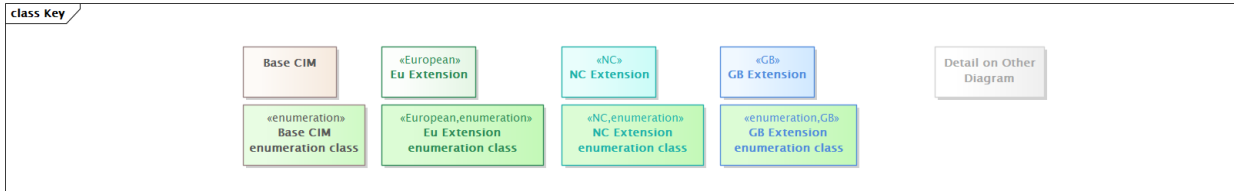

The Building Block diagram includes:


- The foundational CIM classes (e.g., Identified Object, PowerSystemResource, ConductingEquipment, Terminal, ConnectivityNode, BaseVoltage)
- Two classes used for grouping and naming (e.g., ReportingGroup, BusNameMarker)

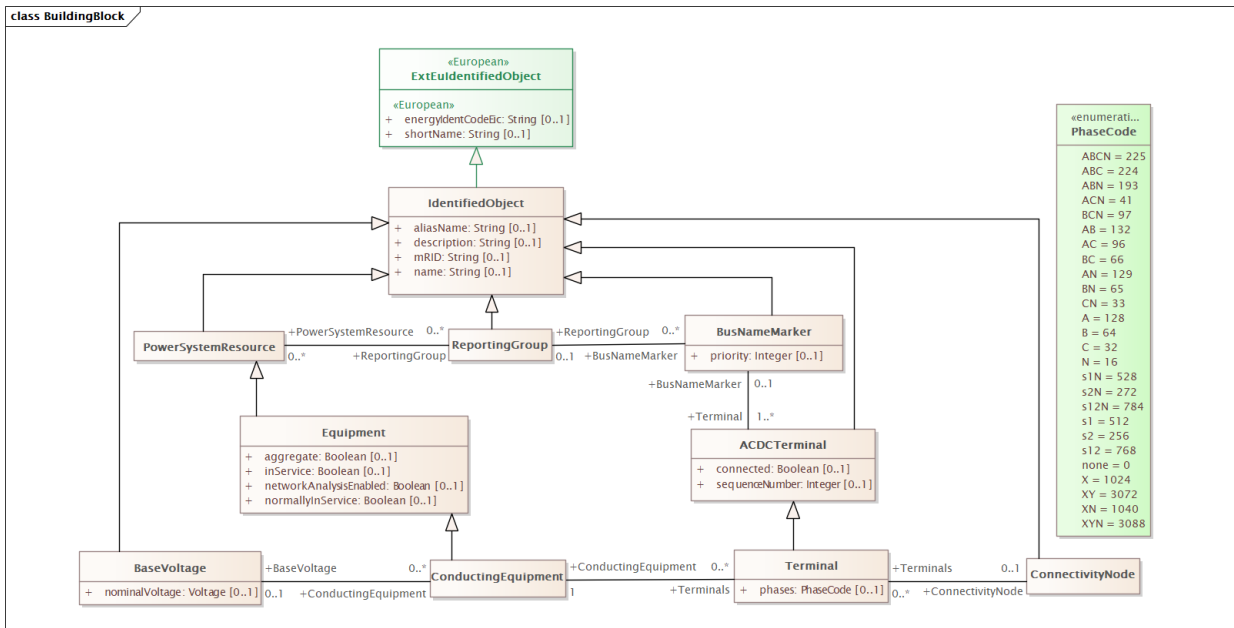




The ConductingEquipment RegulatingControl and External diagram includes:


- The RegulatingControl class (which is referenced by classes that support generator, tap changer and shunt compensator modelling)
- The CIM classes used to support external network modelling (BoundaryPoint and ExternalInjection)
- The BusbarSection and BusbarGroup classes
- Several ConductingEquipment subtype classes which have no additional associated objects (e.g., SeriesCompensator, Ground, Junction, Clamp)

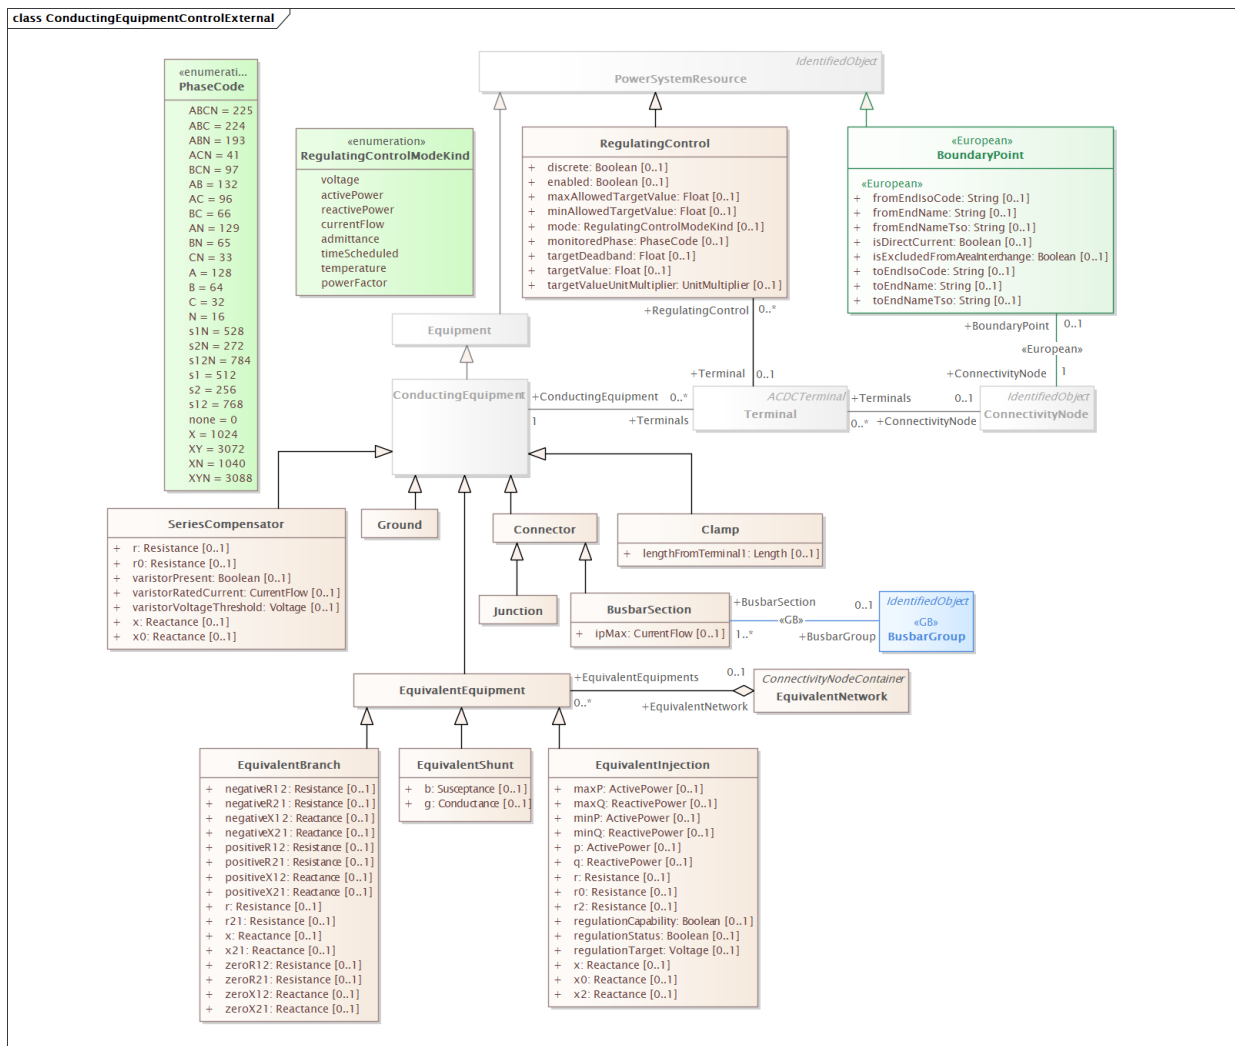


The Switch diagram shows the CIM classes which support switching device modelling:

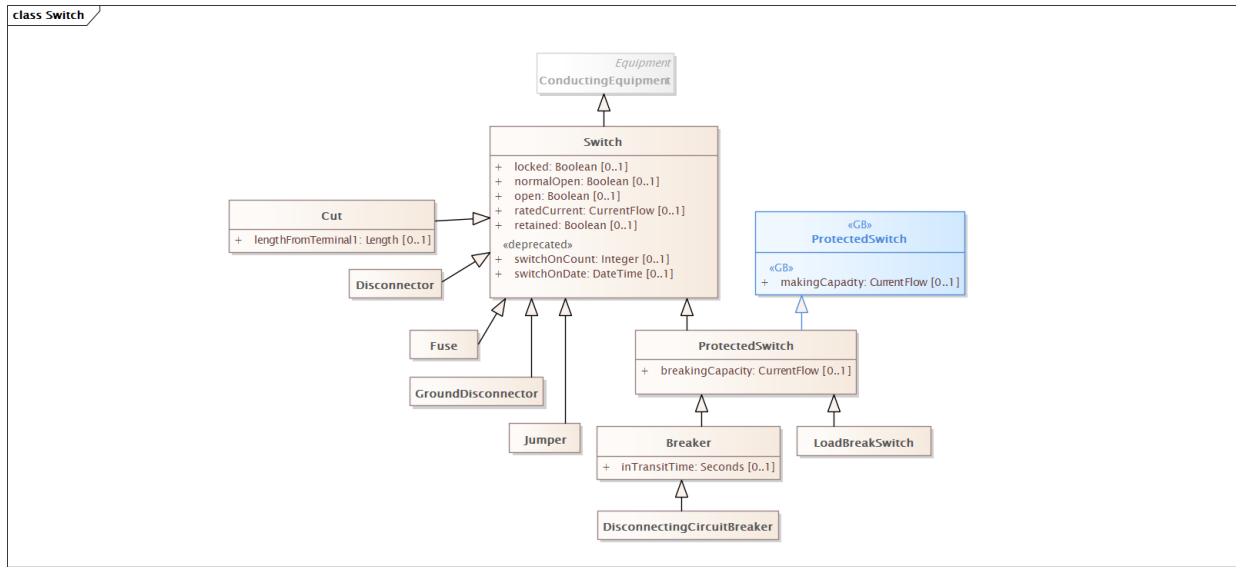


The ACLineSegment diagram shows the CIM classes which support circuit modelling:

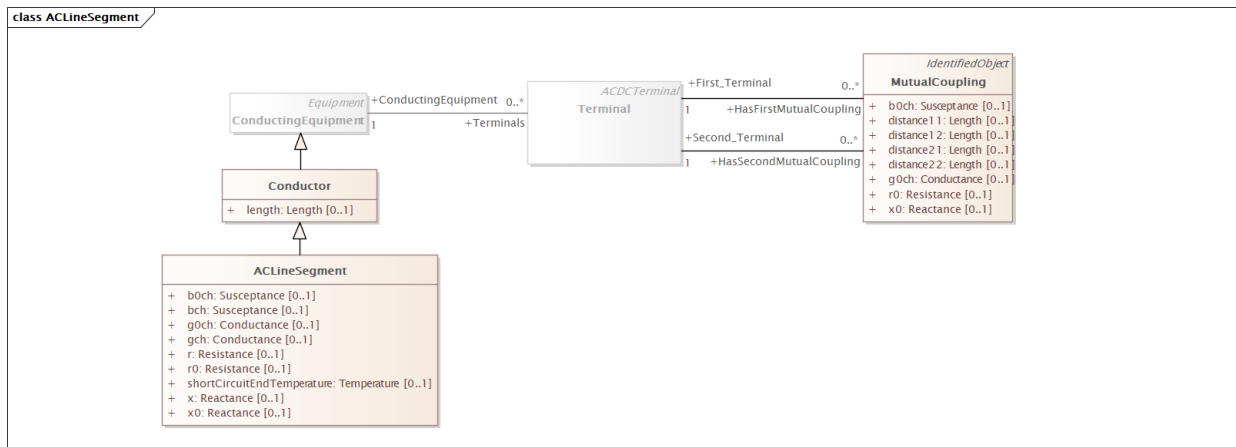


The PowerTransformer diagram shows the CIM classes which support transformer modelling:

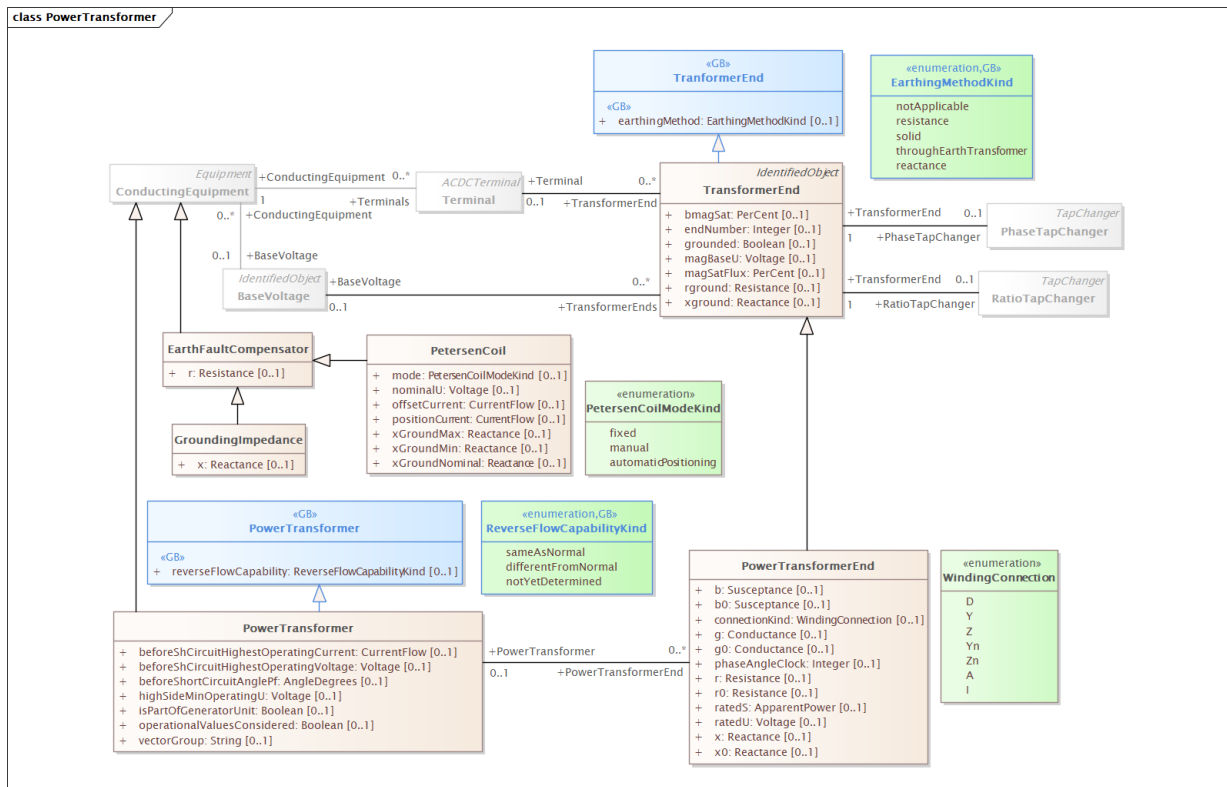


The TapChanger diagram shows the CIM classes which support transformer tap changer modelling:

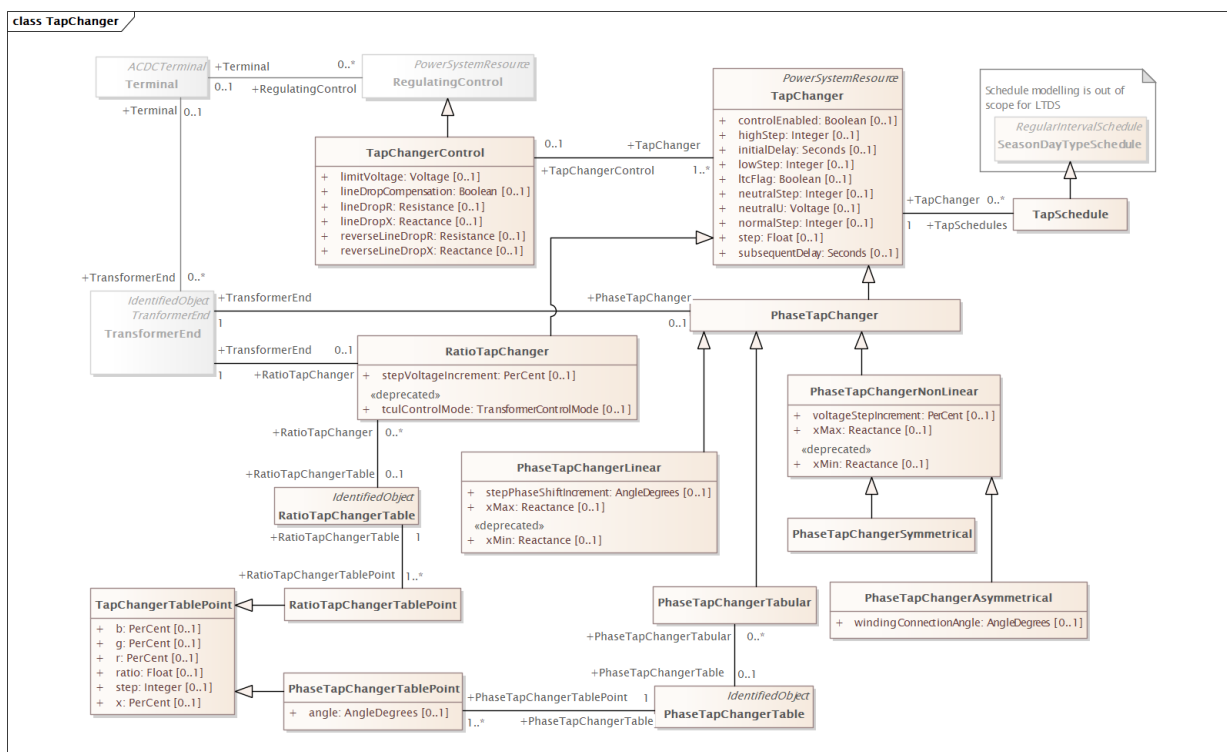


The EnergyConsumer diagram shows the CIM classes which support load modelling:

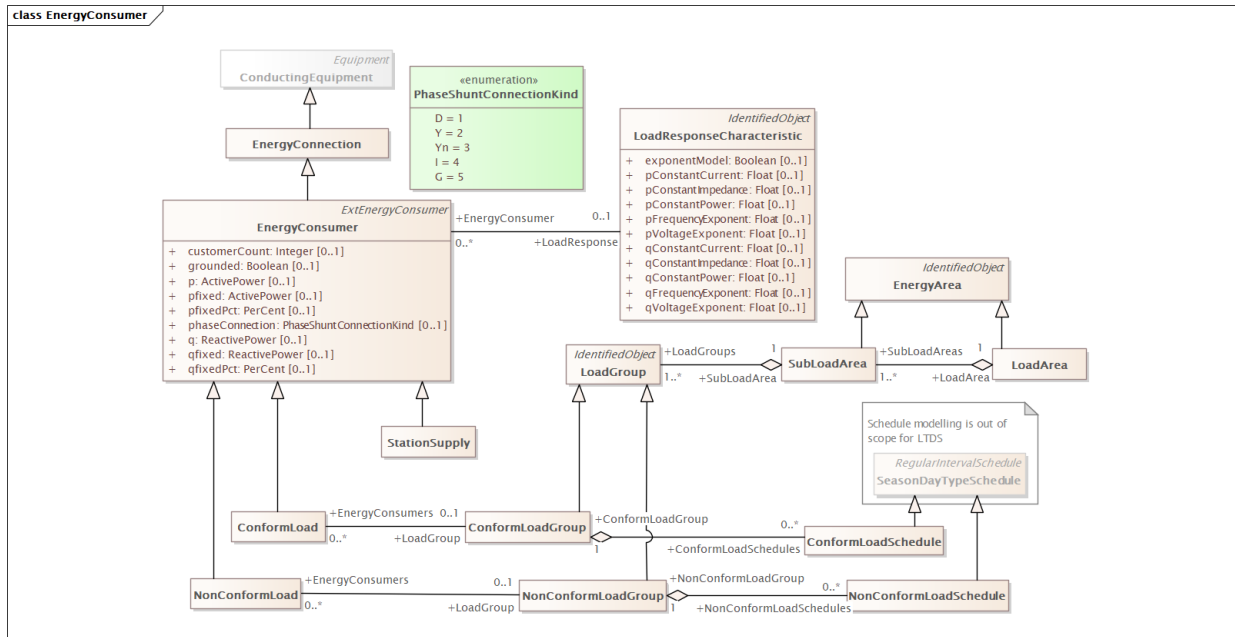


The RegulatingCondEq diagram shows the foundational CIM classes which support generation modelling:

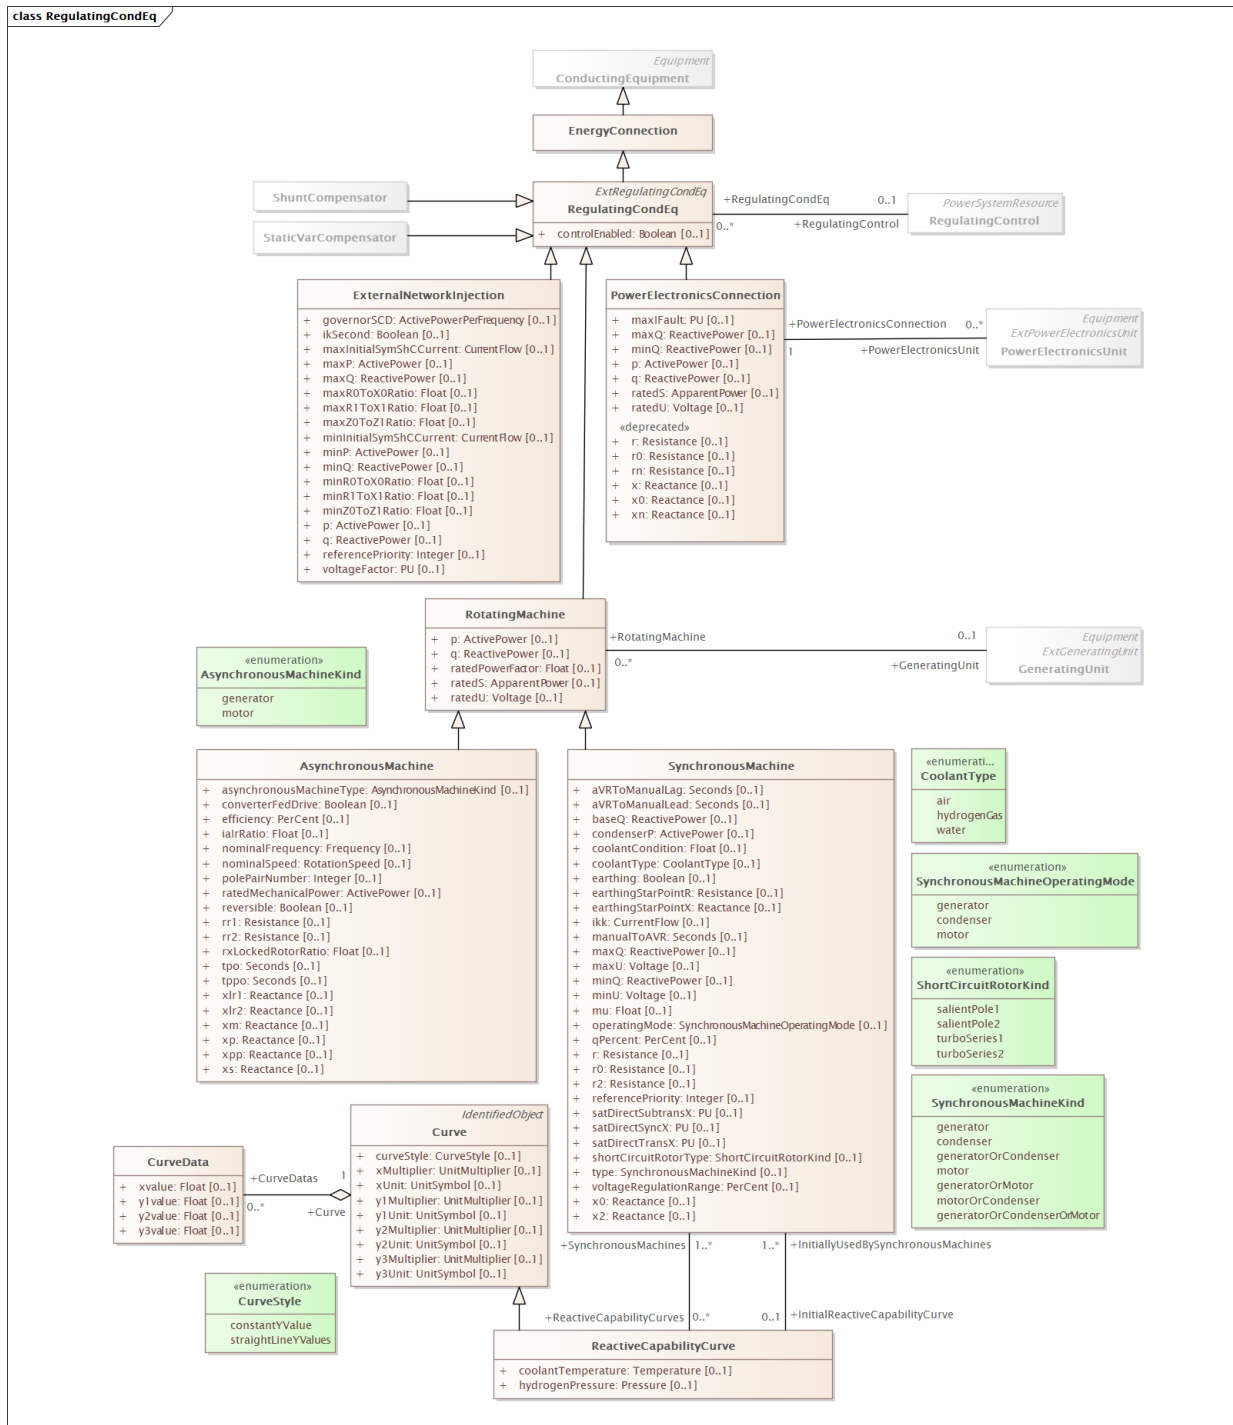


The GeneratingUnit diagram shows the classes that supply additional detail for generation modelling:

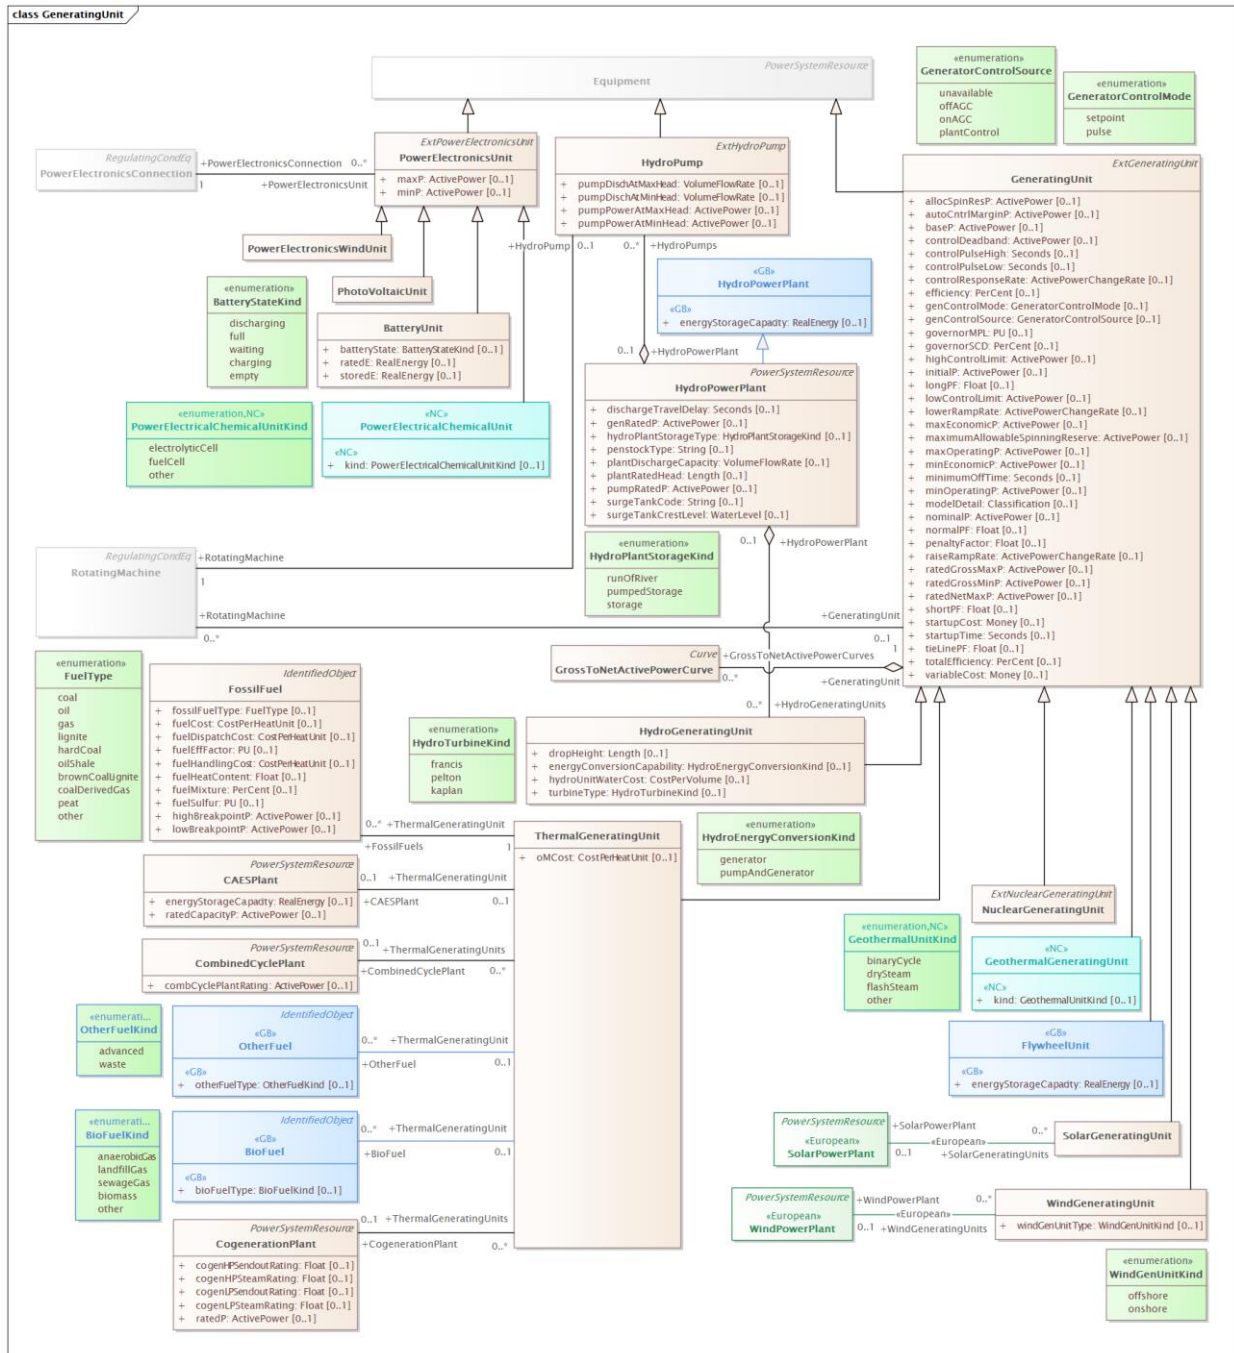


The ShuntCompensator diagram shows the CIM classes which support shunt compensator and static VAR compensator modelling:

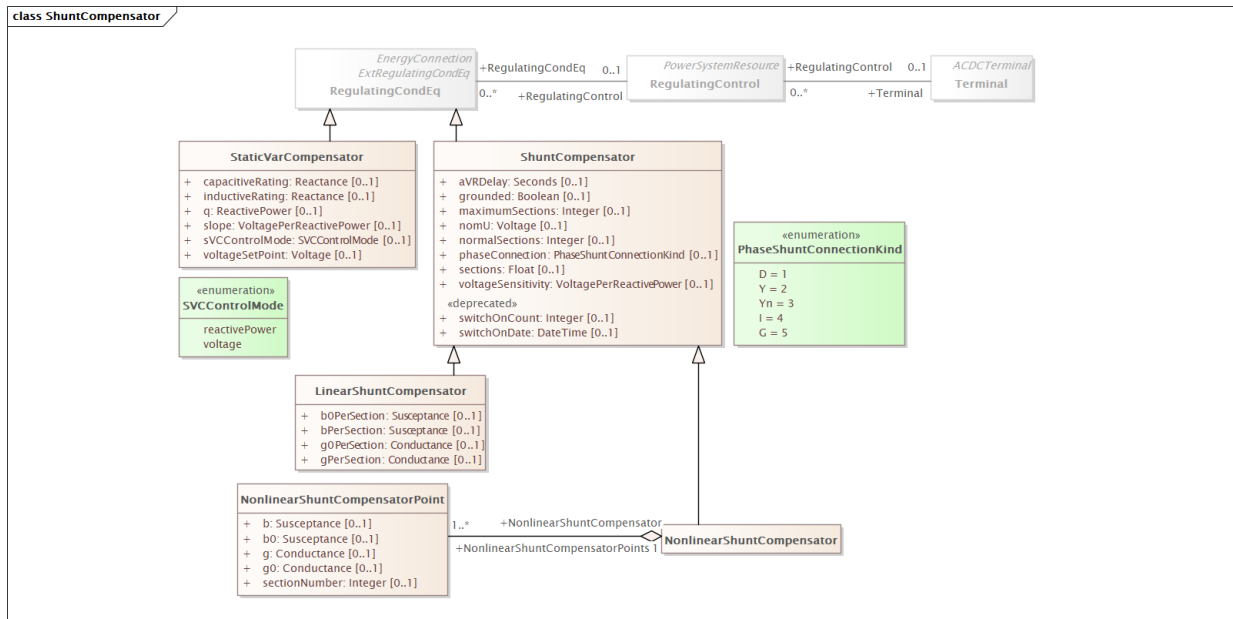


The OperationalLimitSet diagram shows the CIM classes which support the modelling of limits:

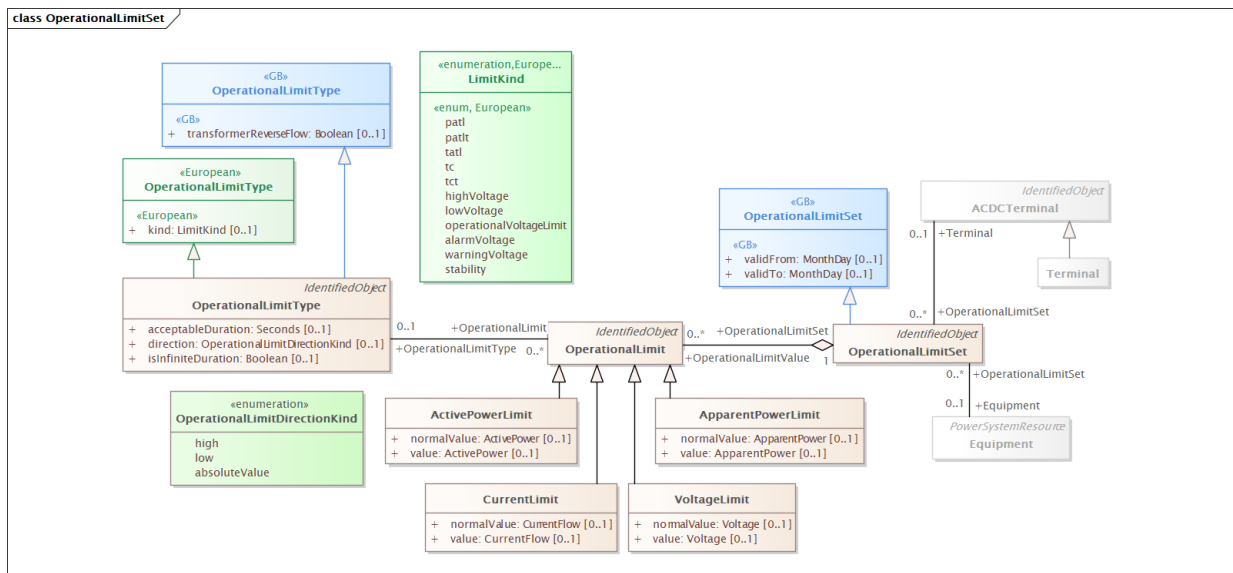

The EquipmentContainer diagram shows the CIM classes which support the containment in grid equipment in facilities and regions:

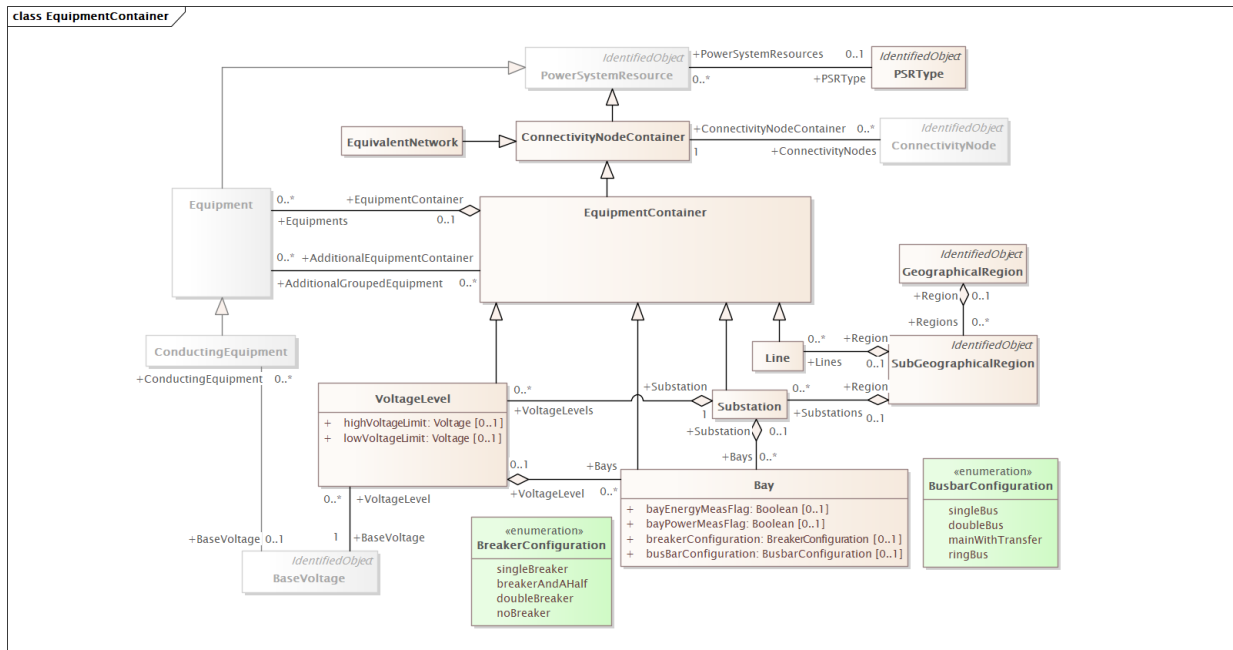


The Geographical Location diagram shows the CIM classes which describe the geospatial location of grid equipment and facilities:

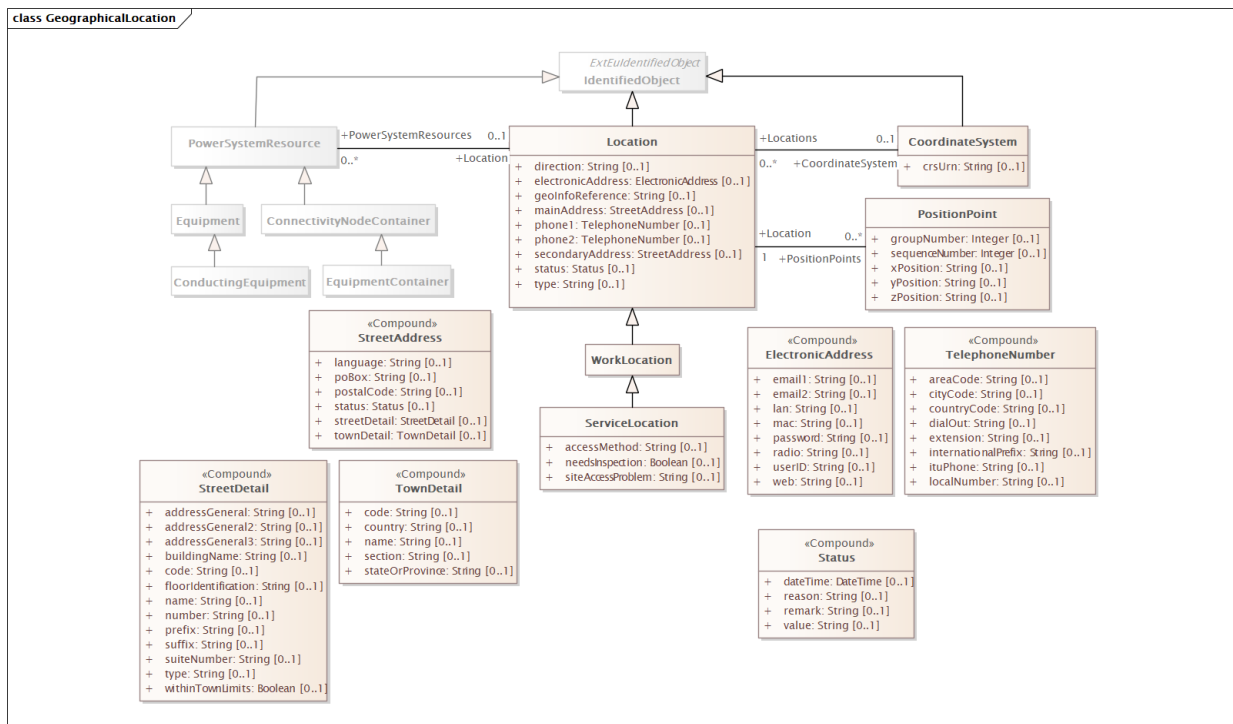




The System Capacity diagram shows the CIM classes which support the modelling of various types of capacity information and connection activity modelling:

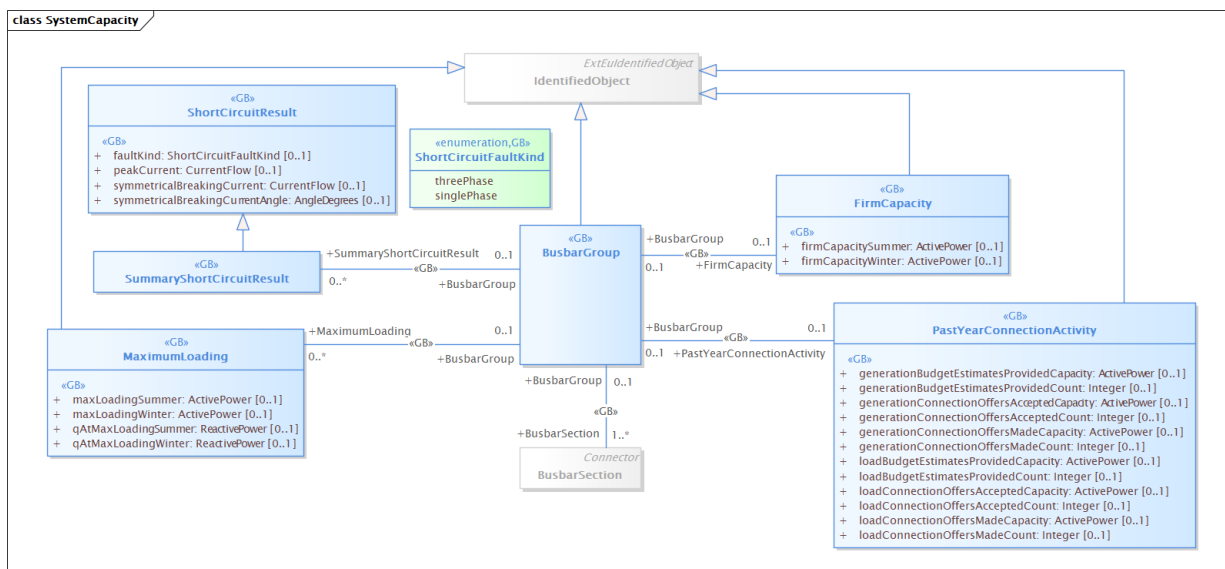


The CIM UML information model is maintained using Sparx System’s Enterprise Architect tool<sup>14</sup>. The Enterprise Architect file Appendix\_1\_CIM100v111\_UK\_LTDS\_AllProfiles\_3July2023pab2.eap containing the complete LTDS information model (underlying CIM information model along with related European, Network Codes and Great Britain extensions) is supplied as *Appendix 1 – LTDS Information Model and Profiles*. The Appendix\_1\_CIM100v111\_UK\_LTDS\_AllProfiles.eap file contains not only the LTDS information model, but also the LTDS profile in subpackages under the main Model:

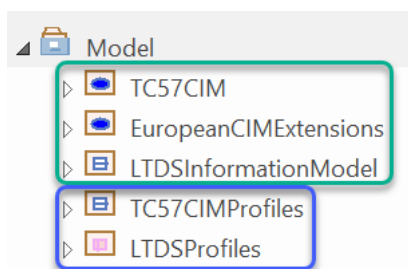

The top three packages (boxed in green) comprise the information model, the lower 2 packages make up the profiles. The TC57CIM package contains the underlying CIM information model, the EuropeanCIMExtensions package contains European and Network Codes extensions and the LTDSInformationModel package contains the Great Britain extensions defined for LTDS.

<sup>14</sup> [Enterprise Architect | Sparx Systems](#)

The above diagrams are located in LTDSInformationModelDiagrams sub-package of the LTDSInformationModel package:

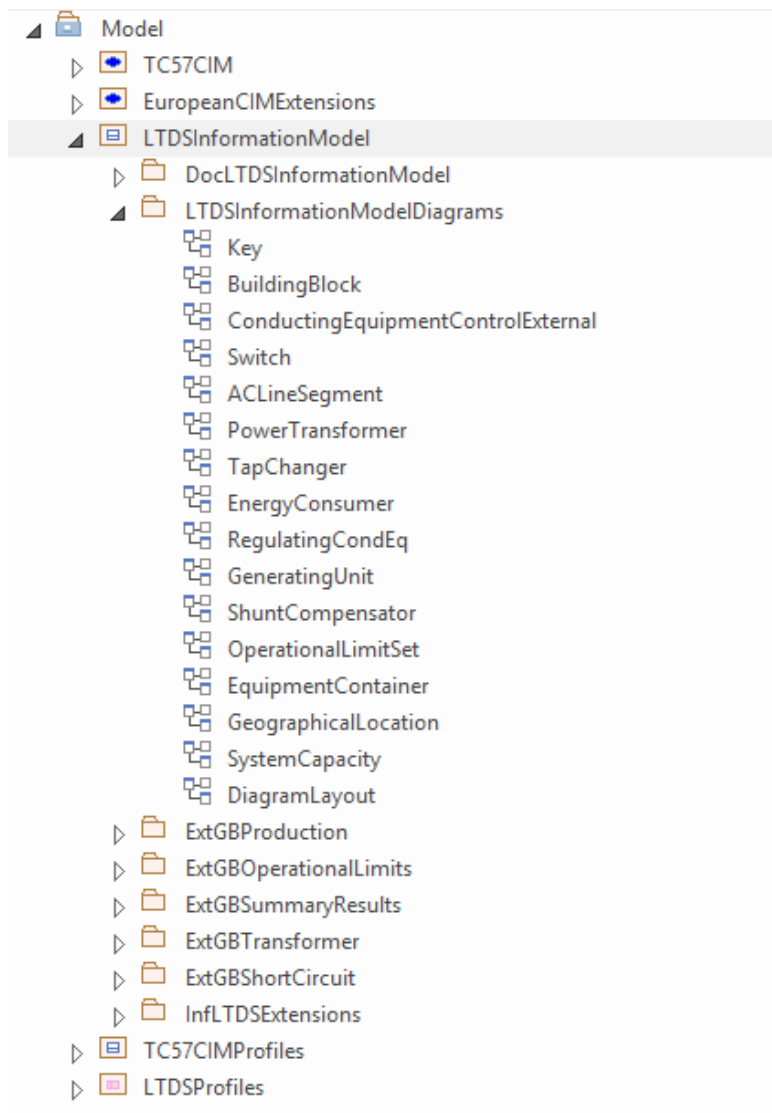

## 1.3 LTDS Profiles

### 1.3.1 CIM grid model profiles

CIM generally defines a profile as “a subset of the classes, attributes and associations of the information model”. CIM exchanges of grid model data refine that definition a bit further and consider a profile to be “a non-overlapping subset of CIM classes, attributes and associations defined to organise grid model data and support its exchange”. CIM grid model profiles organise grid model data primarily for the purpose of studies which involve power flow calculation, i.e., they describe inputs such as the physical model and the grid operating state as well as the output of power flows as a separate exchange from the inputs.

The CIM grid model profiles, like the grid model-related portion of the CIM information model, contain a broader scope of information than is required by LTDS. The CIM profiles of relevance to LTDS and their groupings are as follows:

- The **Physical group** of profiles describes the grid itself, providing information about the behaviour, connectivity, and geospatial location of the equipment that makes up the electrical system. Profiles in the Physical group are:
  - The Equipment profile which describes basic equipment and connectivity and provides the foundation on which the data of the other Physical profiles are layered.
  - The Short Circuit profile which describes equipment electrical behaviour characteristics essential to the execution of short circuit studies.
  - The Geographical Location profile which describes the geospatial location of equipment, facilities, and load and generation.
- The **Situation group** of profiles describes a grid operating state and is used, in conjunction with foundational Physical data, as input to network analysis. It has a single profile:
  - The Steady State Hypothesis profile which represents load and generation injections, the operating state of the switching equipment and control settings.
- The **Solution group** of profiles describes the output resulting from a successful power flow execution. It has two profiles:
  - The Topology profile which describes the output of topology processing which eliminates closed switches and zero impedance branches.
  - The State Variables profile which describes the output of a power flow calculation, including node voltage and angle and active and reactive power flows.

An additional profile, the Diagram Layout profile, describes the layout of CIM objects for visualisation on a display. It can reference objects and attributes from any of the other profiles.

### 1.3.2 Approach to LTDS profile development

IEC standard profiles of relevance to LTDS grid model data exchange are defined by the 61970-45x set of standards<sup>15,16,17</sup>, the IEC 61968-13 standard<sup>18</sup>, and the IEC 61970-600-2<sup>19</sup> standard. The usual approach to the definition of profiles for a specific implementation of CIM-based data exchange (like LTDS) is to start with a set of relevant IEC standard profiles and modify them as necessary to meet local requirements. The LTDS profile development process followed this philosophy, but did so using an unusually rigorous methodology, in which each LTDS profile was defined as a “delta” from an underlying standard profile. As a result, developers and data modellers using the LTDS profiles are provided with a clear, concise identification of changes from a known existing profile. This approach is intended to ease both initial implementation efforts and facilitate longer term solution evolution.

The standard CGMES v3.0 exchange profiles – as expressed in IEC 61970-600-2 - were selected as the underlying standard profiles. This was done for a variety of reasons:

- The CGMES v3.0 profiles align very closely with the IEC 61970-45x set of standards and incorporate relevant modelling (primarily related to geographical location) from IEC 61968-13.
- There is continuous ongoing CIM and CGMES alignment activity occurring within IEC with support from ENTSO-E community via the established formal liaisons.
- The CGMES standards are intended to meet the requirements specified in European Network Codes.
- CGMES v3.0 is the most recent, approved version of the CGMES standard, correcting a number of issues present in earlier versions.
- Interfaces based on CGMES v3.0 are implemented on several vendor tools (and the clear expression of differences will enable those tools to more easily accommodate LTDS data).
- The use of CGMES v3.0 enables the future evolution of LTDS to take advantage of European advancements.

It is hoped that expressing LTDS profiles as deltas from CGMES v3.0 profiles will set a precedent for the definition of other local CIM-based profiles, particularly in the United Kingdom. If used widely, this approach to profile definition has the potential to make data more accessible and tools more interoperable across Europe.

---

<sup>15</sup> [IEC 61970-452:2021 | IEC Webstore](#)

<sup>16</sup> [IEC 61970-453:2014+AMD1:2018 CSV | IEC Webstore](#)

<sup>17</sup> [IEC 61970-456:2021 | IEC Webstore](#)


<sup>18</sup> [IEC 61968-13:2021 | IEC Webstore](#)

<sup>19</sup> [IEC 61970-600-2:2021 | IEC Webstore](#)

The definition of LTDS profiles as deltas to CGMES v3.0 is accomplished via a “layered” approach not unlike the layered approach to information model definition described above. Two LTDS “difference” profiles are defined for each CGMES v3.0 profile:

- An “LTDS deviation from CGMES” profile, which describes differences from the data structure defined in a CGMES v3.0 profile.
- An “LTDS extension to CGMES” profile, which describes additional data structures not defined by a CGMES v3.0 profile.

The complete profile stack (including the CIM standard profiles on which CGMES v3.0 profiles are based) looks like this:

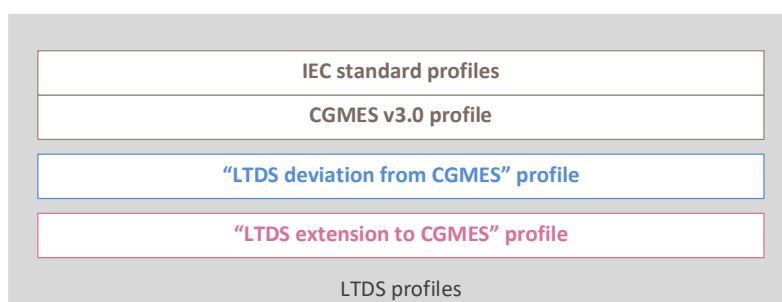

While the layered approach offers significant benefits, it is not an approach that has been used elsewhere, so tooling has not (yet) been specifically developed to support it. The LTDS layered profiles were defined primarily using existing tooling, but there is an area where future tool development would be useful. A bit of background information is necessary to understand where the additional tooling support is needed.

Several profiling tools, among them CimConteXtor<sup>20</sup>, use UML as the mechanism by which a profile designer specifies the information model subset comprising a profile. (CimConteXtor is the most widely used profiling tool in Europe and is an add-in to the Sparx Enterprise Architect application.) Other profiling tools leverage mechanisms other than UML to express profile design. Regardless of the mechanism used for design, once profile design is complete, the profiling tool produces a machine readable version of the profile expressed in Resource Definition Framework Schema (RDFS). (As an example, after a profile is designed in CimConteXtor, an RDFS description of it is created by a companion tool called CimSyntaxGen<sup>21</sup>.) The IEC 61970-501 standard<sup>22</sup> describes the mapping of CIM grid model profiles expressed in UML to their RDFS equivalents.


---

<sup>20</sup> [CimConteXtor | Zamiren](#)

<sup>21</sup> [CimSyntaxGen | Zamiren](#)

<sup>22</sup> [IEC 61970-501:2006 | IEC Webstore](#)

In LTDS profile definition, the three individual profiles (CGMES v3.0, LTDS deviation from CGMES, and LTDS extension to CGMES) are first defined in UML and then each is expressed in RDFS. The rules regarding the changes to be made to the underlying RDFS profile by applying the two “difference” RDFS profiles are clear and can be implemented by a “profile merging” software tool. A beta version of a profile merging tool (called CimPal and available here: <https://github.com/griddigit/CimPal>) has been created and was used to produce a complete set of final LTDS RDFS profiles.

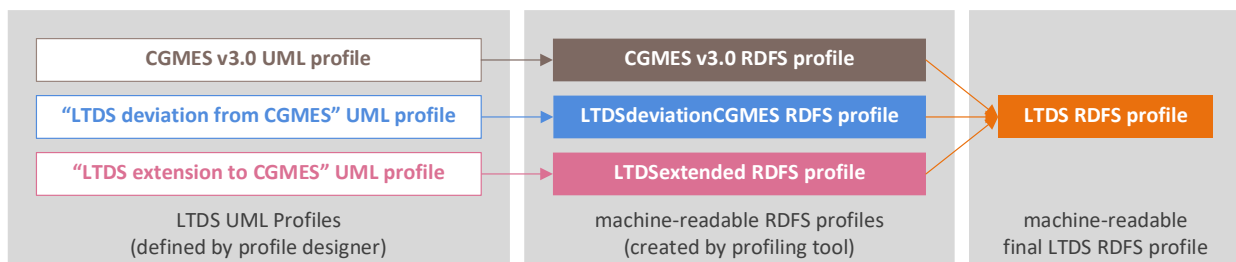

The final LTDS RDFS profiles are included, along with the CGMES v3.0 RDFS profile and the two difference RDFS profiles, in [Appendix 6 – LTDS Profiles in RDFS](#).

The expression of merged LTDS profiles in UML is the area where additional tooling support would be useful. The beta profile merging software works sufficiently well to support the use of LTDS profiles in LTDS grid model data exchanges, but a means of creating a merged profile in UML would be helpful. It would provide a human-understandable profile definition which could then be used as the direct source for a machine-generated final RDFS profile.


### 1.3.3 LTDS layered profiles in UML

This section contains a set of UML diagrams which detail the layered profiles used to structure LTDS data exchanges. Because UML does not exist for merged profiles, each diagram illustrates a base CGMES v3.0 UML profile (or portion of a profile) along with its two corresponding LTDS “difference” profiles (LTDS deviation from CGMES and LTDS extension to CGMES). The diagram layers are illustrated in the Key diagram below. The upper layer shows the CGMES v3.0 profile classes, attributes and associations. The middle layer shows the LTDS deviations from the upper layer:

- Classes (of any kind, including <<enumeration>> classes) which are eliminated completely in creating the merged LTDS profile are shown in grey. Eliminating a class eliminates all of its associations, whether or not the association is shown.
- Classes where CGMES v3.0 attribute requirements are modified when the merged LTDS profile is created are shown in pink. Modifications take one of three forms:

- Attribute exists in CGMES v3.0 and is not defined in LTDS (these are indicated with an <<LTDSnotDefined>> stereotype)
- Attribute is required in CGMES v3.0 and is optional in LTDS (the usual convention of [0..1] after the attribute name indicates this)
- Attribute is optional in CGMES v3.0 and is required in LTDS (the usual convention of nothing after the attribute name indicates this)

The lower layer shows the LTDS extensions to the upper layer, with classes and/or attributes to be added in creating the merged LTDS profile indicated in blue. Associations to be added are indicated by blue association lines.

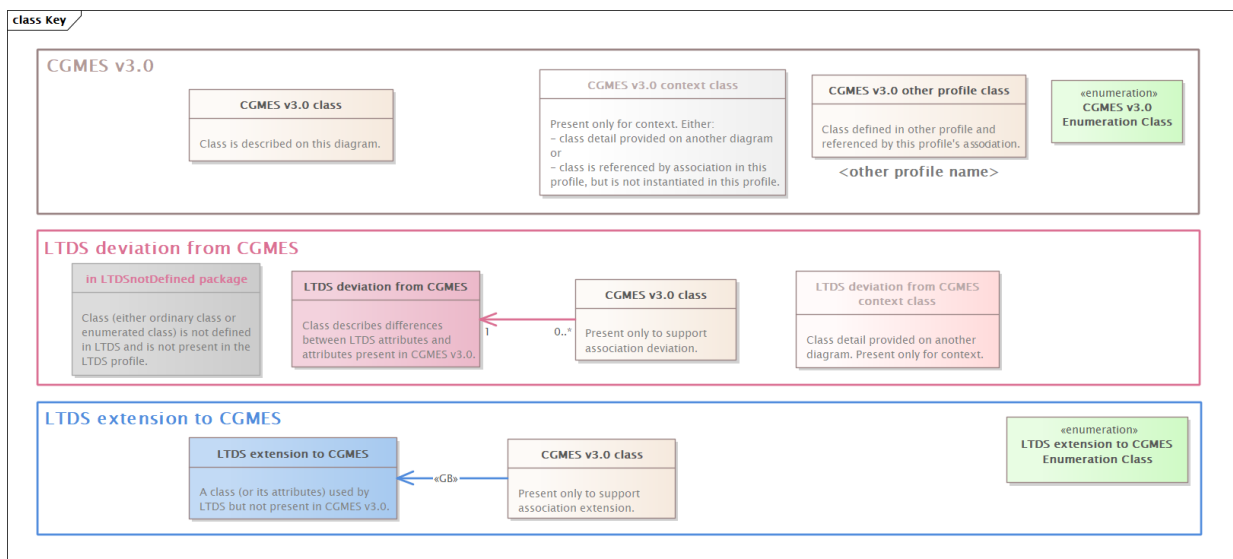

The UML profile diagrams below appear in the following order:

- Diagrams of the Physical profile group:
  - Equipment and Short Circuit profile diagrams of building block classes
  - Equipment and Short Circuit profile diagrams of general equipment, control and external modelling classes
  - Equipment and Short Circuit profile diagrams of switch-related classes
  - Equipment and Short Circuit profile diagrams of circuit-related classes
  - Equipment and Short Circuit profile diagrams of transformer-related classes
  - Equipment profile diagram of transformer tap changer-related classes
  - Equipment profile diagram of load-related classes
  - Equipment and Short Circuit profile diagrams of generation-related classes (3 diagrams)
  - Equipment profile diagram of shunt and static VAR compensator-related classes
  - Equipment profile diagram of limits-related classes

- Equipment profile diagram of containment-related classes
- Geographical Location profile diagram of geospatial location-related classes
- Diagrams of the Situation profile group:
  - Steady State Hypothesis profile diagram of control and external modelling classes
  - Steady State Hypothesis profile diagram of switch-related classes
  - Steady State Hypothesis profile diagram of transformer tap changer-related classes
  - Steady State Hypothesis profile diagram of load-related classes
  - Steady State Hypothesis profile diagrams of generation-related classes (2 diagrams)
  - Steady State Hypothesis profile diagram of shunt and static VAr compensator-related classes
  - Steady State Hypothesis profile diagram of limits-related classes
- Diagrams of the Solution profile group:
  - A Topology profile diagram of classes describing the output of topology processing
  - A State Variables profile diagram of power flow solution-related classes
- A diagram of the System Capacity profile (an LTDS-extension profile with classes describing system fault levels, loadings and capacities, along with connection activity)
- A diagram of the Diagram Layout profile classes



#### *1.3.3.1 Physical profile group*

Taken as a whole, the 20 diagrams of this section describe the LTDS Equipment, Short Circuit and Geographical Location profiles.





These diagrams show the basic building block portions of the Equipment and Short Circuit profiles:

This

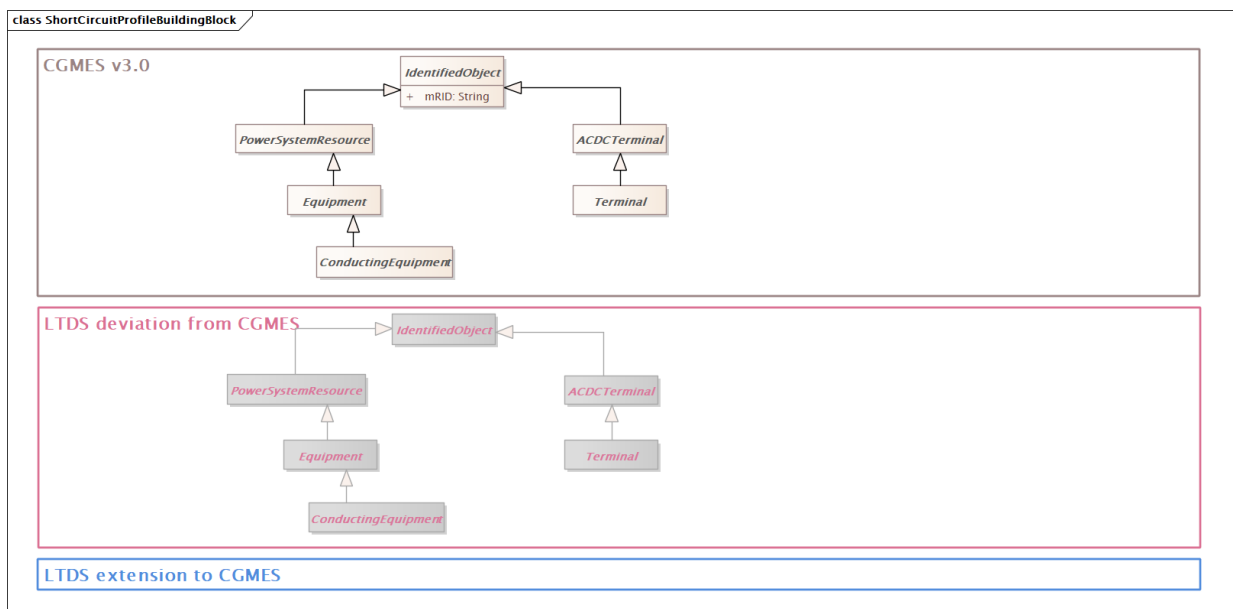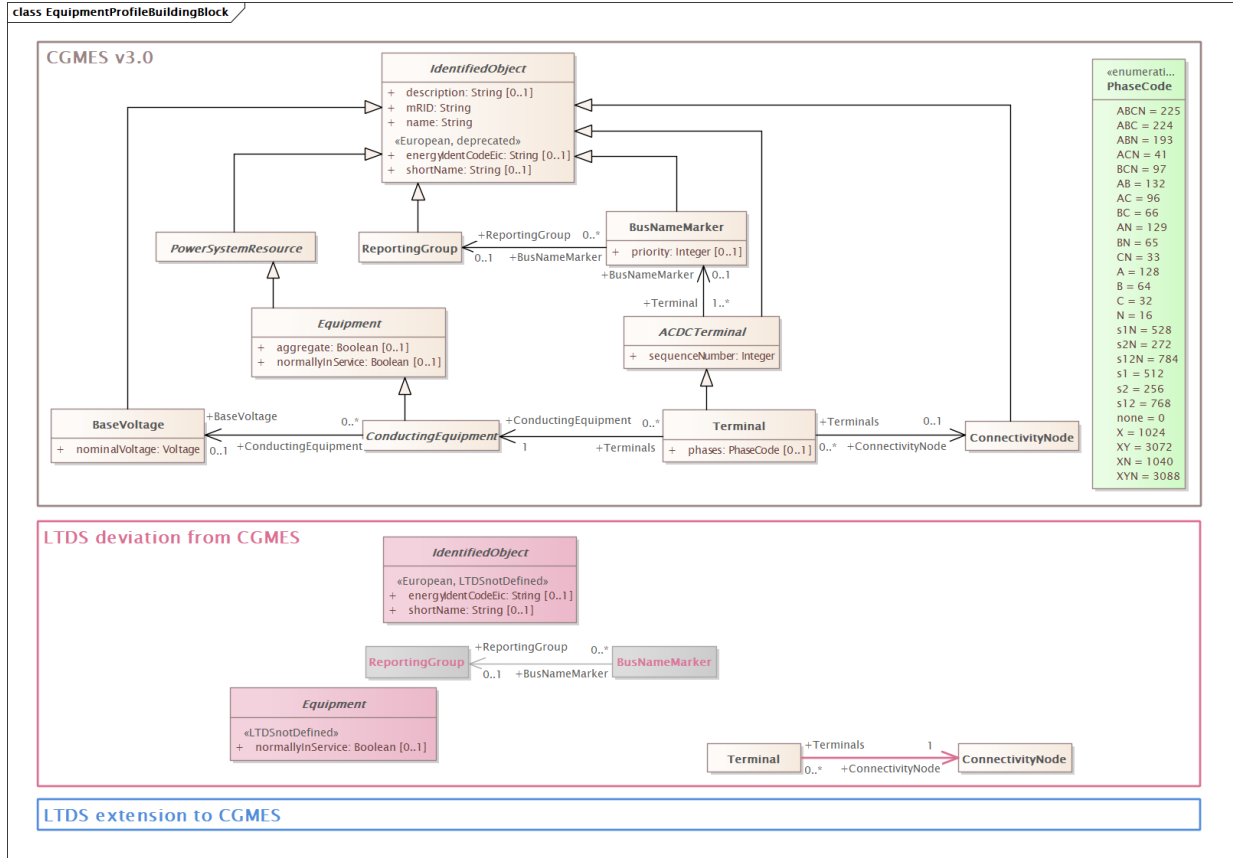



These diagrams show the portions of the Equipment and Short Circuit profiles which support general equipment, control and external modelling:

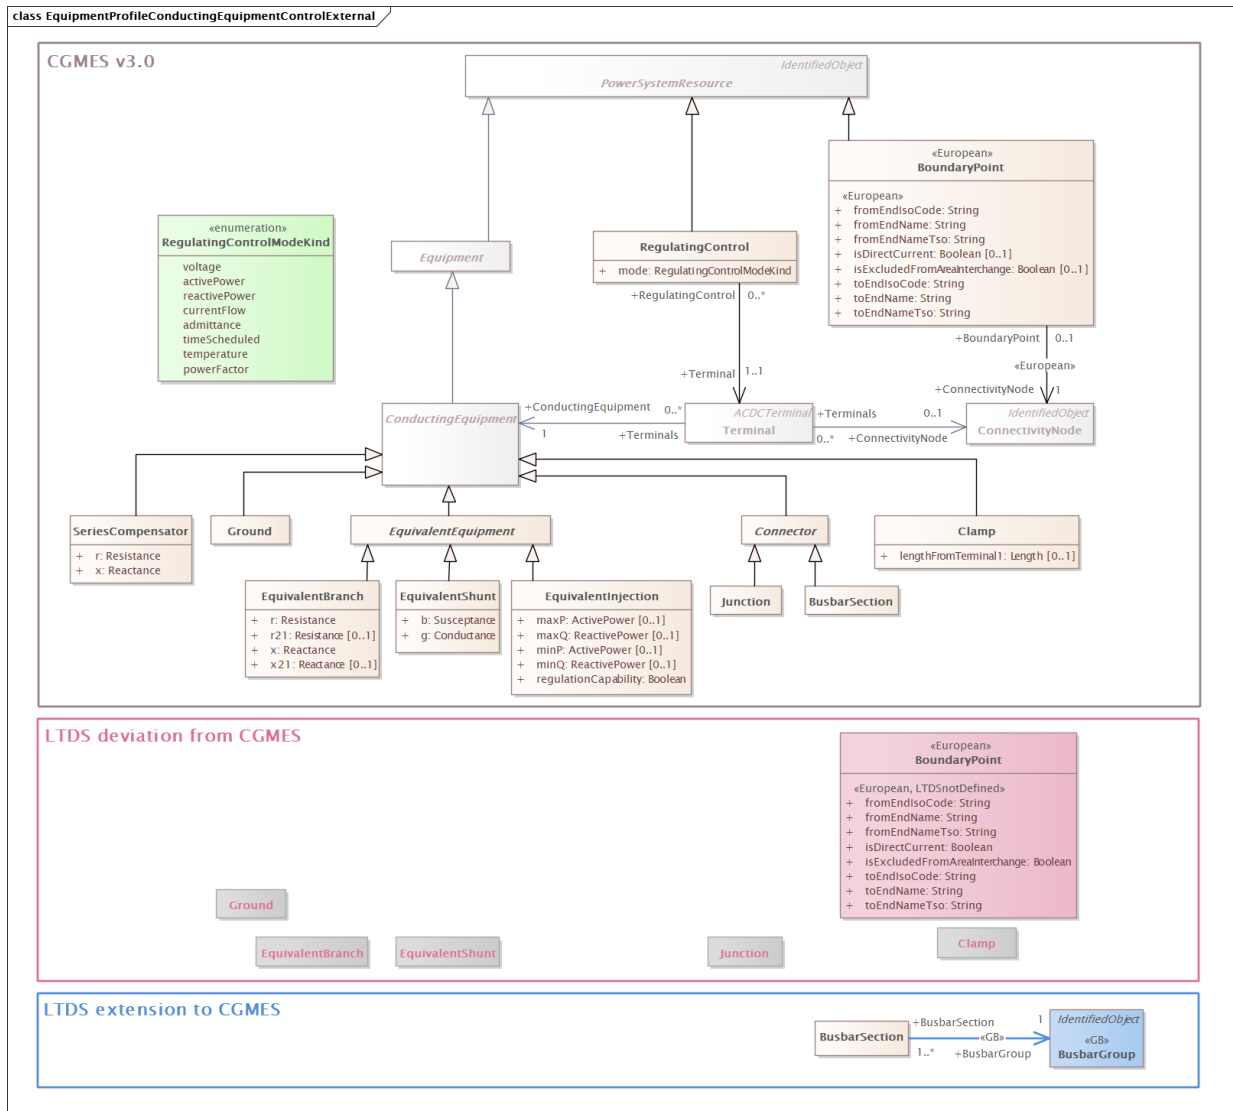


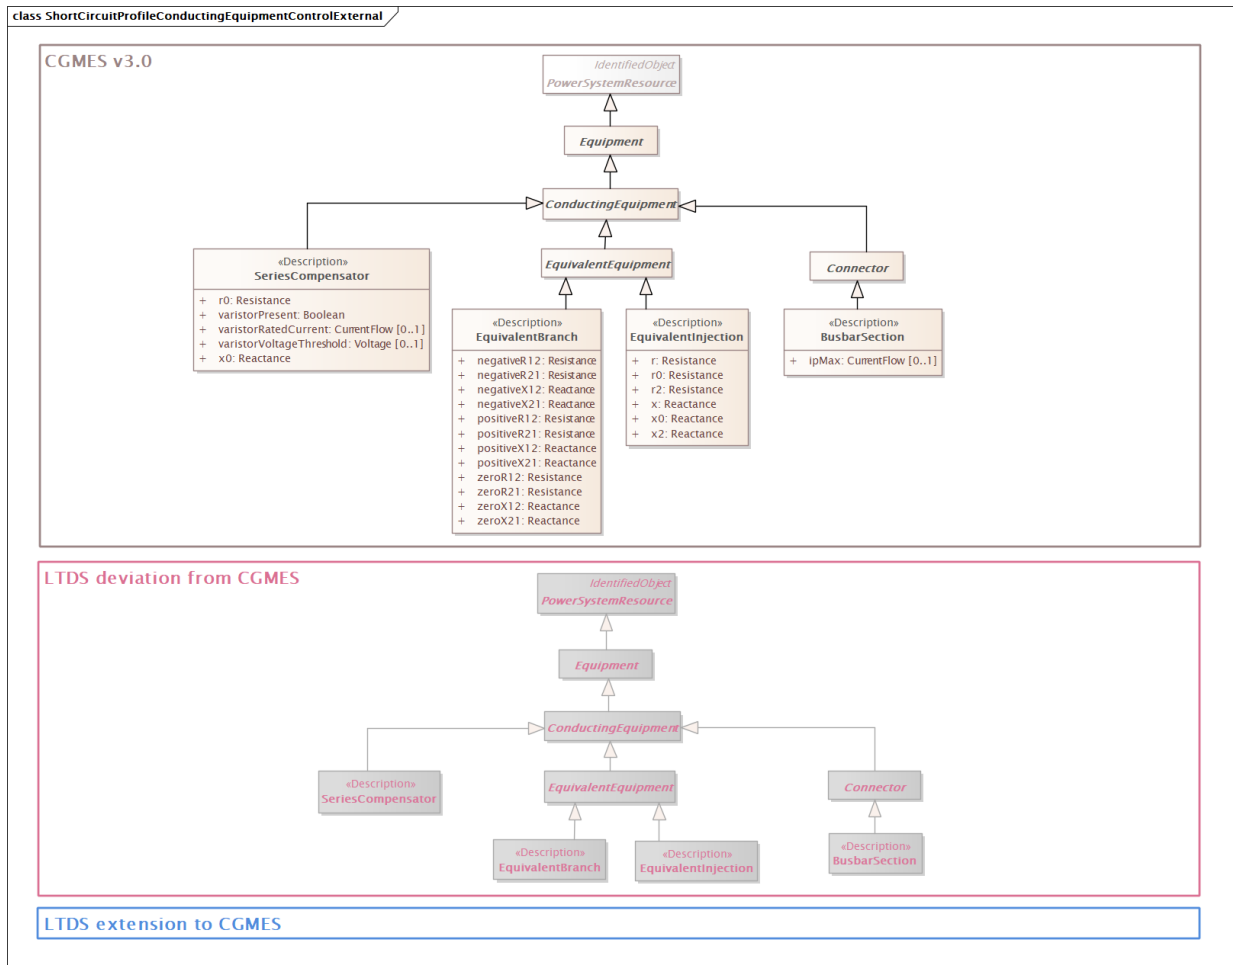


These diagrams show the switching device-related portion of the Equipment and Short Circuit profiles:


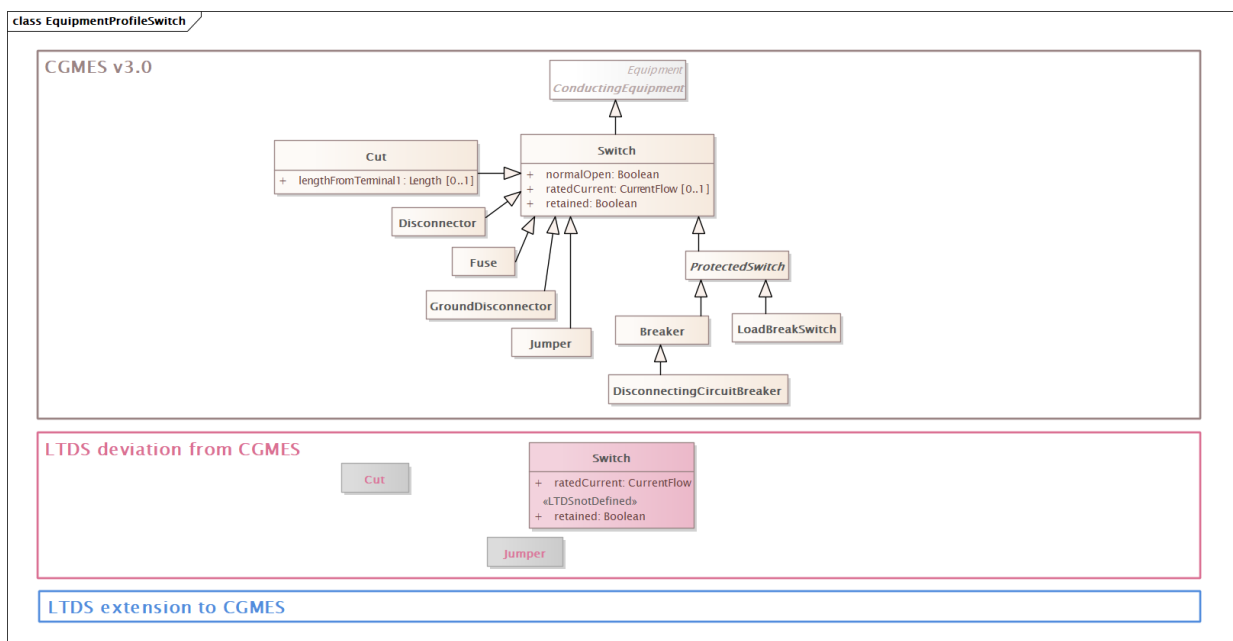


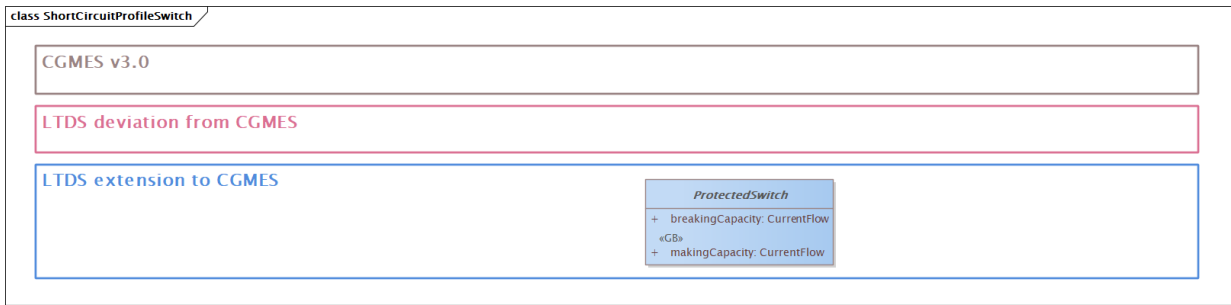


These diagrams show the circuit-related portion of the Equipment and Short Circuit profiles:

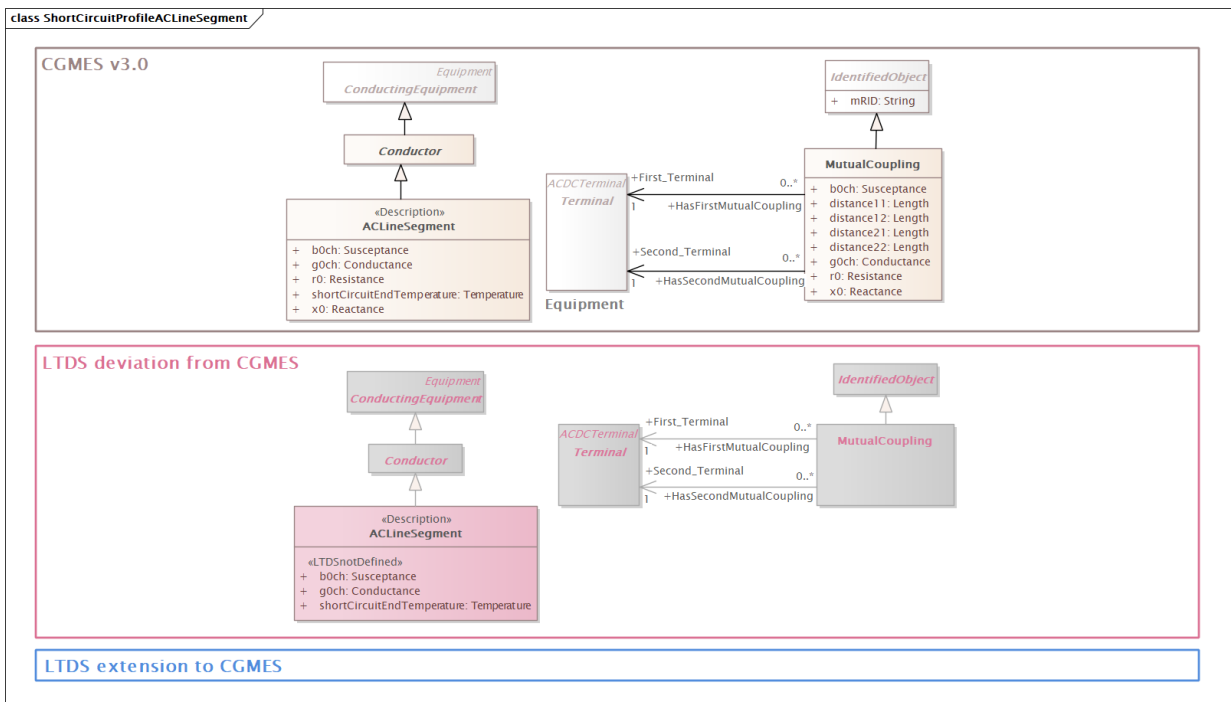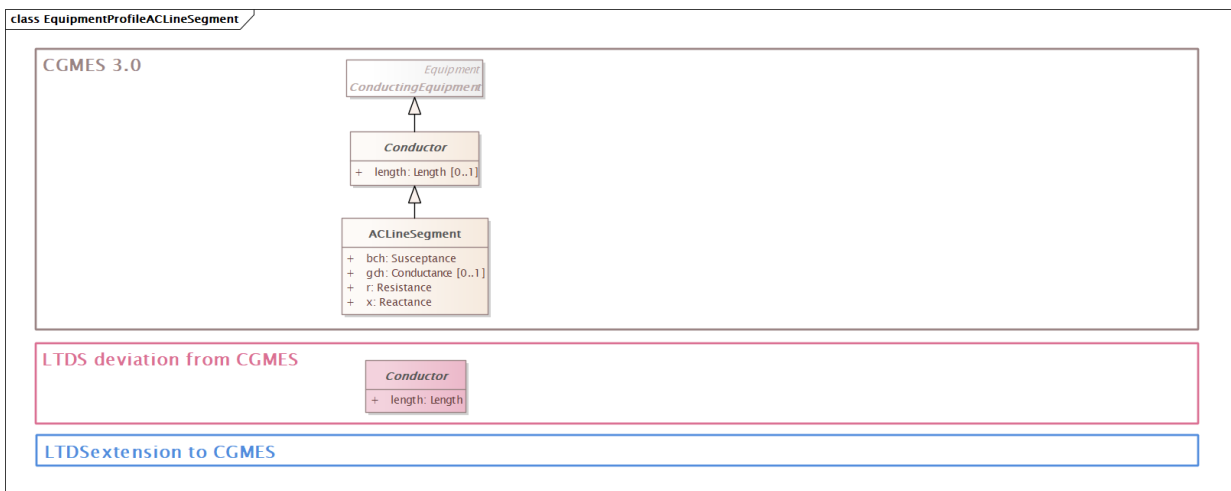


These diagrams show the transformer-related portion of the Equipment and Short Circuit profiles:

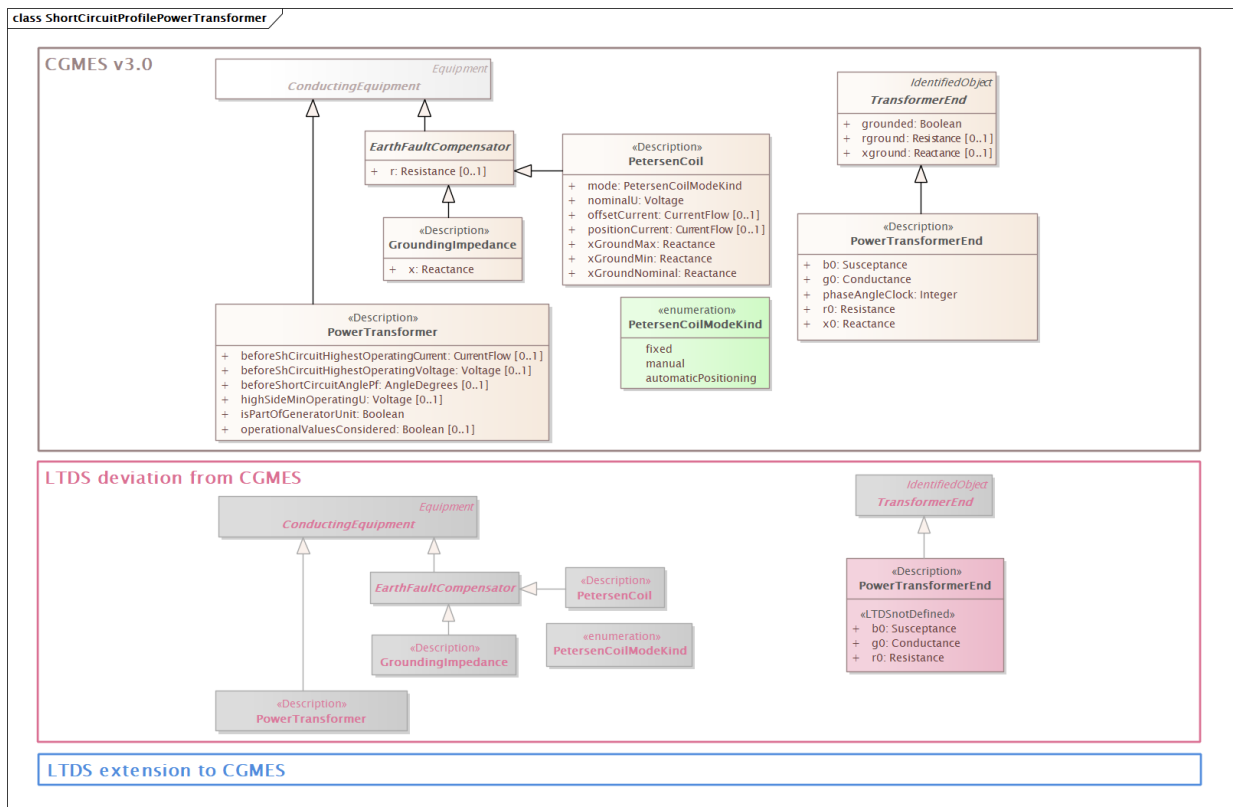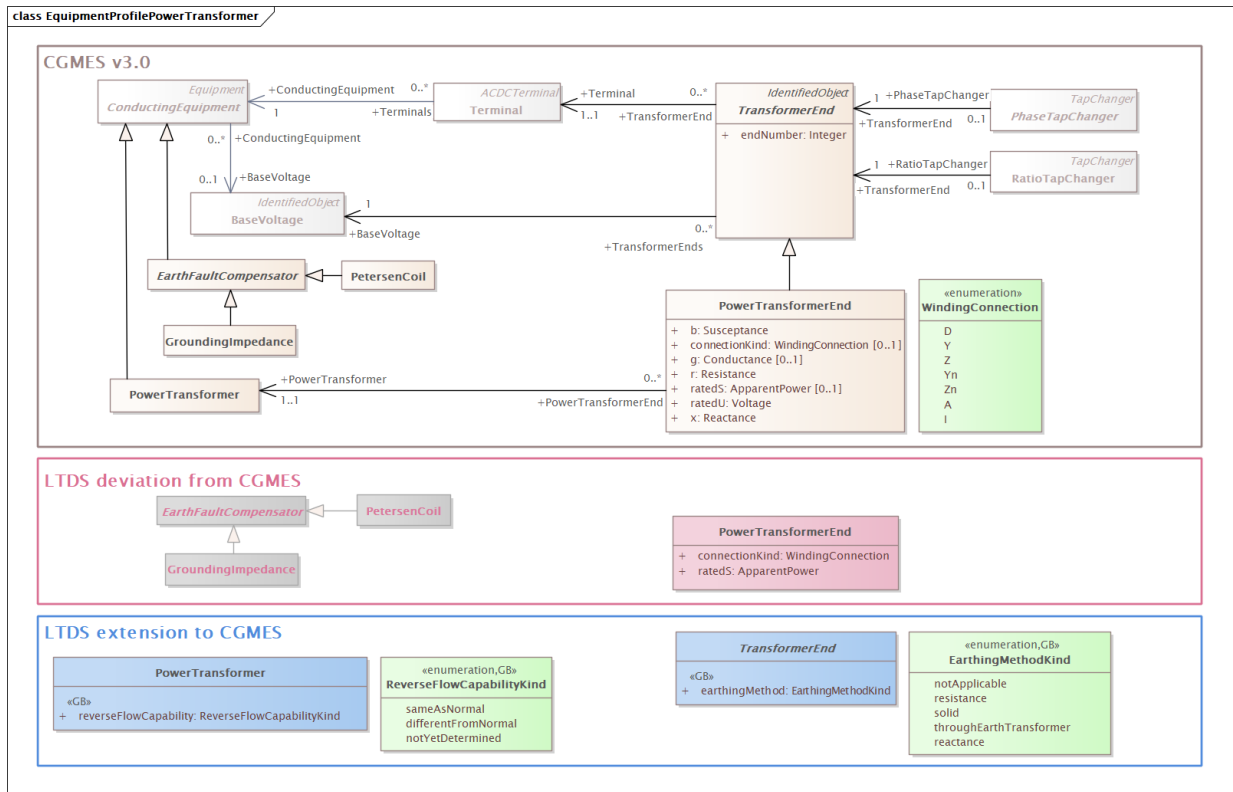


This diagram shows the transformer tap changer-related portion of the Equipment profile:

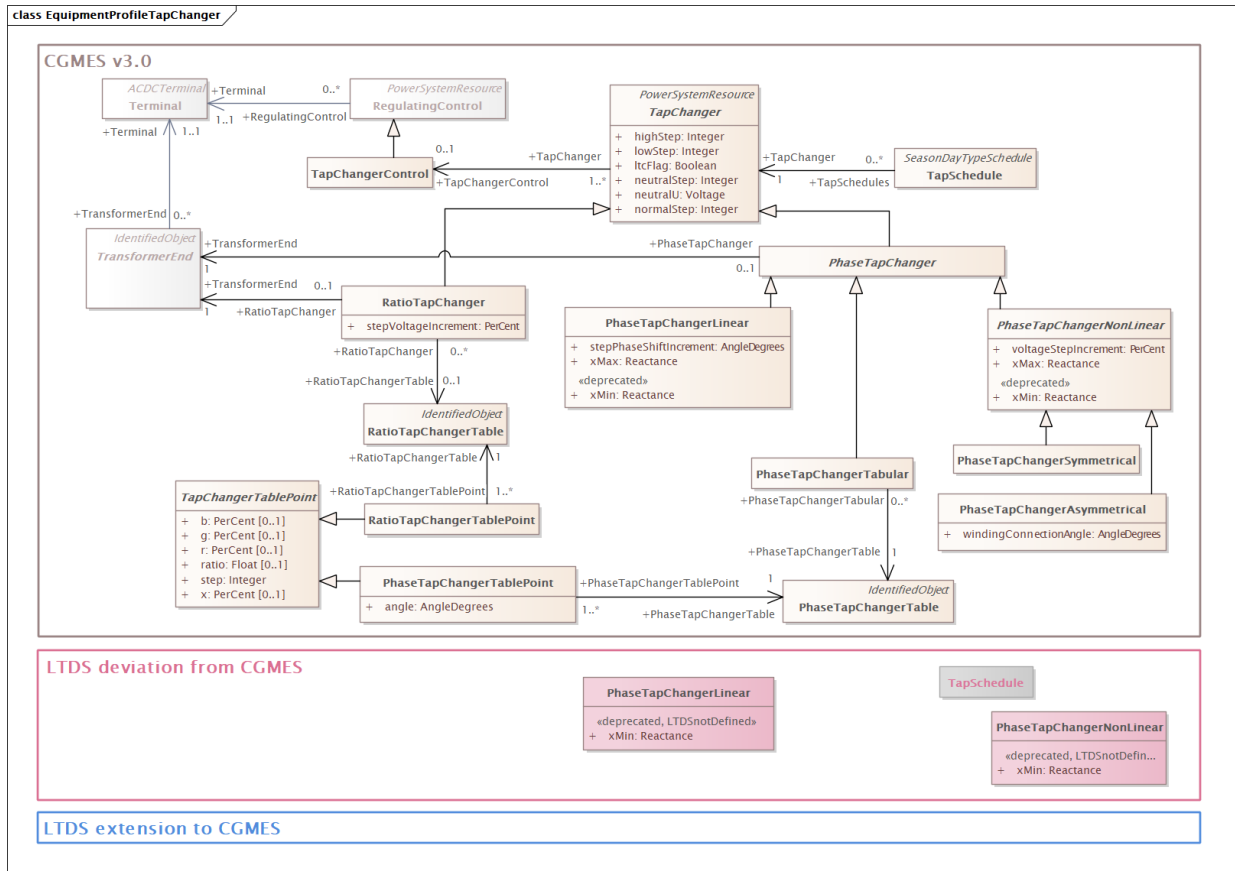


This diagram shows the load-related portion of the Equipment profile:

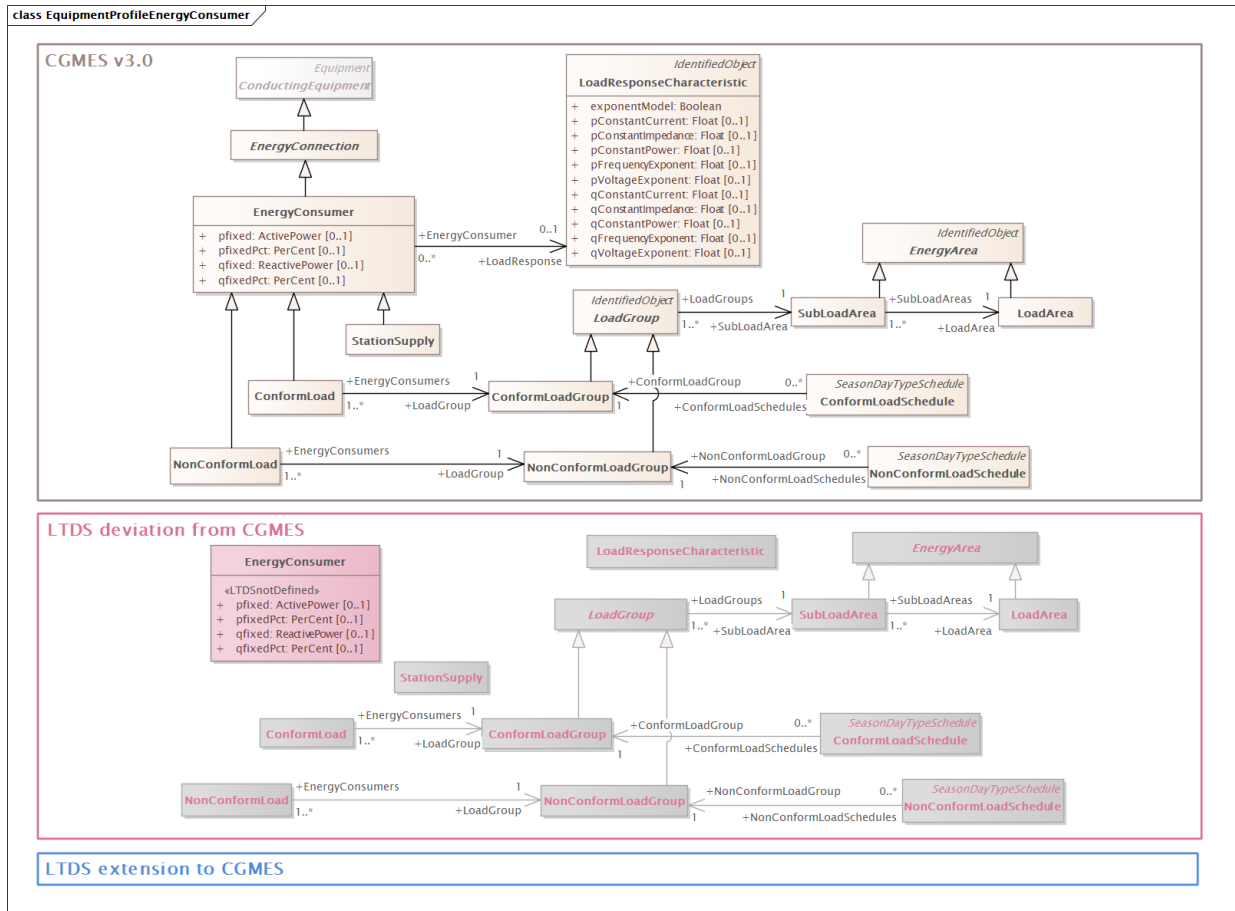


These diagrams show the generation-related portion of the Equipment profile:

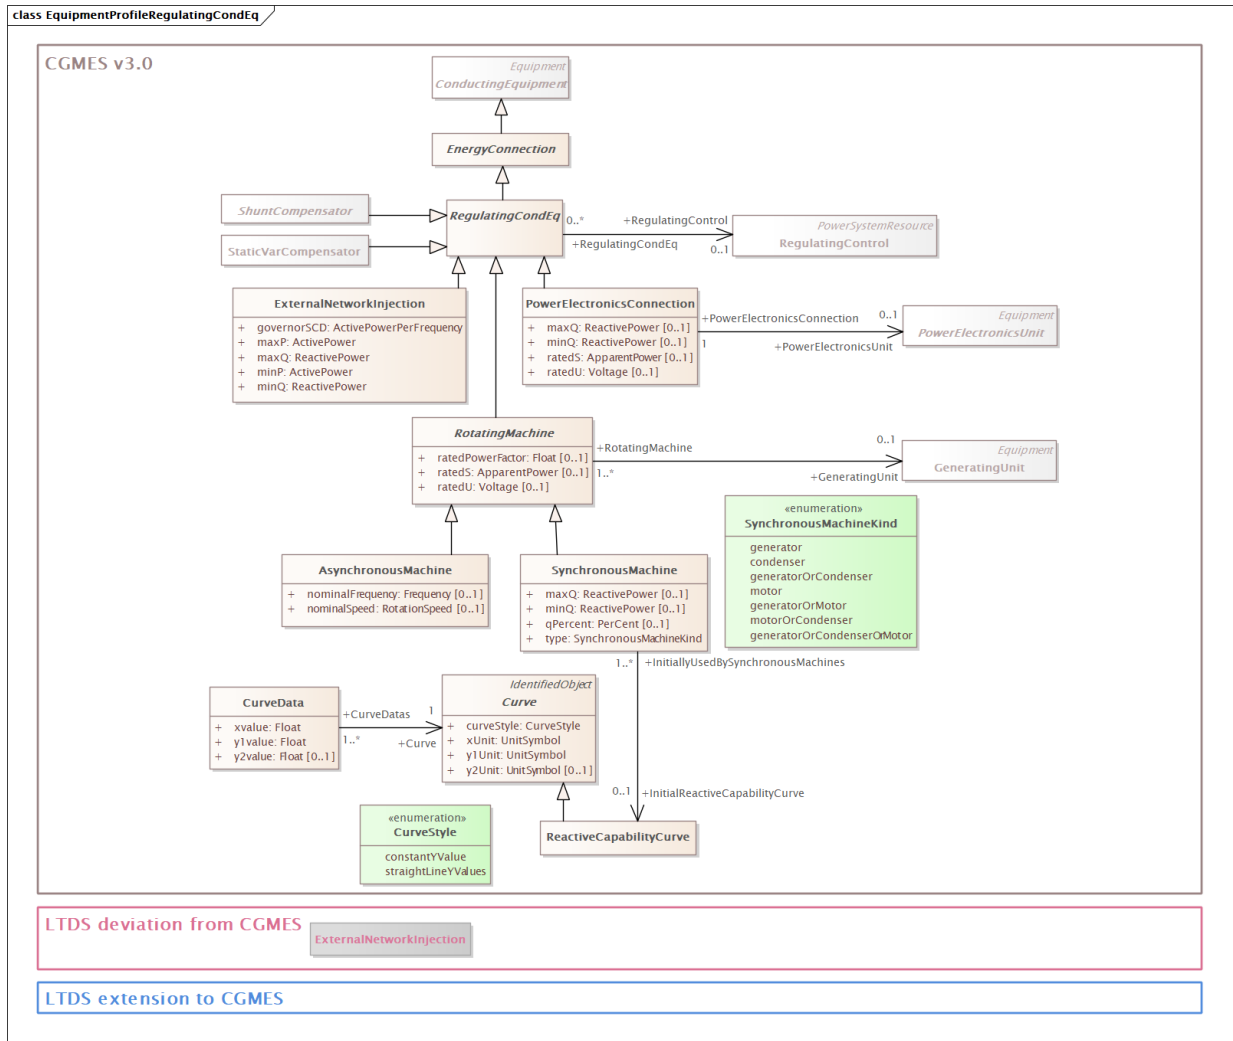





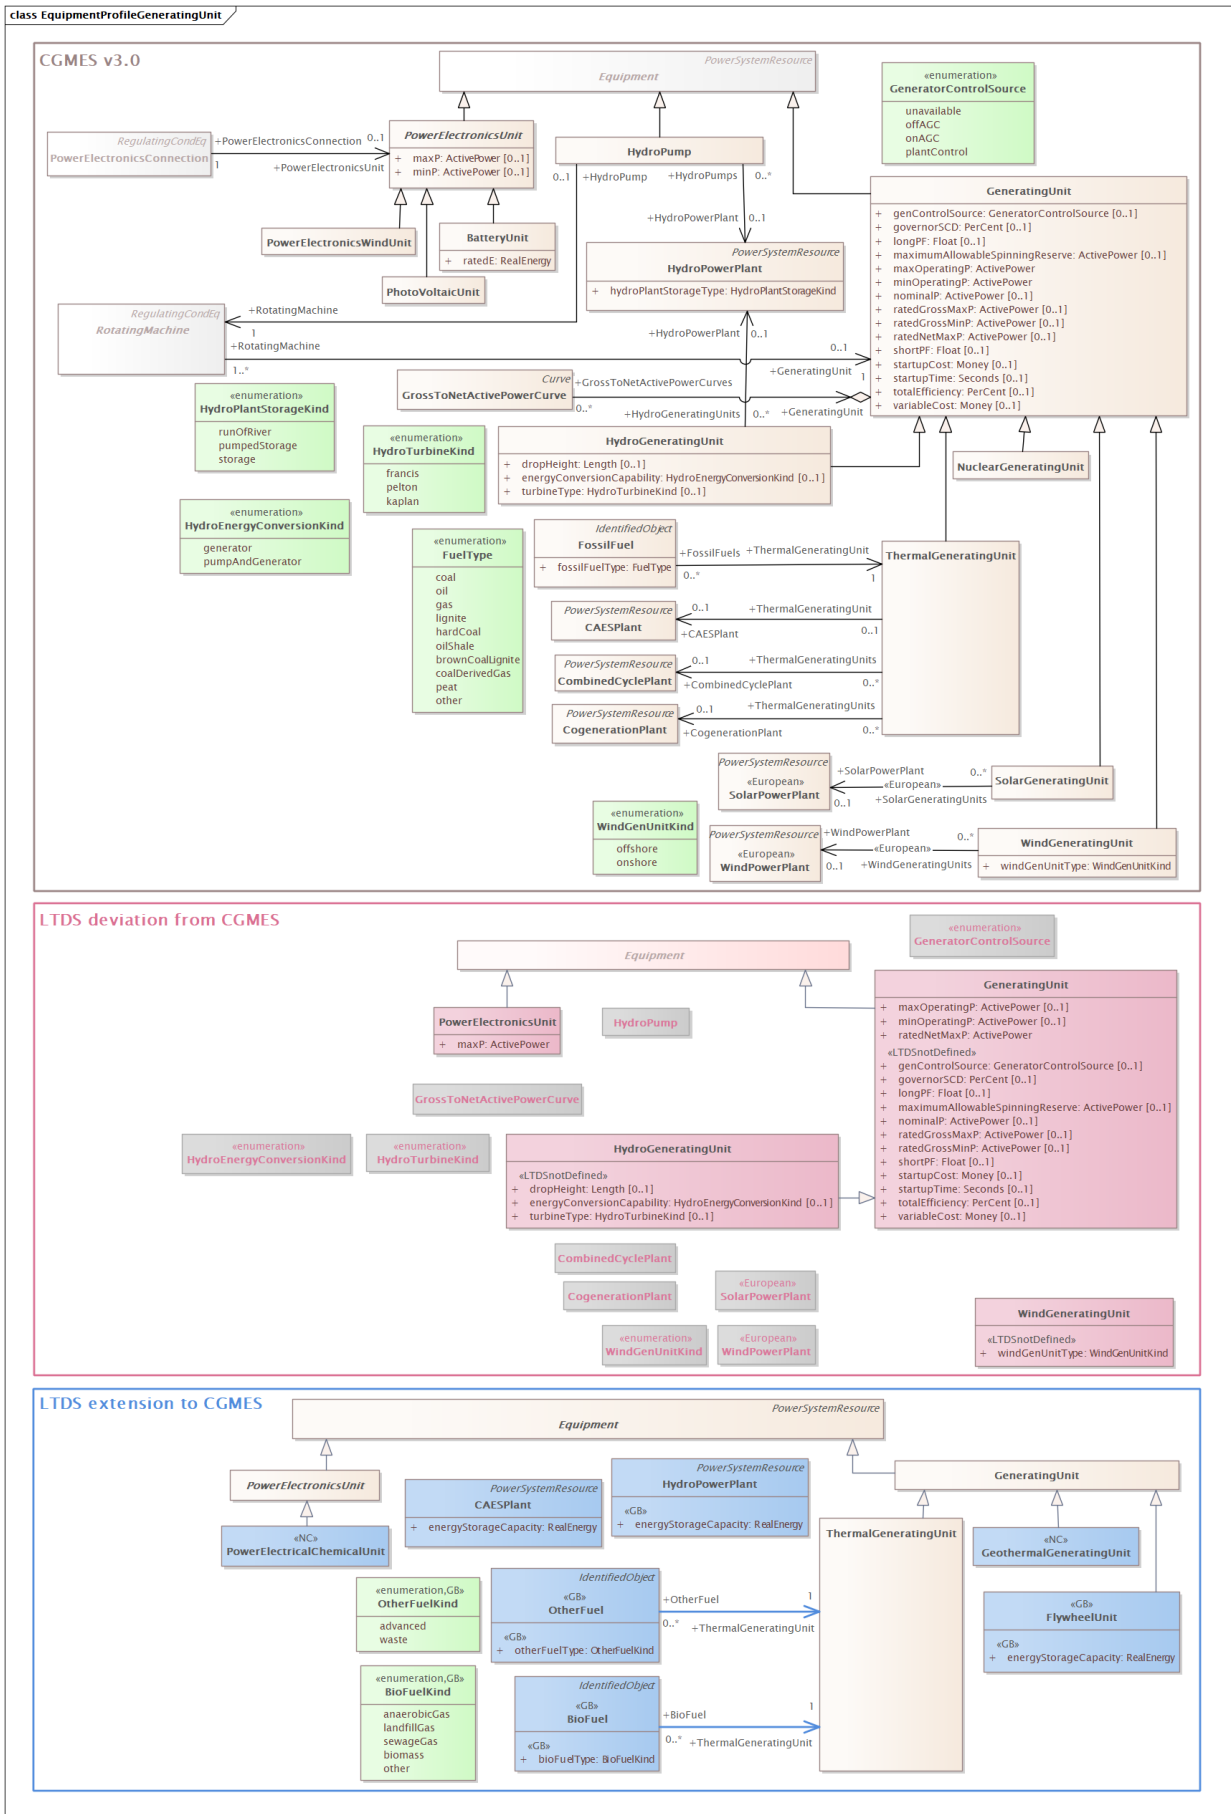


This diagram shows the generation-related portion of the Short Circuit profile:

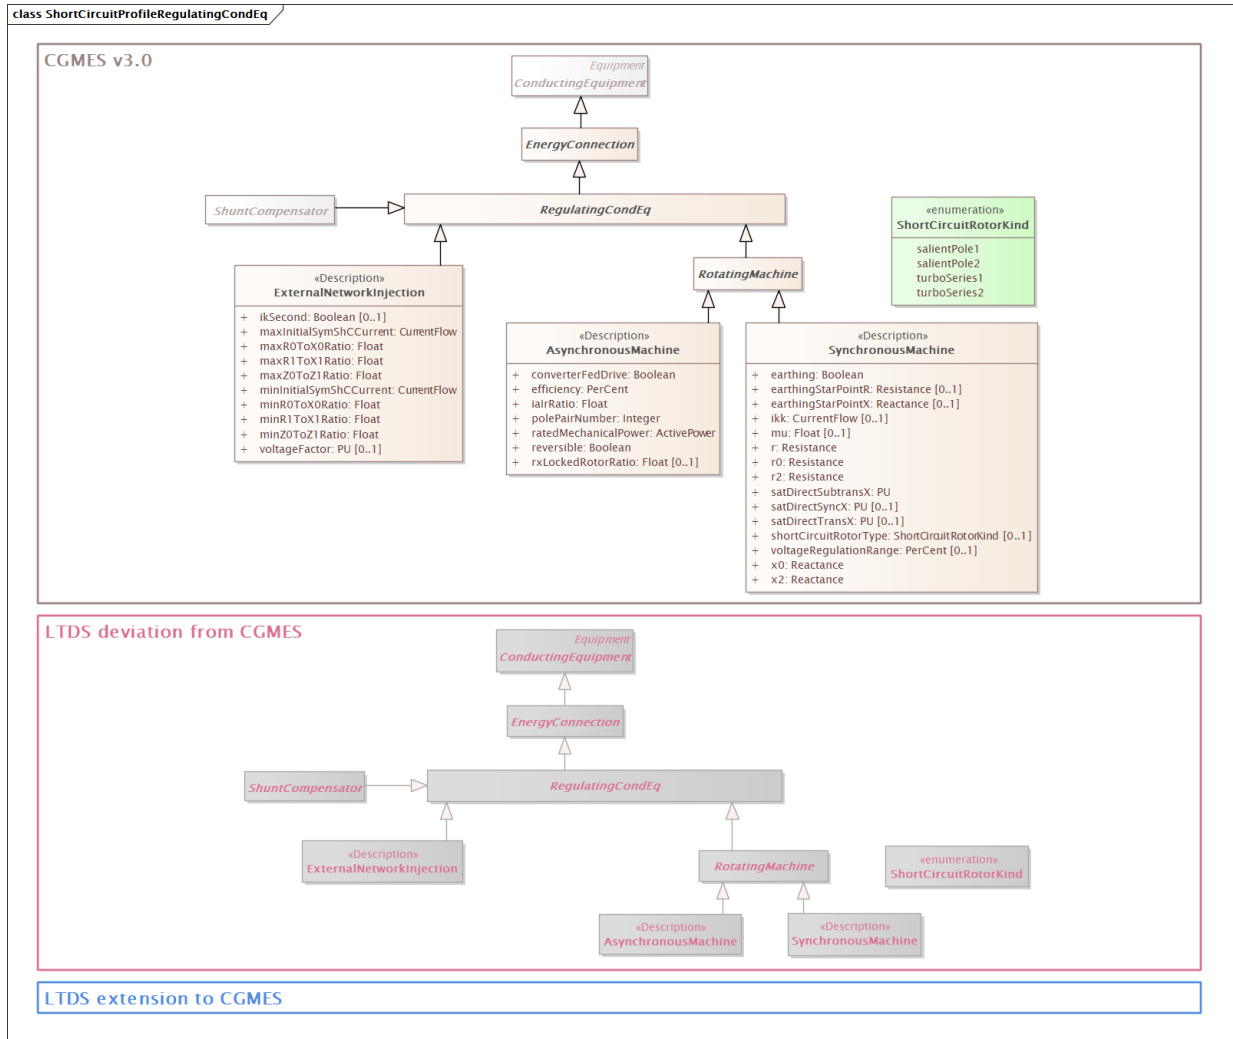


These diagrams show the shunt and static VAR compensator-related portions of the Equipment and Short Circuit profiles:

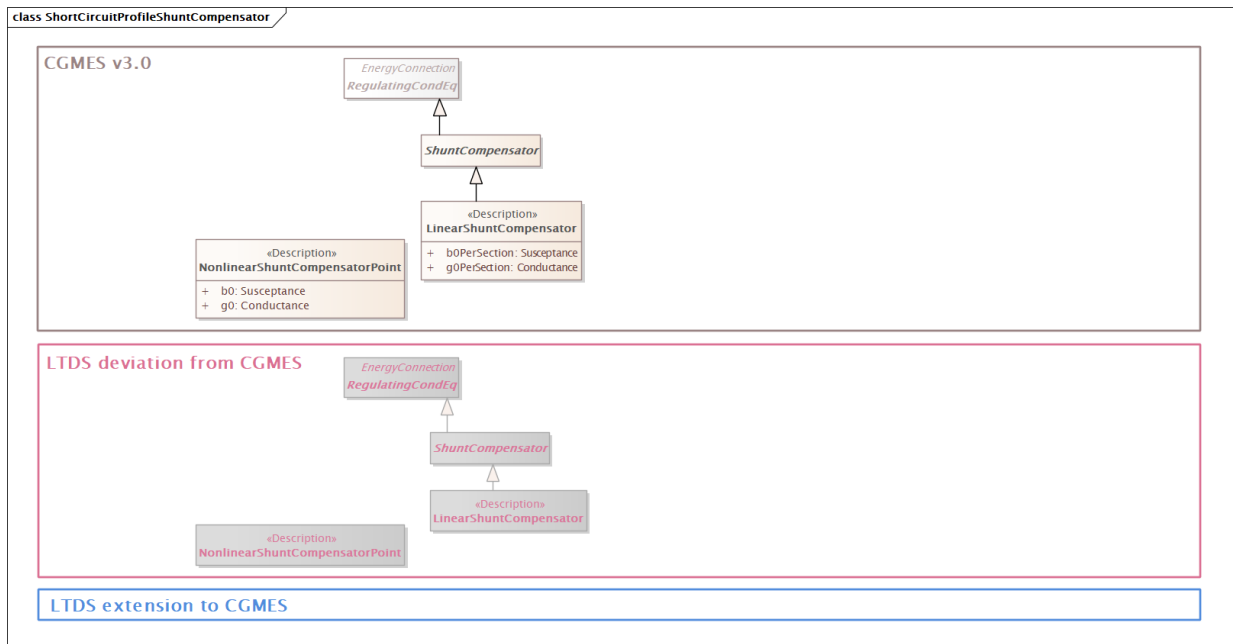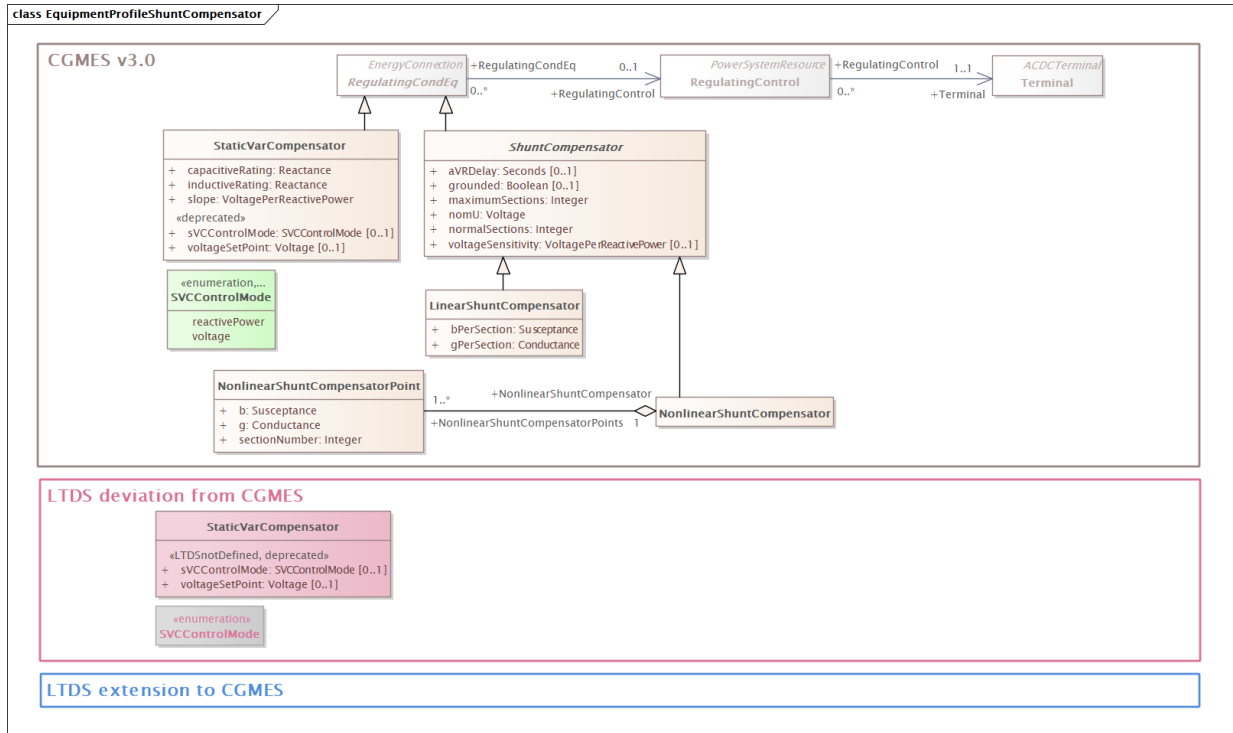


This diagram shows the limit-related portion of the Equipment profile:

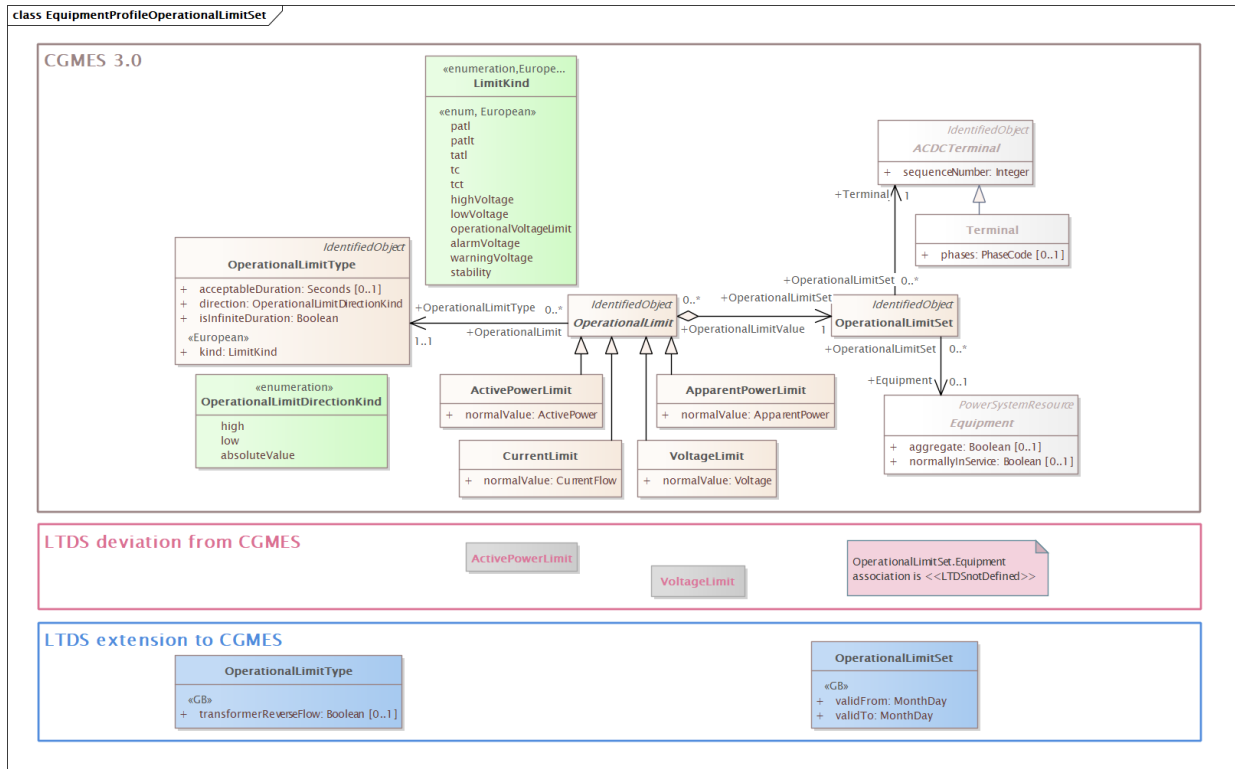

This diagram shows the portion of the Equipment profile which supports the containment of grid equipment in facilities and regions:

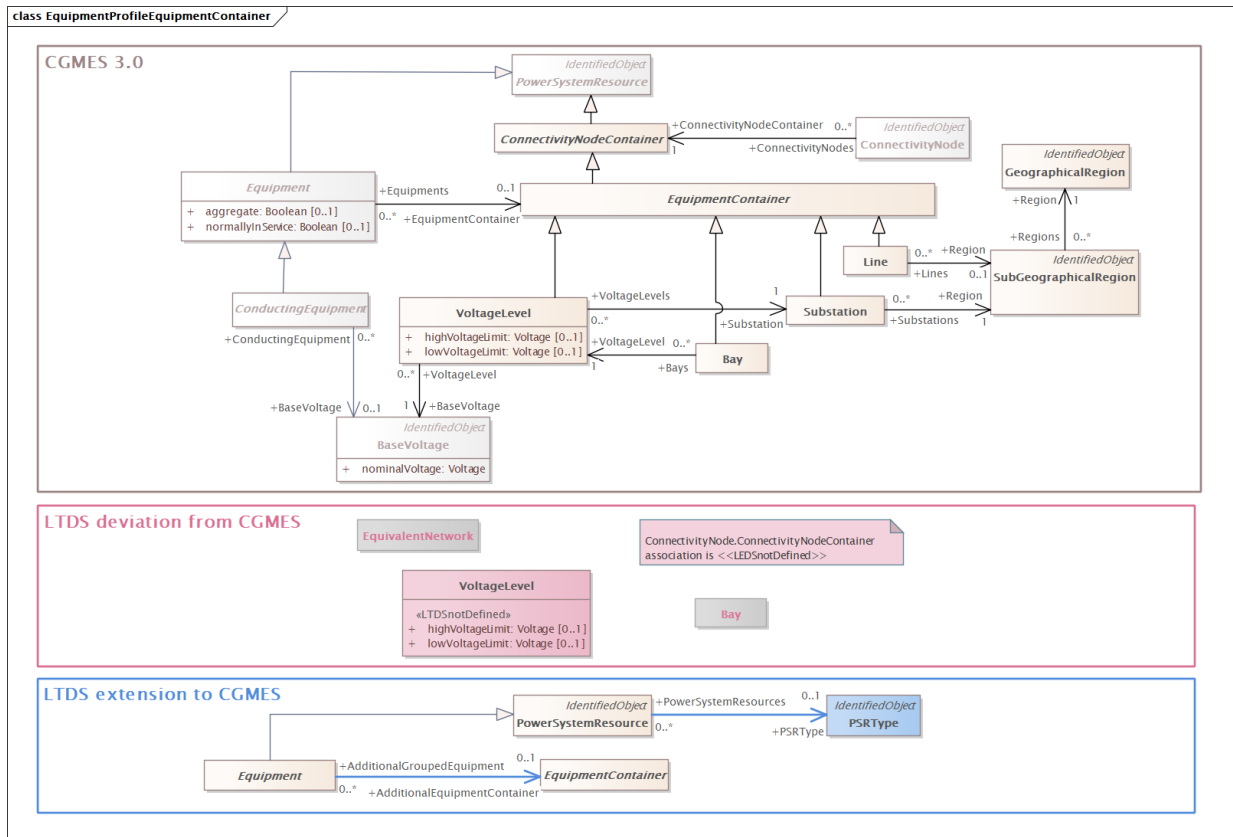


This diagram shows the Geographical Location profile:

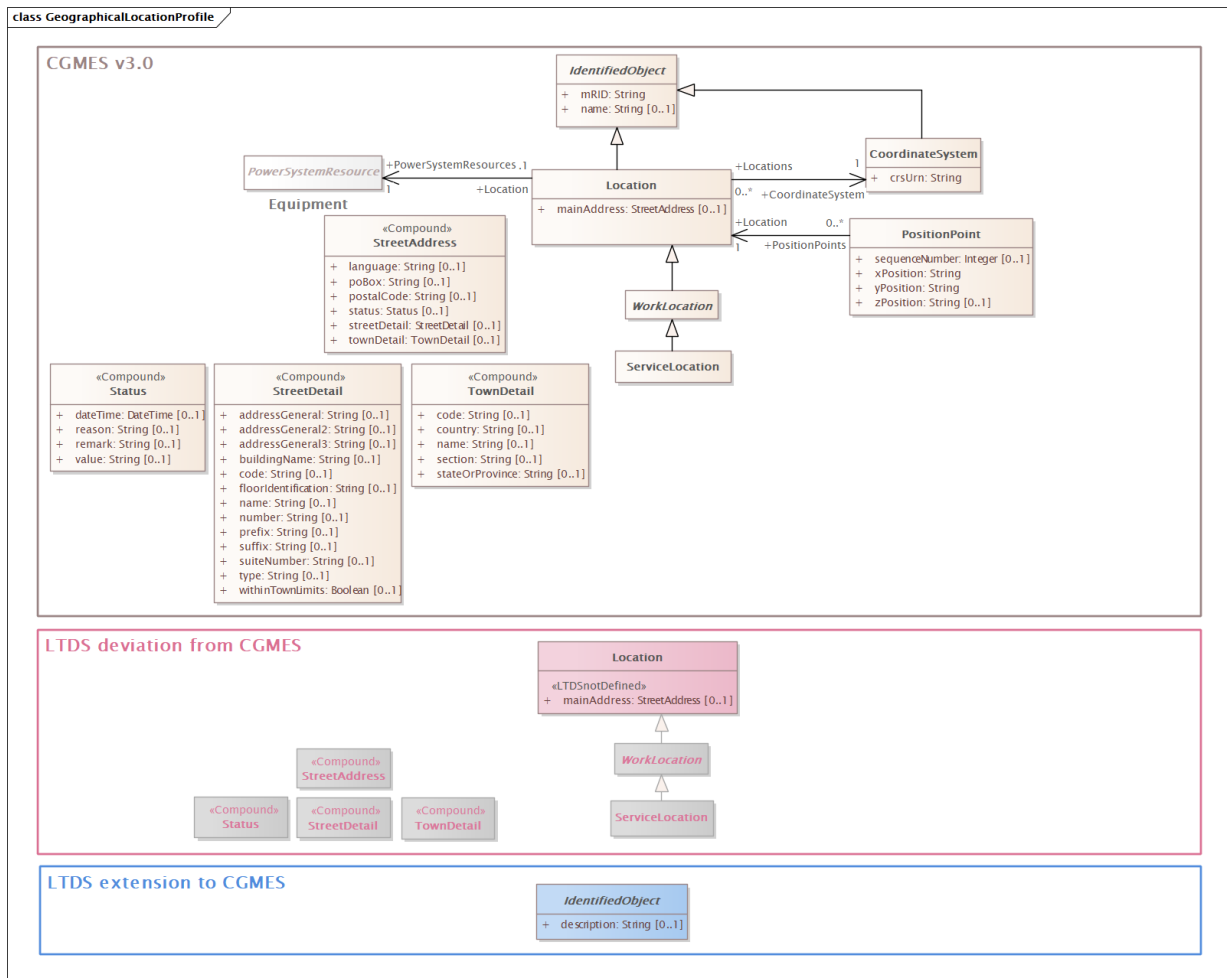


### 1.3.3.2 Situation profile group

Taken as a whole, the 8 diagrams of this section describe the LTDS Steady State Hypothesis profile. Note that an anomaly in CIM and CGMES profiling has left multiple Equipment subtype classes out of the Steady State Hypothesis UML profile. All Equipment subtype classes should be present in the Steady State Hypothesis profile and should inherit the required `cim:Equipment.inService` attribute. Notes have been put on diagrams to identify these classes.


This diagram shows the building block-related portion of the Steady State Hypothesis profile:

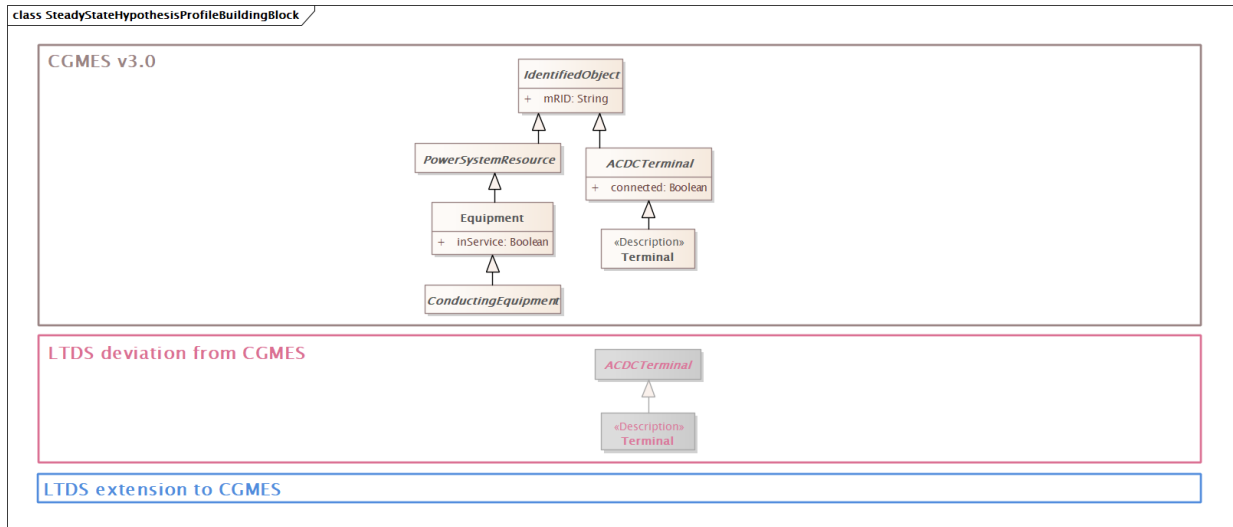


This diagram shows the portion of the Steady State Hypothesis profile which relates to conducting equipment, control and external modelling:

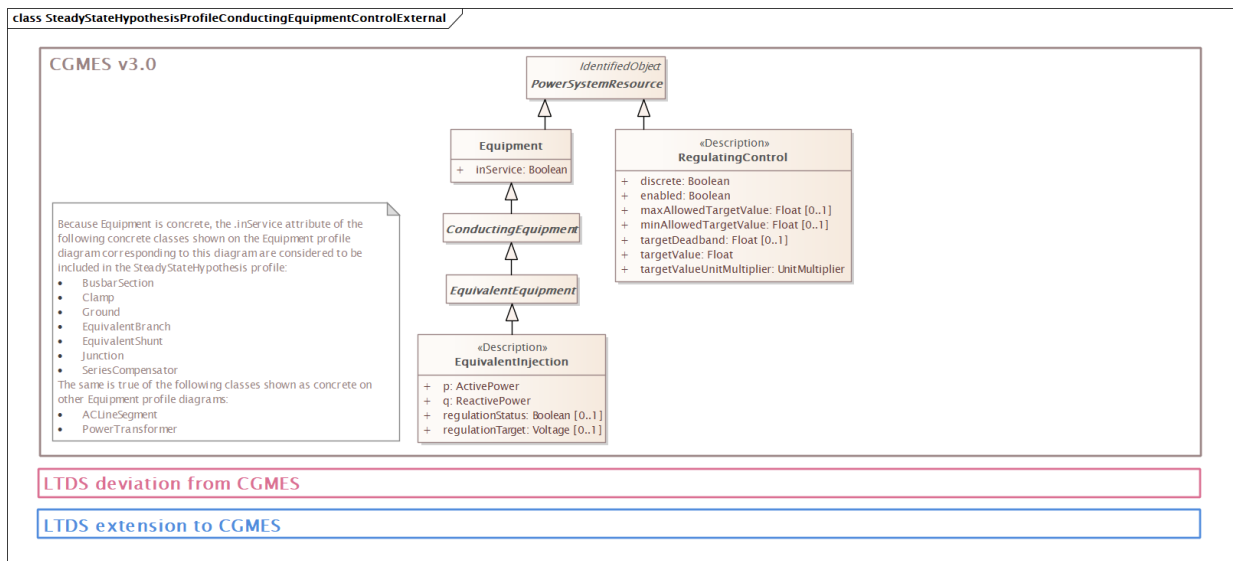

This diagram shows the switching device-related portion of the Steady State Hypothesis profile:

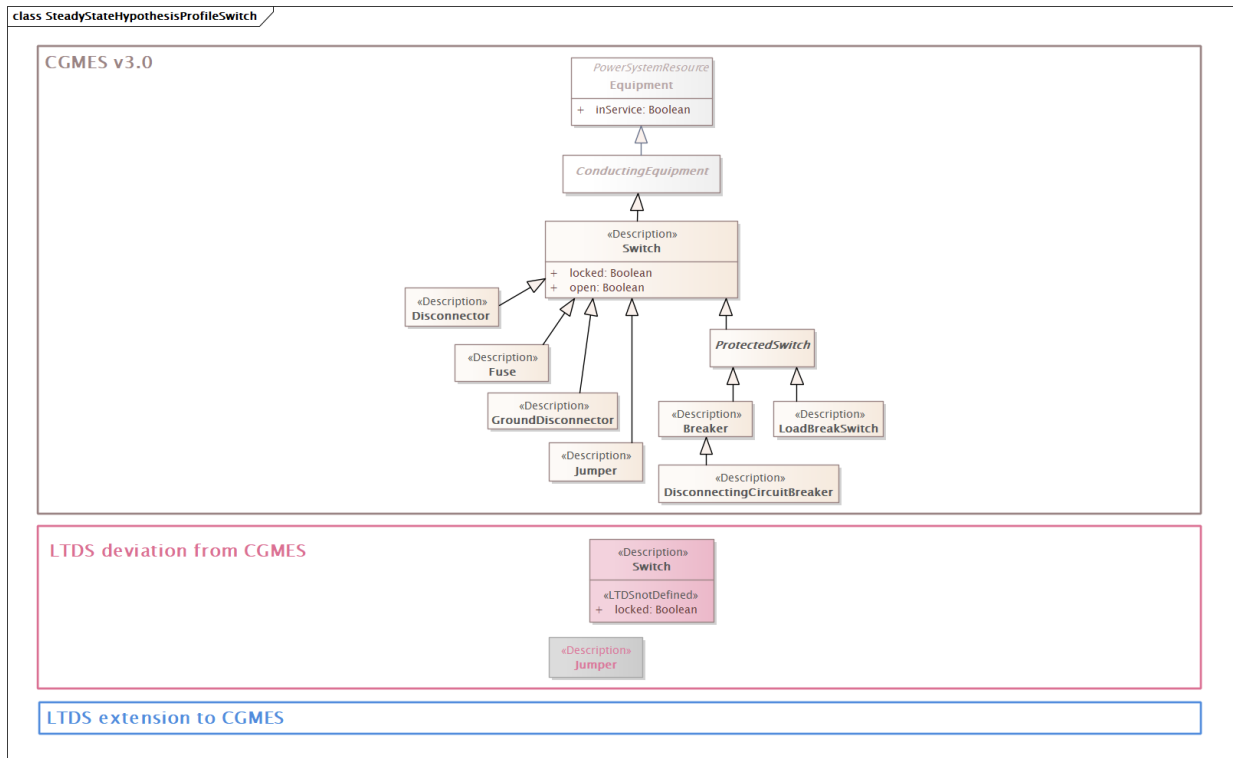


This diagram shows the transformer tap changer-related portion of the Steady State Hypothesis profile:

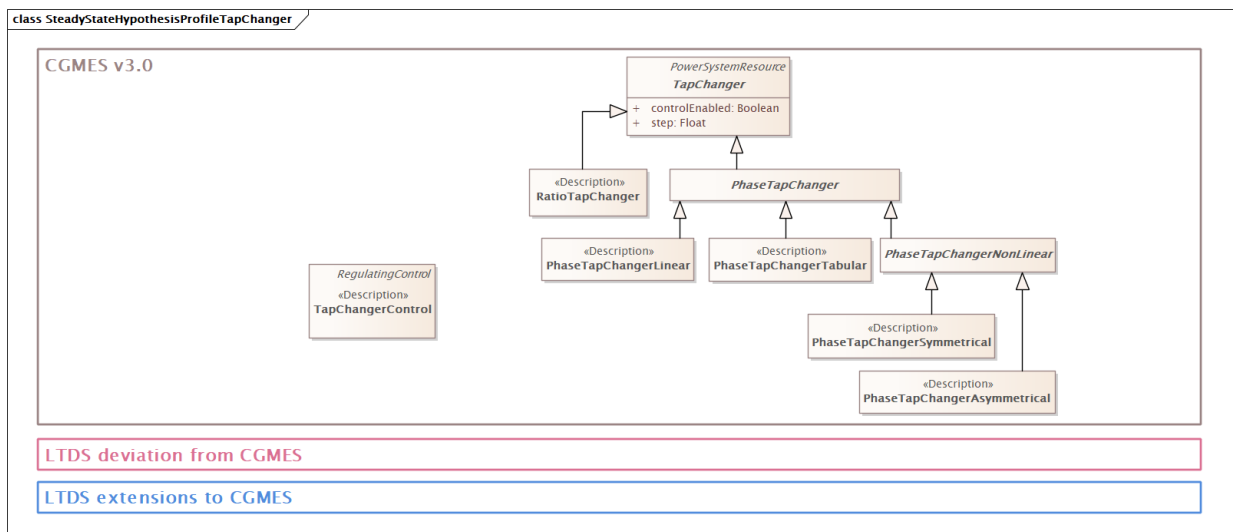





This diagram shows the load-related portion of the Steady State Hypothesis profile:

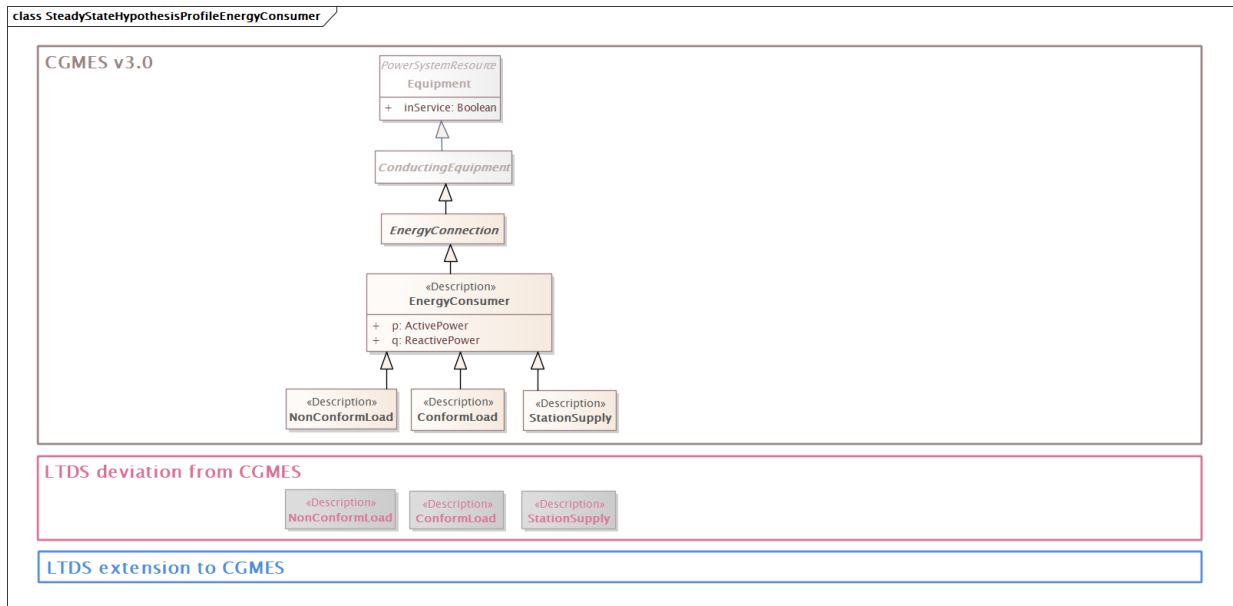


These diagrams show the generation-related portion of the Steady State Hypothesis profile:

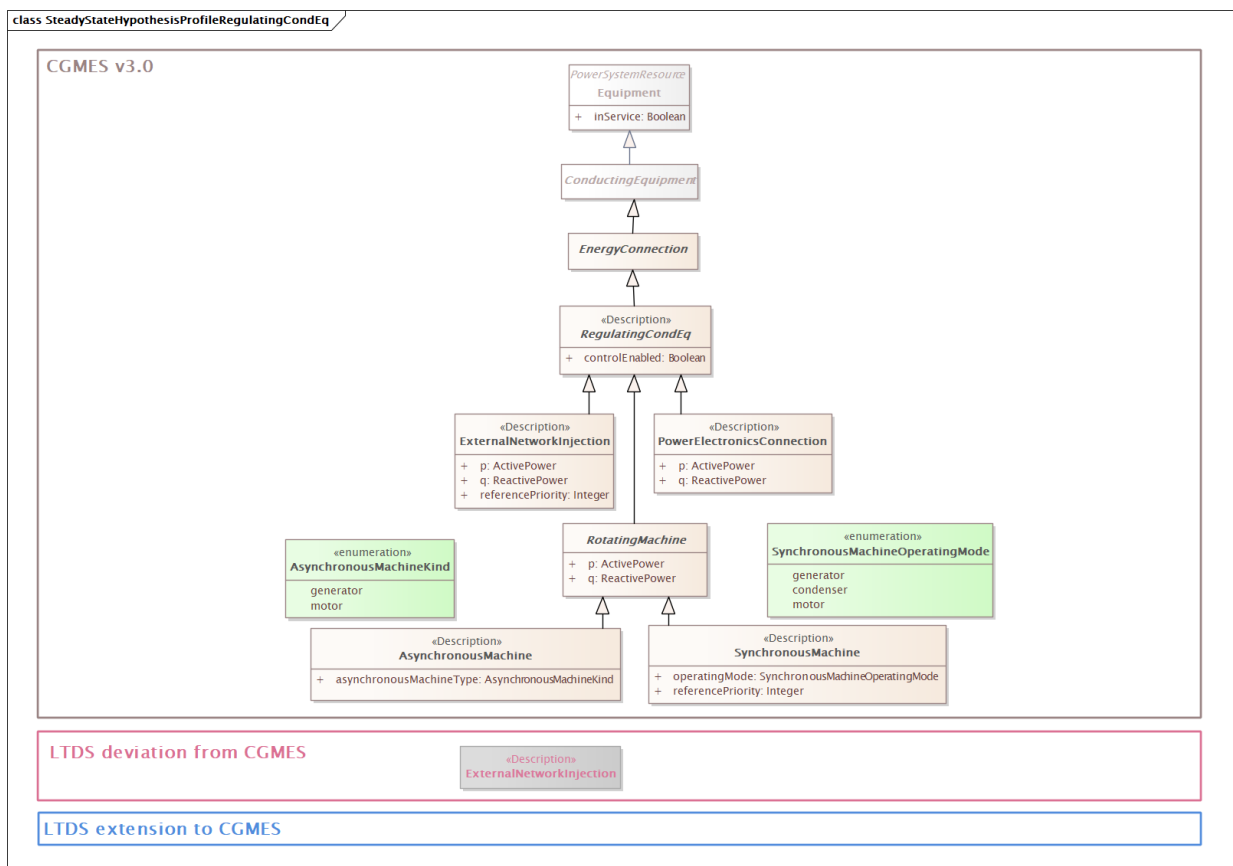


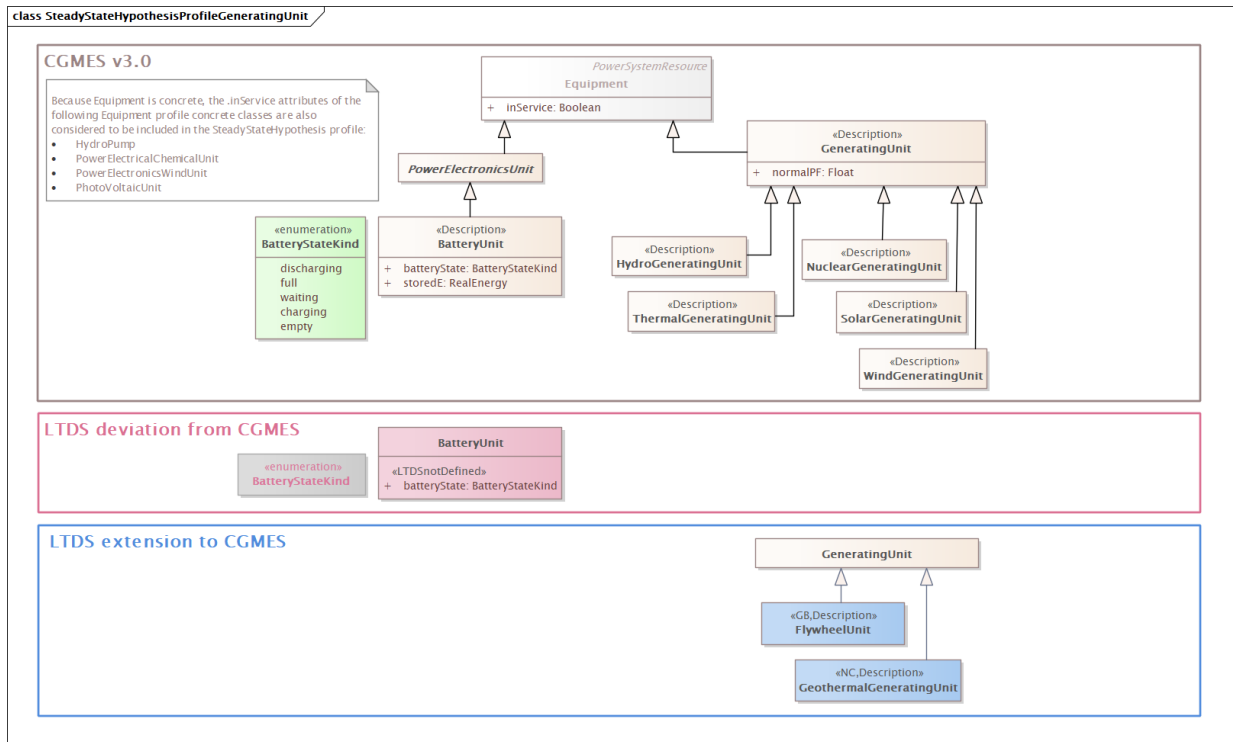

This diagram shows the shunt and static VAR compensator-related portions of the Steady State Hypothesis profile:

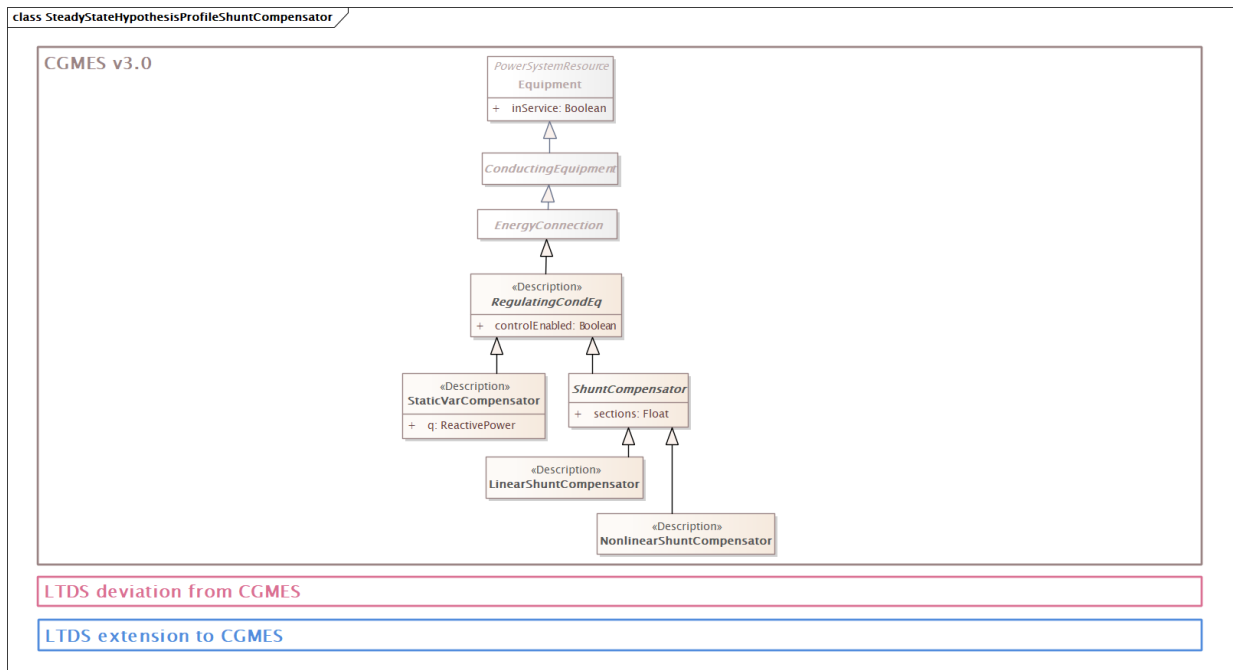


This diagram shows the limit-related portion of the Steady State Hypothesis profile:

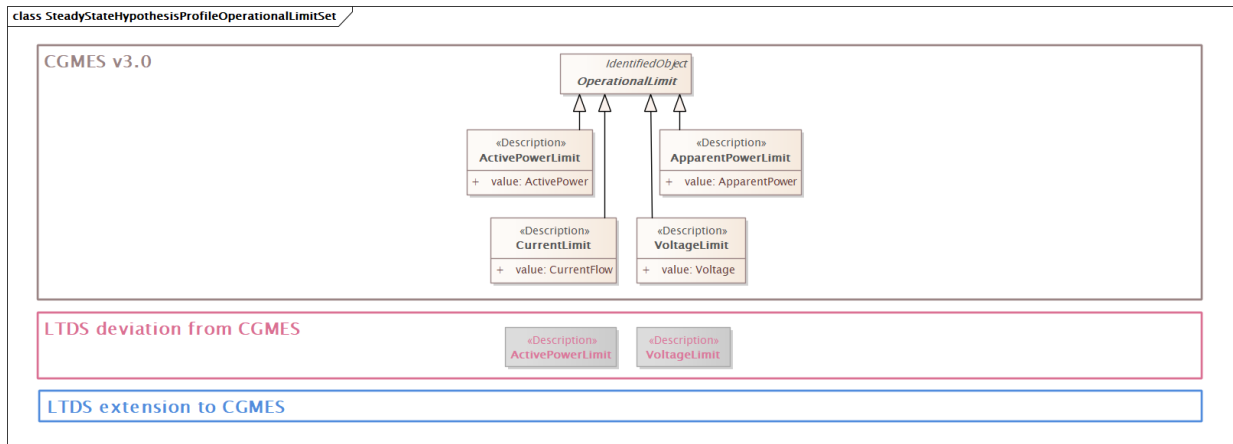


### 1.3.3.3 Solution profile group

The two diagrams of this section describe the LTDS Topology profile and the LTDS StateVariables profile.

This diagram shows the Topology profile:

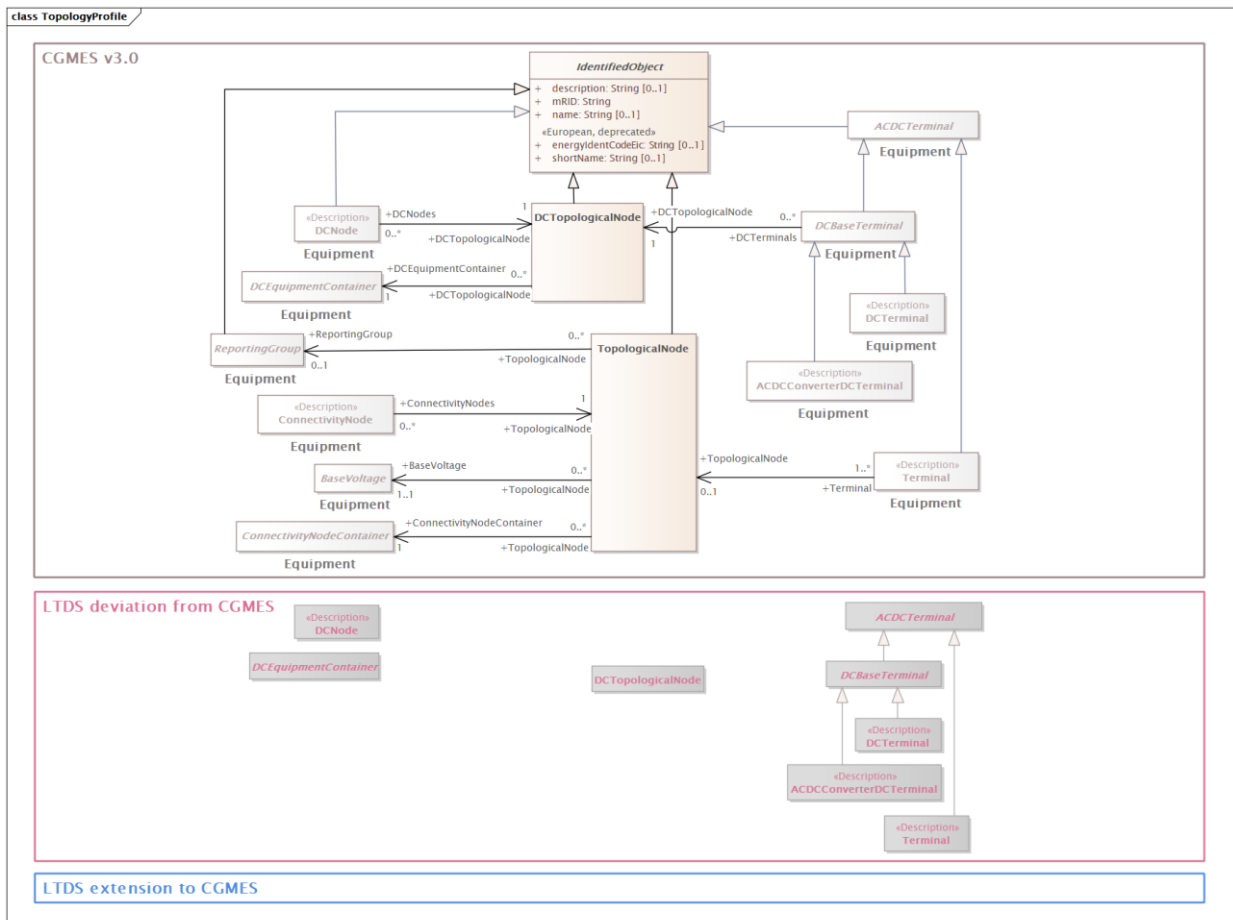


This diagram shows the State Variables profile:

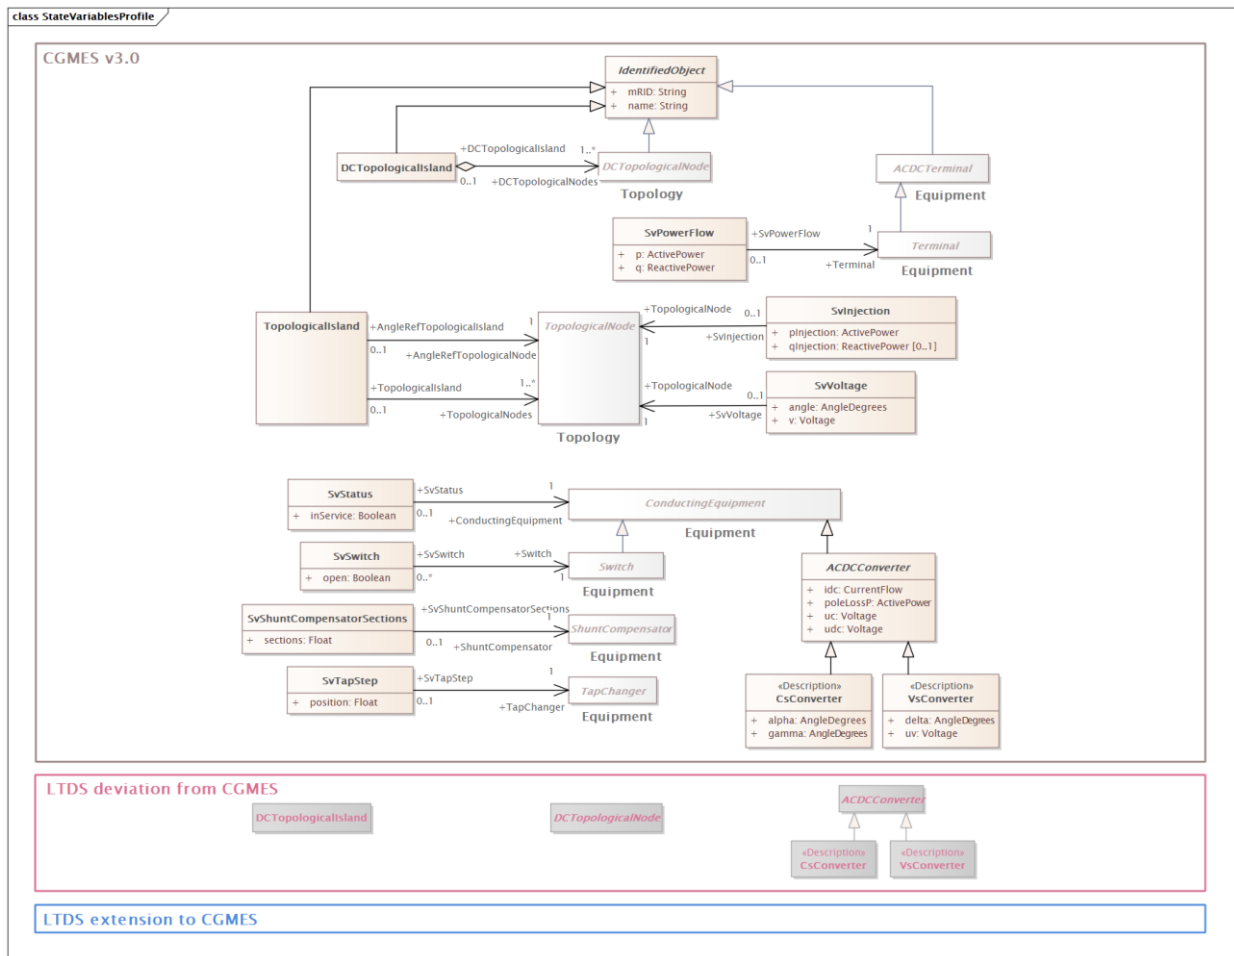


### 1.3.3.4 System Capacity profile

This diagram describes the LTDS System Capacity profile. It is an LTDS extension profile.

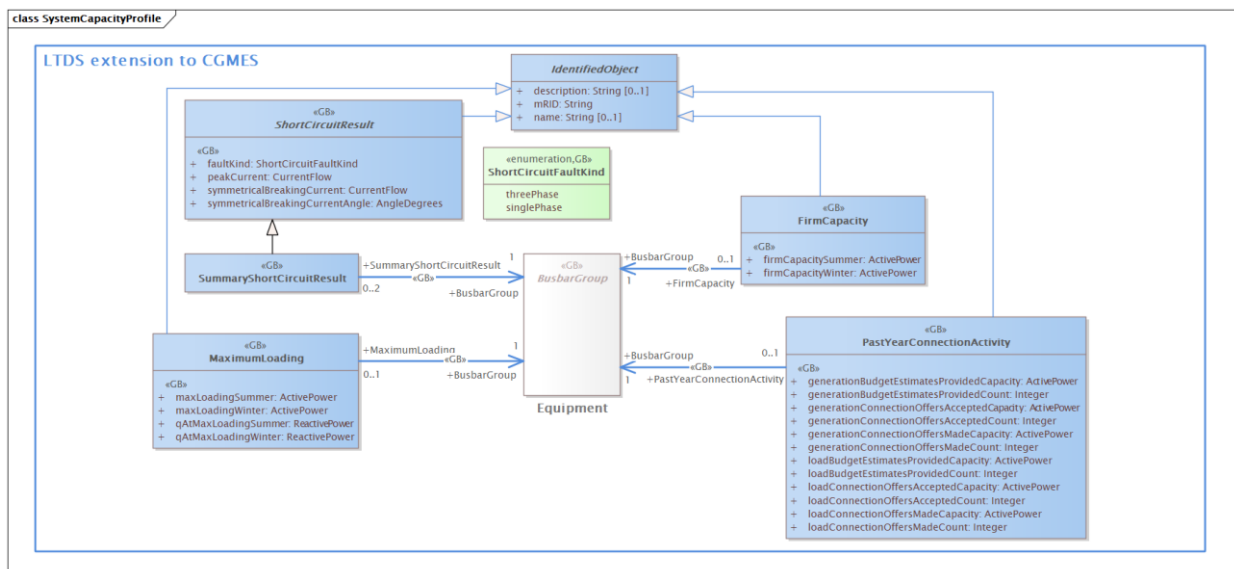


### 1.3.3.5 Diagram Layout profile

This diagram describes the LTDS Diagram Layout profile.

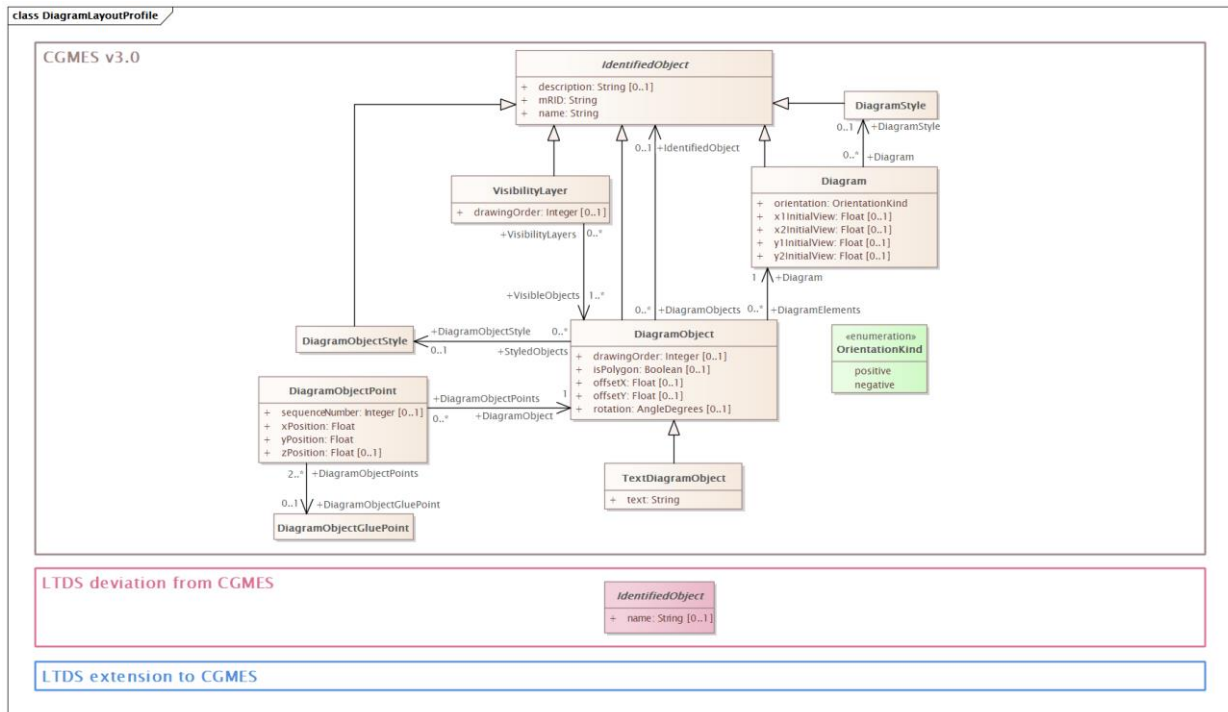


Appendix 1 – LTDS Information Model and Profiles contains the .eap file in which all three of the layered profiles (as well as the LTDS information model) are described. The lower two packages in the Appendix\_1\_CIM100v111\_UK\_LTDS\_AllProfiles\_3July2023pab2.eap file contain profile definitions:


- The CGMES v3.0 profiles are in the TC57CIMProfiles package
- The two LTDS “difference” profiles are in the LTDSProfiles package.

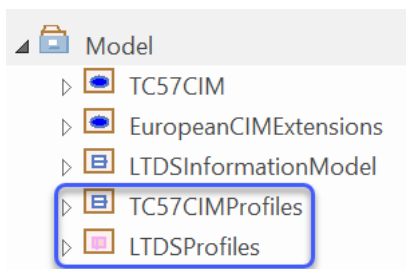

The underlined sub-packages of the IEC61970Profiles package contain the UML profile definitions used by CGMES v3.0:

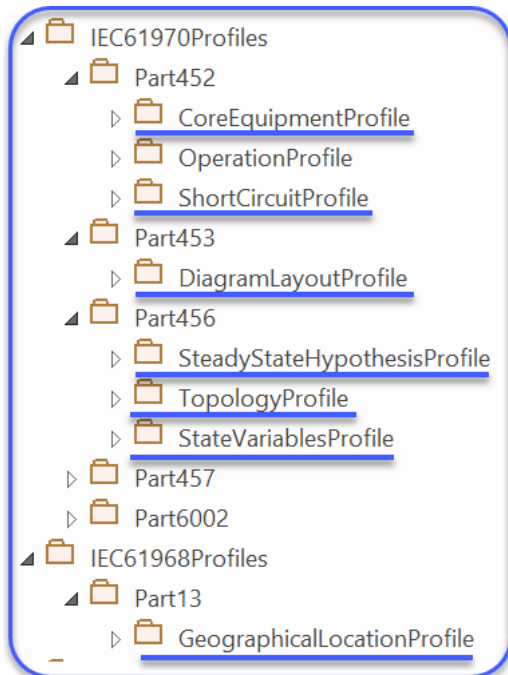

The LTDS “difference” profiles are defined in the RequiredProfiles sub-package of the LTDSProfiles package:

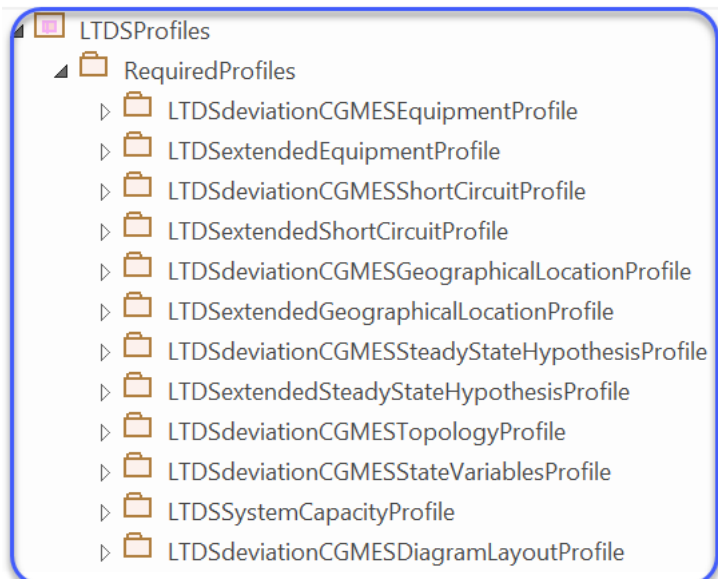

### 1.3.4 Constraints

CIM RDFS profiles are critical to the definition of data to be exchanged, but their capability to support validity checking is fairly limited.


RDFS profiles are good for defining a scope of data that has understood, shared meaning and providing the structure to which that data must conform. An RDFS profile can:

- Specify the classes, attributes and associations for which there is a defined meaning
- Specify allowed attribute values for certain datatypes (booleans, enumerations)
- Specify that an attribute must be populated (i.e., it is required) or may be populated (i.e., it is optional)
- Specify that an association must exist
- Specify an upper bound on the number of instances of an association that may exist
- Require that an object exists, but only by means of a required association.

There are many other types of requirements that RDFS profiles cannot express. They include:

- The allowed value (or value range) for an attribute
- The conditions under which an optional attribute must be populated
- The conditions under which an optional association must be present
- The number of associations (within the allowed multiplicity range) that must or may be present and under what conditions
- The number of objects of a given class must be present in a data exchange

The ability to specify these more involved data requirements is an essential pre-requisite to validating exchanged grid model data. Constraint languages – like Shapes Constraint Language (SHACL) or Object Constraint Language (OCL) – are the vehicle by which these more specific, more complex data requirements are described. Typically, constraints are defined in conjunction with every profile, both standard profiles and local implementation profiles. Constraints are also described for combinations of profiles, which are used in validating models containing data conforming to multiple profiles. The set of constraints to be used in validating LTDS grid model data exchanges currently includes a selected subset of CGMES v3.0 constraints, and ultimately will include both those and a set of LTDS-specific constraints:

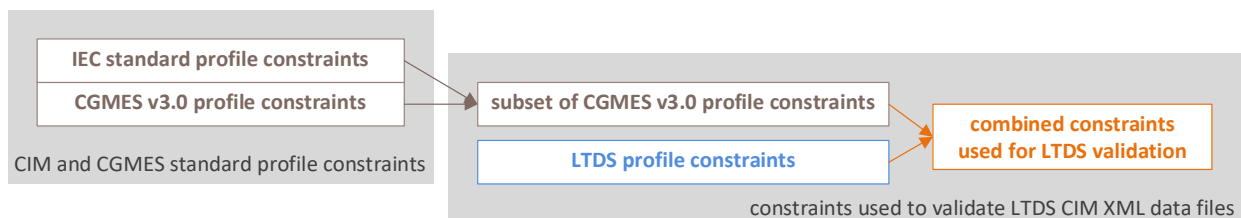

A note on CGMES current practice for SHACL constraints: To allow all cardinality and value validation to be done using one rule source, CGMES v3.0 includes SHACL constraints which duplicate the RDFS definitions regarding attribute and association cardinality and attribute

datatype. These constraints are generated from the RDFS profile definitions. This practice will be followed when the LTDS constraints are defined.

A document containing a table of the subset of CGMES v3.0 profile constraints used by LTDS is provided in [Appendix 9 – LTDS Constraint Descriptions](#). Machine-readable versions of the constraints can be found in [Appendix 7 – LTDS Constraints in SHACL](#).

### 1.3.5 Creating CIM XML for LTDS and CGMES v3.0

It is recognised that tools with CGMES v3.0 interfaces might want to read a file produced primarily for LTDS purposes. To enable this, a special type of CIM XML file, conforming to both CGMES v3.0 and LTDS profiles and containing both CGMES v3.0 and LTDS data, needs to be created by the producing tool.

In CIM-based data exchanges, the interface of a consuming application is designed to receive and process data conforming to a specific profiles or set of profiles. Because the CIM XML file is expressed in RDF/XML, a consuming application can simply ignore data it doesn't understand - data not defined by the profiles it is designed to consume - without affecting the readability of the data which it does expect. This feature of RDF/XML (and other graph-based data exchange syntaxes) means that a CIM XML file conforming to both a CGMES v3.0 profile and an LTDS profile can be read by a consuming application designed to receive data that conforms to one of the profiles, to the other of the profiles, or to both profiles.

Creation of the special type of CIM XML file depends on conditions being satisfied by both the producing tool and the grid modeller:

- The modelling tool producing the CIM XML file needs to:
  - Internally support all required LTDS and CGMES v3.0 data
  - Be capable of exporting a file:
    - Whose data conforms to the union of CGMES v3.0 profile requirements and final merged LTDS profile requirements. (The union is essentially the most stringent expressed by either profile.)
    - That identifies both profiles with a `md:Model.profile` record in its header.
- The grid modeller needs to ensure that all data required by either LTDS or CGMES v3.0 is populated. (See the *Modelling aligned with CGMES v3.0 constraints* section of the [LTDS Grid Modelling Guidelines](#).)



## 1.4 LTDS Serialisation

In CIM-based data exchanges, serialisation is the process of readying data for exchange. It includes:

- Creating context information for the data being shared and
- Expressing data in a particular syntax (format)

The IEC 61970-552 standard<sup>23</sup> specifies serialisation conventions – for both context and syntax – to be used by CIM-based grid model data exchanges. The syntax called for by IEC 61970-552 is RDF/XML. Grid model data context is defined by IEC 61970-552 in the form of a header whose structure is described in UML.

The IEC 61970-552 standard is currently under revision, with the next version promising major improvement in the definition of context. The planned improvements will support accurate, detailed modelling of grid model context in machine-readable form. They will also implement the metadata features recommended by Ofgem<sup>24</sup> and others as data best practice.

This proposed version of the LTDS Data Exchange Specifications calls for serialisation according to the existing IEC 61970-552 standard. If the revisions to IEC 61970-552 are complete by the end of consultation, the intent is to revise this document to leverage the new approach to context definition.


LTDS grid model data exchange requires that context be defined sufficient to organise the data exchanges shown below. The header described by IEC 61970-552 is used to supply some of the organisational information. A variety of other mechanisms are used to supply the remainder of the context required to organise LTDS data. They include:

- The grouping of files into .zip files
- .zip file naming conventions
- The presentation of collections of .zip files on websites.

---

<sup>23</sup> [IEC 61970-552:2016 | IEC Webstore](#)

<sup>24</sup> [Consultation on updates to Data Best Practice Guidance and Digitalisation Strategy and Action Plan Guidance | Ofgem](#)

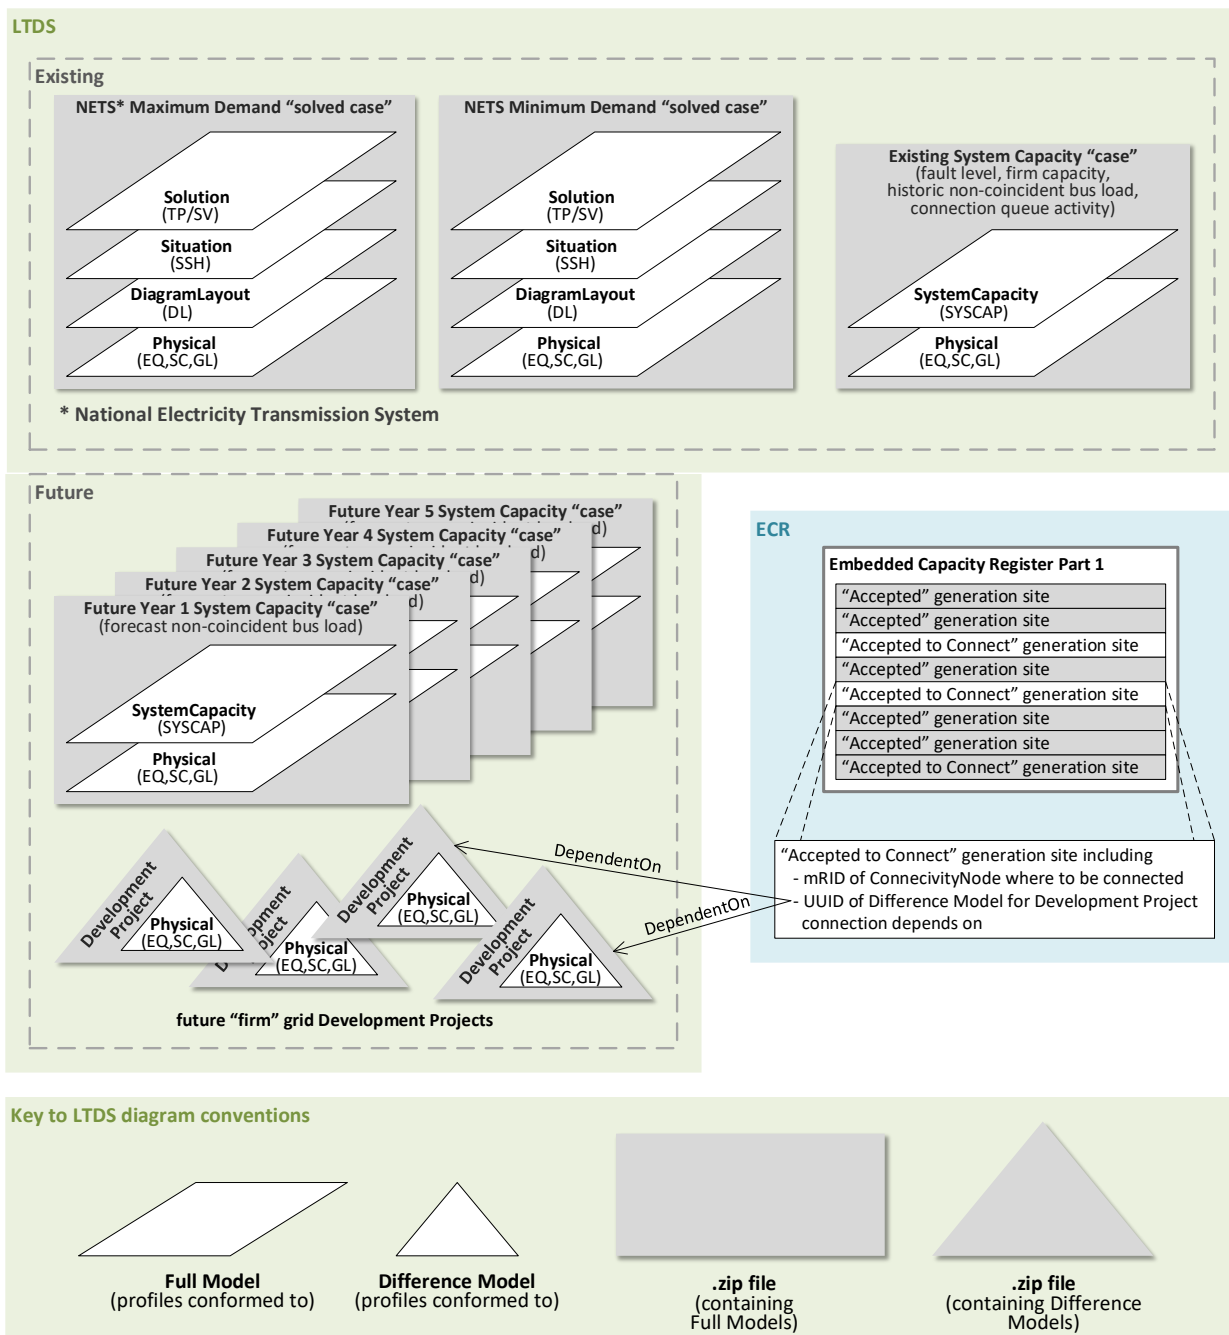

Starting from the top and moving down into lower organisational levels, the context for the provision of LTDS grid model data is defined using the following:

- A web page location allows the LTDS data for a licence area to be identified. (This corresponds to the upper green area on the diagram above.)
- Within the web page, links to .zip files whose names follow specific naming conventions allow the identification of the following sets of grid model information:
  - The National Electricity Transmission System (NETS) Maximum Demand "solved case"

- The NETS Minimum Demand “solved case”
- The Existing System Capacity “case”
- The five Future Year System Capacity “cases”
- Planned grid Development Projects

(The links to .zip files correspond to the solid grey shapes in the diagram above.)

- Within each .zip file, there is one or more CIM XML files. CIM XML files can be either Full Models (which are shown as white parallelograms with black borders in the diagram above) or Difference Models (shown as white triangles with black borders).
- Within each CIM XML file, the IEC 61970-552 header defines additional context information.

The conventions to be followed in describing the context of LTDS grid model data are defined below, with examples provided where appropriate.

#### .zip file naming

For the NETS Maximum Demand “solved case”

LTDS\_<licence area>\_<publication year>-<period>\_GBMaximum\_<date/time of maximum>h\_v<version number>.zip

For the NETS Minimum Demand “solved case”

LTDS\_<licence area>\_<publication year>-<period>\_GBMinimum\_<date/time of minimum>h\_v<version number>.zip

For the Existing System Capacity “case”

LTDS\_<licence area>\_<publication year>-<period>\_SystemCapacity\_Existing\_v<version number>.zip

For the five Future Year System Capacity “cases”

LTDS\_<licence area>\_<publication year>-<period>\_SystemCapacity\_FY<yyyy>\_v<n>.zip

For all “firm” future development projects

LTDS\_<licence area>\_<publication year>-<period>\_<project ID>\_v<version number>.zip

Where

- <licence area> is one of the following:
  - EELC (for East England operated by UK Power Networks)
  - EMEB (for East Midlands operated by National Grid Electricity Distribution)
  - LOND (for London operated by UK Power Networks)
  - MANW (for North Wales, Merseyside and Cheshire operated by SP Energy Networks)
  - MIDE (for West Midlands operated by National Grid Electricity Distribution)
  - NEEB (for North East England operated by Northern Powergrid)
  - NORW (for North West England operated by Electricity North West)
  - HYDE (for North Scotland operated by Scottish and Southern Electricity Networks)

- SPOW (for South and Central Scotland operated by SP Energy Networks)
- SEEB (for South East England operated by UK Power Networks)
- SOUT (for Southern England operated by Scottish and Southern Electricity Networks)
- SWAE (for South Wales operated by National Grid Electricity Distribution)
- SWEB (for South West England operated by National Grid Electricity Distribution)
- YELG (for Yorkshire operated by Northern Powergrid)
- <publication year> is the 4-digit year of the publication
- <period> is a 2-digit number reflecting the publication cycle number within the year
- <date/time of maximum> and <date/time of minimum> are expressed in yyyy-mm-dd\_hhmm format
- <version number> is 1 for the .zip file initially published in a publication cycle and is incremented by 1 for any correction publication of the .zip file done thereafter in the cycle
- <yyyy> is a 4-digit future year
- <project ID> is a unique identifier, not longer than 24 characters, for the project. The project ID should persist through LTDS publication cycles.


#### .zip file content

- For the NETS Maximum Demand “solved case” and NETS Minimum Demand “solved case” .zip files, there are 4 CIM XML files with the following names and contents:
  - Physical.xml containing a Full Model with grid objects conforming to three merged LTDS profiles (Equipment, Short Circuit and Geographical Location)
  - DiagramLayout.xml containing a Full Model with grid objects conforming to the merged LTDS Diagram Layout profile
  - Situation.xml containing a Full Model with grid objects conforming to the merged LTDS Steady State Hypothesis profile
  - Solution.xml containing a Full Model with grid objects conforming to two merged LTDS profiles (Topology and State Variables)
- For the Existing System Capacity “case” .zip file and for each of the five Future Year System Capacity “case” .zip files, there are 2 CIM XML files with the following names and contents:
  - Physical.xml containing a Full Model with grid objects conforming to three merged LTDS profiles (Equipment, Short Circuit and Geographical Location)
  - SystemCapacity.xml containing a Full Model with grid objects conforming to the merged LTDS System Capacity profile

- For each planned grid Development Project .zip file, there is one CIM XML file called Physical.xml which contains a Difference Model whose grid objects are those defined in three merged LTDS profiles (Equipment, Short Circuit and Geographical Location).

CIM XML file content

The data described for the instance file header is based on CGMES v3.0. The CGMES v3.0 is using the definitions defined in the IEC 61970-552. The UML diagram presented below describes the header UML that is used by CGMES v3.0. The header information appears at the beginning of every CIM XML file.

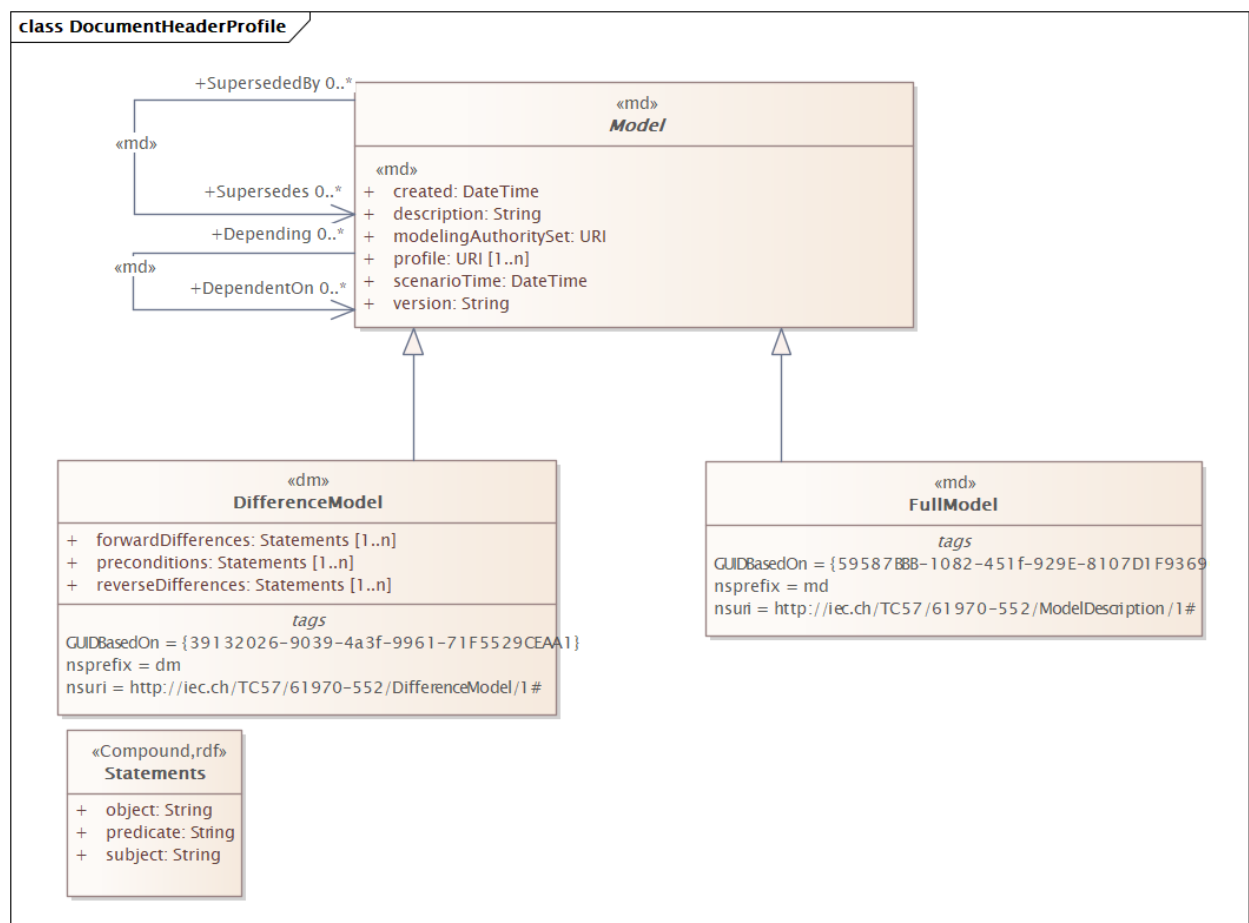

The Model class defines the header information and the md:FullModel and dm:DifferenceModel objects used in exchanges inherit the Model attributes and associations. For LTDS it is defined that all the md:Model attributes, except .version, are required in both the md:FullModel and dm:DifferenceModel objects of LTDS data exchanges. The .version is attribute is considered optional. The md:Model.Supersedes association is not used by LTDS and the md:Model.DependentOn association is conditional.

A CIM XML file with a md:FullModel header supplies a “snapshot” of grid data reflecting a given moment or condition. Grid instance data, conforming to one or more profiles, follows immediately after the md:FullModel header object.

A CIM XML file with a dm:DifferenceModel header describes changes to grid data. The changes are described by of two sets of grid model instance data embedded in the dm:DifferenceModel header:

- One set of objects, and their attributes and associations, define items to be added to an existing Full Model – these are the Statements of the dm:DifferenceModel.forwardDifferences.
- A second set of objects, and their attributes and associations, define items to be deleted from an existing Full Model – these are the Statements of the dm:DifferenceModel.reverseDifferences.

Together they describe the net effect of a set of grid changes. The objects making up the forward differences and reverse differences are CIM grid objects which conform to the class, attribute and association structure defined by one or more profiles, although they cannot, on their own, be expected to conform to the multiplicity rules specified by the profiles.

### Full Models

In LTDS grid model data exchanges, a Full Model CIM XML file contains the following statements:

```
<?xml version="1.0" encoding="UTF-8" ?>
<rdf:RDF
  xmlns:md="http://iec.ch/TC57/61970-552/ModelDescription/1#"
  xmlns:cim="http://iec.ch/TC57/CIM100#"
  xmlns:eu="http://iec.ch/TC57/CIM100-European#"
  xmlns:gb="http://ofgem.gov.uk/ns/CIM/LTDS/Extensions#"
  xmlns:rdf="http://www.w3.org/1999/02/22-rdf-syntax-ns#">
  <md:FullModel rdf:about="urn:uuid:UUID">
    <md:Model.created>yyyy-mm-ddT hh:mm:ss.nnnZ</md:Model.created>
    <md:Model.scenarioTime>yyyy-mm-ddT hh:mm:ss.000Z</md:Model.scenarioTime>
    <md:Model.description>FullModel or DifferenceModel description</md:Model.description>
    <md:Model.modelingAuthoritySet>DNO website URL/licence area</md:Model.modelingAuthoritySet>
    <md:Model.version>nn</md:Model.version>
    <md:Model.profile>http://ofgem.gov.uk/CIM/LTDS/profile name</md:Model.profile>
    <md:Model.profile>http://ofgem.gov.uk/CIM/LTDS/profile name</md:Model.profile>
    <md:Model.DependentOn rdf:resource="#_UUID"/>
  </md:FullModel>
  ... grid objects ...
```

</rdf:RDF>

The statements in grey are RDF and namespace definitions that appear in any CIM XML file containing a FullModel.

The statements in blue are the md:FullModel definition, where the light blue fields describe the following:

- In <md:FullModel rdf:about="urn:uuid:UUID">,
  - UUID* is the unique identifier of the FullModel expressed in Universally Unique Identifier (UUID) form.
- In <md:Model.created>yyyy-mm-ddT hh:mm:ss.nnnZ</md:Model.created>,
  - yyyy-mm-ddT hh:mm:ss.nnn* is the date/time that the Full Model was serialised.
- In <md:Model.scenarioTime>yyyy-mm-ddT hh:mm:00.000Z</md:Model.scenarioTime>,
  - yyyy-mm-ddT hh:mm* is the date/time that the Full Model represents. The conventions for its population in LTDS data exchanges are given in the table below.
- In
  - <md:Model.description>FullModel or DifferenceModel description</md:Model.description>,
    - FullModel or DifferenceModel description* is a free form text field containing a locally meaningful description of the CIM XML file.
- In
  - <md:Model.modelingAuthoritySet>DNO website URL/ltids/licence area</md:Model.modelingAuthoritySet>
    - *DNO website URL* is the URL of the DNO's main website.
    - *licence area* is one of the following (same list as for .zip file names):
      - EELC
      - EMEB
      - LOND
      - MANW
      - MIDE
      - NEEB
      - NORW
      - HYDE
      - SPOW
      - SEEB
      - SOUT
      - SWAE
      - SWEB
      - YELG
- In <md:Model.version>nn</md:Model.version> ,

*nn* is any text string a DNO chooses to use to represent a version. It is totally unrelated to the version number appearing in the .zip file name.

- In `<md:Model.profile>http://ofgem.gov.uk/CIM/LTDS/profile name</md:Model.profile>`,

*profile name* is one of the following:

- Equipment
- ShortCircuit
- GeographicalLocation
- DiagramLayout
- SteadyStateHypothesis
- Topology
- StateVariables
- SystemCapacity

The conventions for its population in LTDS data exchanges are given in the table below. Note that there may be one, two or three md:Model.profile statements.

- In `<md:Model.DependentOn rdf:resource=#UUID'/>`,

*UUID* is the unique persistent identifier of a Full Model on which this Full Model depends. The conventions for its population in LTDS data exchanges are given in the table below. Note that there may be zero to many md:Model.DependentOn statements.



<b>.zip file</b>	<b>CIM XML file</b>	<b>Full or Difference Model</b>	<b>header .DependentOn is UUID of</b>	<b>header .scenarioTime represents</b>	<b>header profile name(s) (to which grid object content conforms)</b>
NETS Maximum Demand "solved case"	Physical	Full Model	-none-	date/time of GB maximum demand	Equipment ShortCircuit GeographicalLocation
	DiagramLayout	Full Model	Physical Full Model in same .zip file	same as Physical	DiagramLayout
	Situation	Full Model	Physical Full Model in same .zip file	same as Physical	SteadyStateHypothesis
	Solution	Full Model	Physical and Situation Full Models in same .zip file	same as Physical	Topology StateVariables
NETS Minimum Demand "solved case"	Physical	Full Model	-none-	date/time of GB minimum demand	Equipment ShortCircuit GeographicalLocation
	DiagramLayout	Full Model	Physical Full Model in same .zip file	same as Physical	DiagramLayout
	Situation	Full Model	Physical Full Model in same .zip file	same as Physical	SteadyStateHypothesis
	Solution	Full Model	Physical and Situation Full Models in same .zip file	same as Physical	Topology StateVariables
Existing System Capacity "case"	Physical	Full Model	-none-	date/time for which SystemCapacity data is valid – a date close to the date of publication	Equipment ShortCircuit GeographicalLocation
	DiagramLayout	Full Model	Physical Full Model in same .zip file	same as Physical	DiagramLayout
	SystemCapacity	Full Model	Physical Full Model in same .zip file	same as Physical	SystemCapacity
Future Year System Capacity "case"	Physical	Full Model	-none-	date/time for which SystemCapacity data is valid – a date in the appropriate future year	Equipment ShortCircuit GeographicalLocation
	DiagramLayout	Full Model	Physical Full Model in same .zip file	same as Physical	DiagramLayout
	SystemCapacity	Full Model	Physical Full Model in same .zip file	same as Physical	SystemCapacity

## Difference Models

In LTDS grid model data exchanges, a Difference Model CIM XML file contains the following statements:

```
<?xml version="1.0" encoding="UTF-8" ?>
<rdf:RDF
  xmlns:md="http://iec.ch/TC57/61970-552/ModelDescription/1#"
  xmlns:dm="http://iec.ch/TC57/61970-552/DifferenceModel/1#"
  xmlns:cim="http://iec.ch/TC57/CIM100#"
  xmlns:eu="http://iec.ch/TC57/CIM100-European#"
  xmlns:gb="http://ofgem.gov.uk/ns/CIM/LTDS/Extensions#"
  xmlns:rdf="http://www.w3.org/1999/02/22-rdf-syntax-ns#">
  <dm:DifferenceModel rdf:about="urn:uuid:UUID">
    <md:Model.created>yyyy-mm-ddT hh:mm.nn.nnnZ</md:Model.created>
    <md:Model.scenarioTime>yyyy-mm-ddT hh:mm:00.000Z</md:Model.scenarioTime>
    <md:Model.description>description of the set of changes</md:Model.description>
    <md:Model.modelingAuthoritySet>DNO website URL/ltids/licence area</md:Model.modelingAuthoritySet>
    <md:Model.version>nn</md:Model.version>
    <md:Model.profile>http://ofgem.gov.uk/CIM/LTDS/profile name</md:Model.profile>
    <md:Model.DependentOn rdf:resource="#_UUID"/>
    <md:Model.DependentOn rdf:resource="#_UUID"/>
    <dm:forwardDifferences parseType="Statements"
      ... grid object additions ...
    </dm:forwardDifferences>
    <dm:reverseDifferences parseType="Statements">
      ... grid object deletions ...
    </dm:reverseDifferences>
  </dm:DifferenceModel>
</rdf:RDF>
```

The statements in grey are RDF and namespace definitions that appear in any CIM XML file containing a Difference Model.

The statements in green are the Difference Model definition, where the light green fields describe the following:

- In `<dm:DifferenceModel rdf:about="urn:uuid:UUID">`, `UUID` is the unique identifier of the Difference Model expressed in Universally Unique Identifier (UUID) form.
- In `<md:Model.created>yyyy-mm-ddT hh:mm.nn.nnnZ</md:Model.created>`, `yyyy-mm-ddT hh:mm.nn.nnn` is the date/time that the Difference Model was serialised.

- In `<md:Model.scenarioTime>yyyy-mm-ddT hh:mm.00.000Z</md:Model.scenarioTime>`, *yyyy-mm-ddT hh:mm* is a date/time of relevance to the Difference Model. The conventions for its population in LTDS data exchanges are given in the table below.
- In `<md:Model.description>description of set of changes</md:Model.description>`, *description of set of changes* is a free form text field containing a locally meaningful description of what the set of changes in the CIM XML file represents.
- In `<md:Model.modelingAuthoritySet>DNO website URL/tds/licence area</md:Model.modelingAuthoritySet>`
  - *DNO website URL* is the URL of the DNO’s main website.
  - *licence area* is one of the allowed *licence area* values from the list outlined for the `md:modelingAuthoritySet` statement of a Full Model.
- In `<md:Model.version>nn</md:Model.version>`, *nn* is any text string a DNO chooses to use to represent a version. It is totally unrelated to the version number appearing in the .zip file name.
- In `<md:Model.profile>http://ofgem.gov.uk/CIM/LTDS/profile name</md:Model.profile>`, *profile name* is one of the following:
  - Equipment
  - ShortCircuit
  - GeographicalLocation

The conventions for its population in LTDS data exchanges are given in the table below. Note that there may be one, two or three `md:Model.profile` statements, depending on the nature of the grid change being described.
- In `<md:Model.DependentOn rdf:resource="#_UUID"/>`, *UUID* is the unique persistent identifier of a Difference Model on which this Difference Model depends. The conventions for its population in LTDS data exchanges are given in the table below. Note that there may be zero to many `md:Model.DependentOn` statements.

<b>.zip file</b>	<b>CIM XML file</b>	<b>Full or Difference Model</b>	<b>header .DependentOn is UUID of</b>	<b>header .scenarioTime represents</b>	<b>header profile name(s)</b>
individual Development Project	Physical	Difference Model	other individual Development Project Difference Models, if any	anticipated Development Project in-service date/time	Equipment ShortCircuit GeographicalLocation

## 2 Terms, Definitions and Abbreviated Terms

### **Common Grid Model Exchange Standard (CGMES)**

The CGMES is a CIM-based profile and usage standards developed by the European Network of Transmission System Operators for Electricity (ENTSO-E). Version 3.0 of CGMES (CGMES v3.0) is described by IEC 61970-600-1:2021 and IEC 61970-600-2:2021.

### **Common Information Model (CIM)**

The CIM is an information model described by IEC 61970-301:2020 and expressed in UML. Its classes, attributes and associations provide the semantic model on which profiles are based.

### **Common Information Model in Extensible Markup Language (CIM XML)**

CIM XML is CIM-based instance data expressed in Extensible Markup Language (XML). For grid model CIM XML, the RDF/XML syntax is typically used.

### **Difference Model**

A Difference Model is an instance of a dm:DifferenceModel. It describes an update to a FullModel. It is composed of

- a header which provides limited context information and
- two sets of CIM grid instance data, both of which conform to the same profile(s). One set describes objects/attributes/associations to be added, the other set describes objects/attributes/associations to be deleted.

### **Distribution Network Operator (DNO)**

A DNO is a company that owns, operates and maintains an electric distribution network in Great Britain.

### **European Network of Transmission System Operator for Electricity (ENTSO-E)**

ENTSO-E is the European association for the cooperation of transmission system operators (TSOs) for electricity.

### **Full Model**

A FullModel is an instance of a md:FullModel(which is a header which provides limited context information) along with a set of CIM grid instance data conforming to a profile or combination of profiles.

### **High Voltage Direct Current (HVDC)**

HVDC is direct current used for the bulk transmission of power at voltages above 100kV.

### **International Electrotechnical Commission (IEC)**

The IEC is an international standards organization that prepares and publishes international standards for electrical, electronic and related technologies.

### **Long-Term Development Statement (LTDS)**

The LTDS is a statement published by a DNO in Great Britain pursuant to provisions of paragraph 25.2 and 25.3 of the electricity distribution licence granted to it under section 6(1)(c) of the Electricity Act 1989.

### **National Electricity Transmission System (NETS)**

NETS the transmission grid in Great Britain, consisting of high voltage electric lines owned or operated by transmission licensees within Great Britain, in the territorial sea adjacent to Great Britain and in any renewable energy zone, and used for the transmission of electricity from one generating station to a substation or to another generating station or between substations or to or from any interconnector.

A profile, in CIM-based grid model data exchange, is a non-overlapping subset of CIM classes, attributes and associations defined to organise grid model data and support a data exchange.

### **Profile**

A profile, in CIM-based grid model data exchange, is a non-overlapping subset of CIM classes, attributes and associations defined to organise grid model data and support a data exchange.

### **Resource Definition Framework / Extensible Markup Language (RDF/XML)**

RDF/XML is a syntax, defined by the W3C, to express (i.e. serialize) an RDF graph (data expressed as triples) as an XML document. In CIM-based implementations of grid model data exchange, grid instance data is serialised into RDF/XML.

### **Resource Definition Framework Schema (RDFS)**

RDFS is a W3C-defined language for representing the structure of a set of data.

### **Shapes Constraint Language (SHACL)**

SHACL is a language for validating RDF graphs against a set of conditions. In CIM-based grid model data exchange, the RDF graph is grid instance data expressed in RDF/XML.

## 3 List of LTDS Appendices

### LTDS Information Model

- **Appendix 1:** LTDS Information Model and Profiles

This is the EnterpriseArchitect .eap file which includes LTDS information model and the profiles, both required and optional.

- **Appendix 2:** LTDS Information Model Diagrams and Descriptions

This is a Word document with machine-generated diagrams from .eap showing the relevant portions of the underlying information models (base CIM, European extensions, Network Code extensions, and Great Britain extensions) with definitions for all Great Britain extension classes, attributes, associations.

### LTDS Profiles and Constraints

- **Appendix 3:** LTDS Profile Classes and Attributes

This is an Excel spreadsheet summarizing:

- Classes and attributes used by LTDS
- LTDS vs CGMES profile classes and enumerations.

- **Appendix 4:** LTDS Layered Profiles

This is a Word document with machine-generated content from .eap with diagrams showing each LTDS deviation and extended profile and including version information for each profile.

- **Appendix 5:** Short Circuit Result Profile

This is a Word document with machine-generated content from .eap including diagrams and description of classes, attributes and associations of the short circuit result optional profile.

- **Appendix 6:** LTDS Profiles in RDFS

This is machine-generated information which represents the RDF schemas of all profiles. RDFS is generated for individual profiles i.e., LTDS deviation profiles and LTDS extended profiles as well as for merged profiles where the resulting RDFS is a merge of CGMES v3.0 RDFS, LTDS deviation profile and LTDS extended profile.

- **Appendix 7:** LTDS Constraints in SHACL

This is machine-generated information of SHACL based constraints. These constraints are validating cardinalities of associations, attributes, their datatypes and relationship. SHACL constraints are generated only for the merged profiles.

- **Appendix 8:** Equivalent Infeed Impedance Calculations

In the previous version of LTDS the positive and zero sequence impedance parameters (R1, X1, R0 and X0) were explicitly specified. In this version of LTDS these values can be calculated using the single and three phase fault current magnitudes and angles. This appendix is a Word document which describes the equations to calculate impedances.

- **Appendix 9:** LTDS Constraint Descriptions

This is a Word document containing tables with descriptions of:

- Relevant CGMES v3.0 constraints