

## Long Term Development Statement (LTDS)

### Appendix 2: LTDS Information Model Diagrams and Descriptions

<b>Publication date:</b>	29 August 2023	<b>Team:</b>	Digitalisation and Decentralisation; Energy Systems Management and Security
		<b>Email:</b>	flexibility@ofgem.gov.uk

This document outlines the LTDS information model for the data exchanges of the proposed LTDS Common Information Model (CIM) revision.

© Crown copyright 2023

The text of this document may be reproduced (excluding logos) under and in accordance with the terms of the [Open Government Licence](#).

Without prejudice to the generality of the terms of the Open Government Licence the material that is reproduced must be acknowledged as Crown copyright and the document title of this document must be specified in that acknowledgement.

Any enquiries related to the text of this publication should be sent to Ofgem at:  
10 South Colonnade, Canary Wharf, London, E14 4PU.

This publication is available at [www.ofgem.gov.uk](http://www.ofgem.gov.uk). Any enquiries regarding the use and re-use of this information resource should be sent to: [psi@nationalarchives.gsi.gov.uk](mailto:psi@nationalarchives.gsi.gov.uk)

## Contents

<b>1</b>	<b>LTDS Information Model Extensions .....</b>	<b>4</b>
1.1	General .....	4
1.1.1	Information Model Diagrams .....	4
1.2	Extensions to CIM Production package .....	13
1.2.1	General .....	13
1.2.2	(GB) BioFuel .....	14
1.2.3	(GB) FlywheelUnit .....	15
1.2.4	(GB) HydroPowerPlant root class .....	18
1.2.5	(GB) OtherFuel .....	19
1.2.6	(GB) BioFuelKind enumeration .....	20
1.2.7	(GB) OtherFuelKind enumeration .....	20
1.3	Extensions to CIM OperationalLimits .....	20
1.3.1	General .....	20
1.3.2	(GB) OperationalLimitSet root class .....	21
1.3.3	(GB) OperationalLimitType root class .....	21
1.4	Extensions related to Busbar results and capacities .....	22
1.4.1	General .....	22
1.4.2	(GB) BusbarGroup .....	22
1.4.3	(GB) FirmCapacity .....	24
1.4.4	(GB) MaximumLoading .....	24
1.4.5	(GB) PastYearConnectionActivity .....	26
1.5	Extensions to CIM Transformer model .....	28
1.5.1	General .....	28
1.5.2	(GB) PowerTransformer root class .....	28
1.5.3	(GB) TranformerEnd root class .....	29
1.5.4	(GB) EarthingMethodKind enumeration .....	29
1.5.5	(GB) ReverseFlowCapabilityKind enumeration .....	29
1.6	Extensions related to Short Circuit .....	30
1.6.1	General .....	30
1.6.2	(GB) ProtectedSwitch root class .....	30
1.6.3	(GB) ShortCircuitResult .....	31
1.6.4	(GB) StateShortCircuitResult .....	32
1.6.5	(GB) SummaryShortCircuitResult .....	35
1.6.6	(GB) ShortCircuitFaultKind enumeration .....	36

# 1 LTDS Information Model Extensions

## 1.1 General

This package includes extensions that are applicable to the exchanges in Great Britain.

### 1.1.1 Information Model Diagrams

This package contains diagrams used for documenting the usage of the extensions.




Figure 1 – Class diagram LTDSInformationModelDiagrams::Key

Figure 1: This diagram shows the class coloring used in the LTDS information model diagrams.

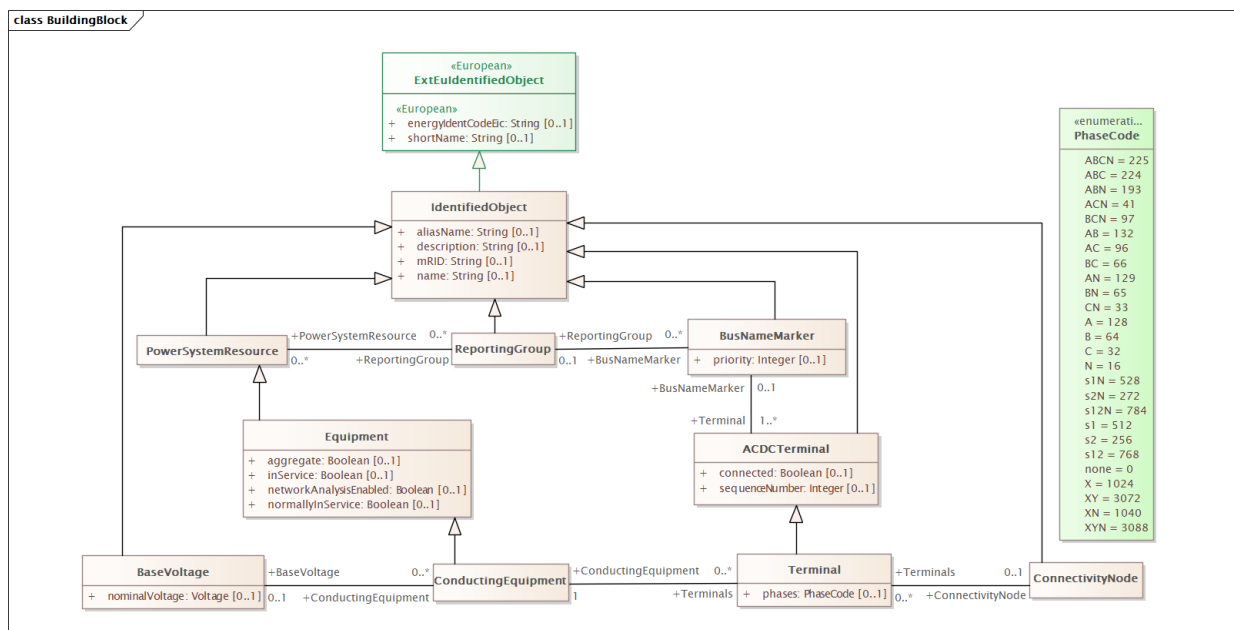


Figure 2 – Class diagram LTDSInformationModelDiagrams::BuildingBlock

Figure 2: This diagram shows the foundational grid model classes (e.g., Identified Object, PowerSystemResource, ConductingEquipment, Terminal, ConnectivityNode, BaseVoltage). It also shows several other classes not detailed on other diagrams (BusNameMarker and ReportingGroup).



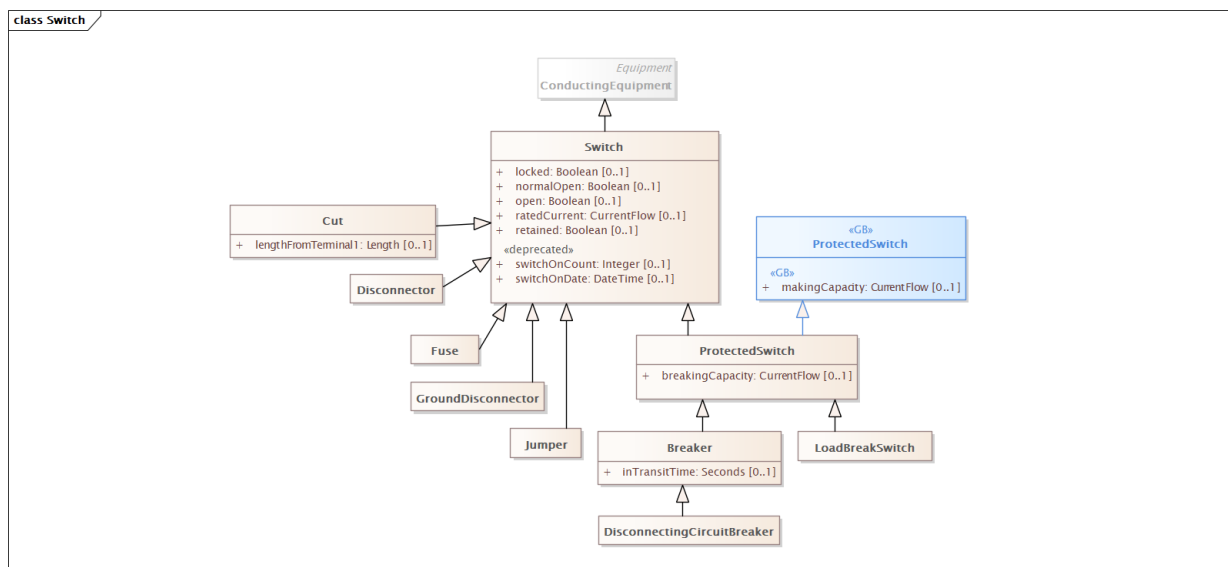


Figure 4 – Class diagram LTDSInformationModelDiagrams::Switch

Figure 4: This diagram shows the CIM Switch-related classes forming the underlying information model for the LTDS profiles.

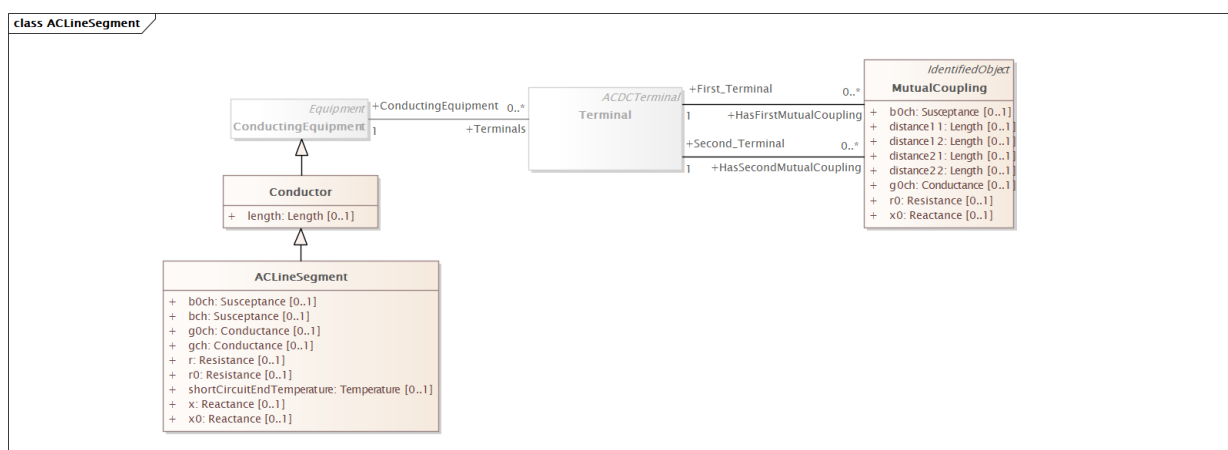


Figure 5 – Class diagram LTDSInformationModelDiagrams::ACLineSegment

Figure 5: This diagram shows the CIM ACLineSegment-related classes forming the underlying information model for the LTDS profiles.

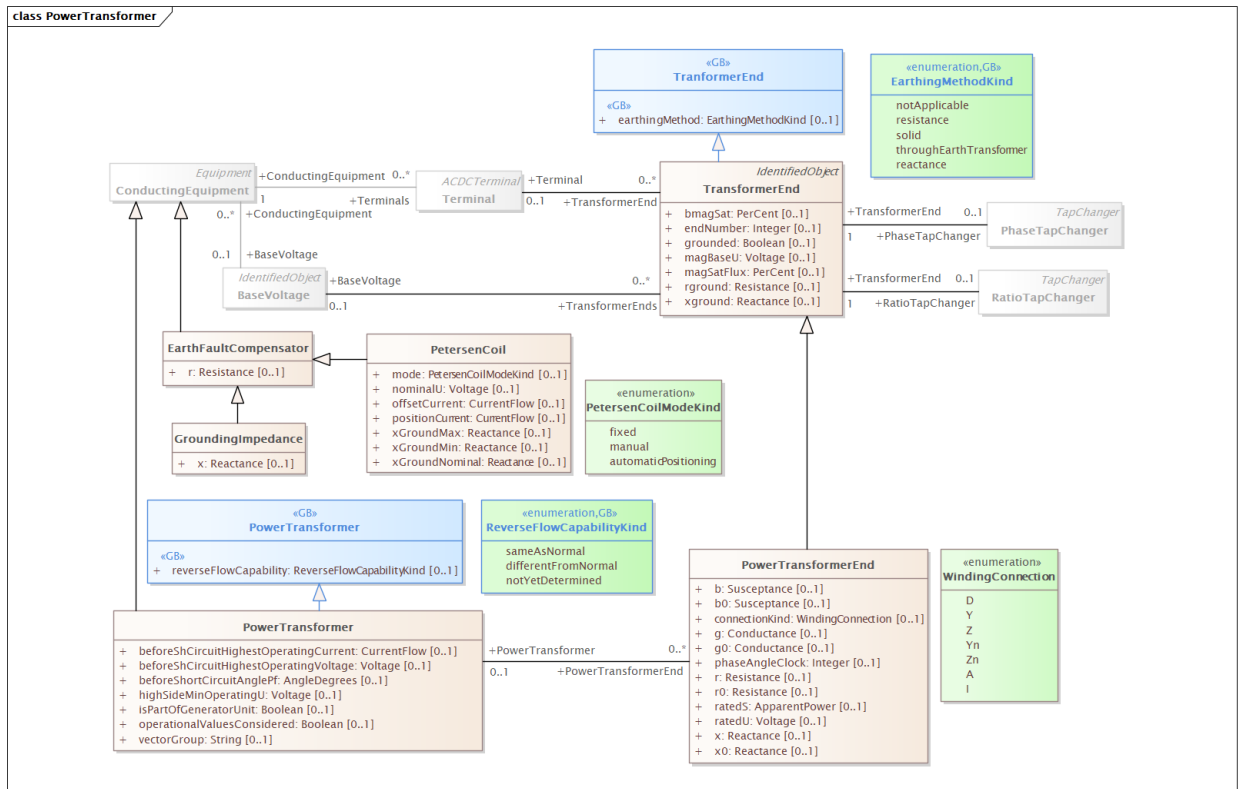


Figure 6 – Class diagram LTDSInformationModelDiagrams::PowerTransformer

Figure 6: This diagram shows the CIM PowerTransformer-related classes forming the underlying information model for the LTDS profiles.

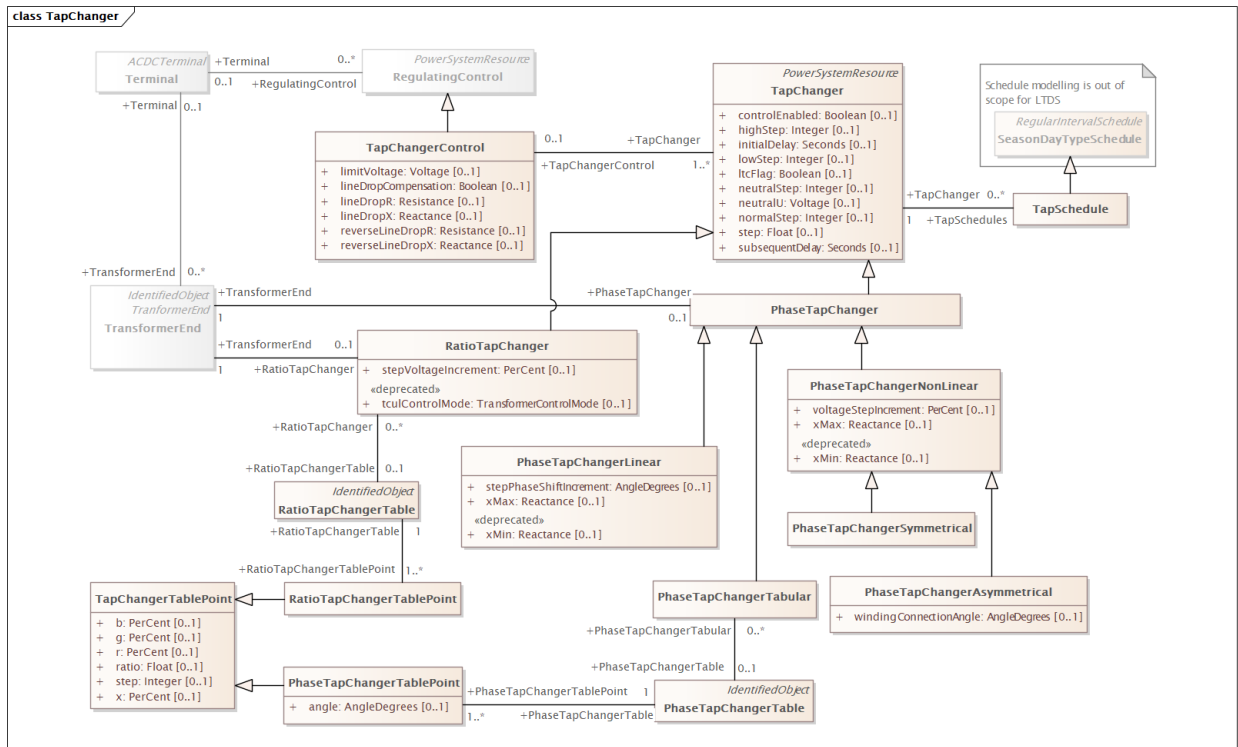


Figure 7 – Class diagram LTDSInformationModelDiagrams::TapChanger

Figure 7: This diagram shows the CIM TapChanger-related classes forming the underlying information model for the LTDS profiles.

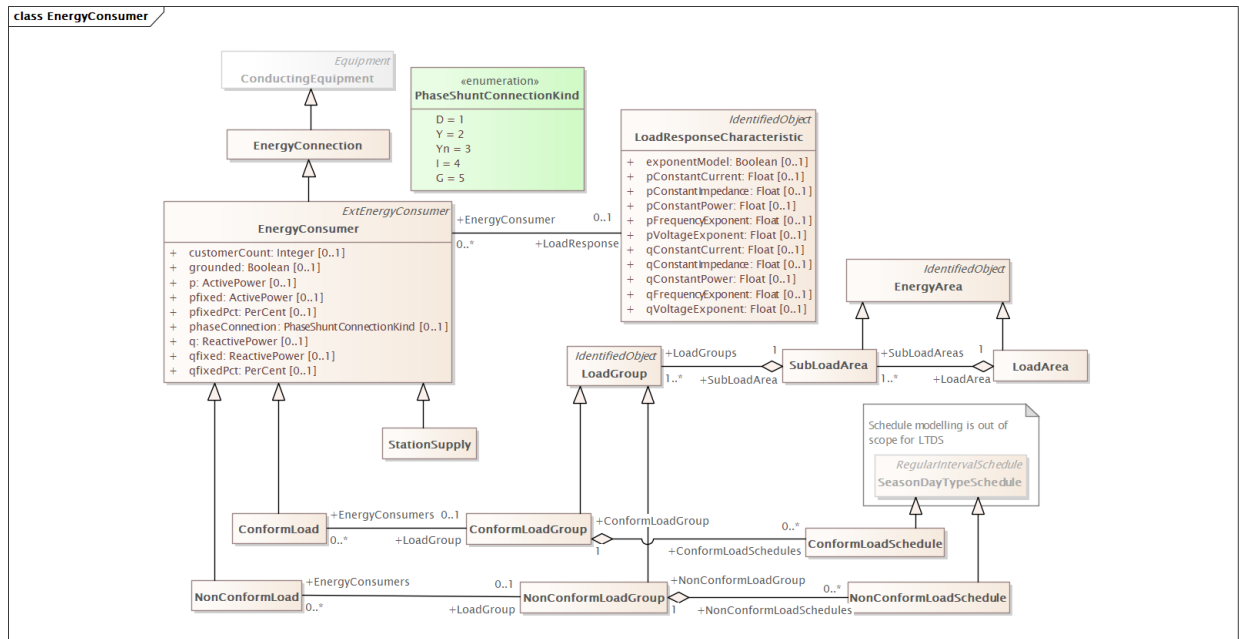


Figure 8 – Class diagram *LTDSInformationModelDiagrams::EnergyConsumer*

Figure 8: This diagram shows the CIM EnergyConsumer-related classes forming the underlying information model for the LTDS profiles.





These classes represent the electrical characteristics of generators.





```

classDiagram
    class OperationalLimitSet {
        <<GB>>
        + validFrom: MonthDay [0..1]
        + validTo: MonthDay [0..1]
    }
    class OperationalLimitType {
        <<GB>>
        + transformerReverseFlow: Boolean [0..1]
    }
    class OperationalLimit {
        <<enum, Europe... LimitKind>>
        + normalValue: ActivePower [0..1]
        + value: ActivePower [0..1]
    }
    class OperationalLimitDirectionKind {
        <<enumeration>>
        + high
        + low
        + absoluteValue
    }
    class ACDCTerminal {
        IdentifiedObject
    }
    class Terminal {
    }
    class ActivePowerLimit {
        + normalValue: ActivePower [0..1]
        + value: ActivePower [0..1]
    }
    class ApparentPowerLimit {
        + normalValue: ApparentPower [0..1]
        + value: ApparentPower [0..1]
    }
    class CurrentLimit {
        + normalValue: CurrentFlow [0..1]
        + value: CurrentFlow [0..1]
    }
    class VoltageLimit {
        + normalValue: Voltage [0..1]
        + value: Voltage [0..1]
    }
    class IdentifiedObject {
    }
    class Equipment {
        PowerSystemResource
    }

    OperationalLimitSet --> OperationalLimitType : + OperationalLimitType
    OperationalLimitSet --> OperationalLimit : + OperationalLimit
    OperationalLimitSet --> OperationalLimitSet : + OperationalLimitSet
    OperationalLimitType --> IdentifiedObject : IdentifiedObject
    OperationalLimit --> IdentifiedObject : IdentifiedObject
    OperationalLimitSet --> ACDCTerminal : + Terminal
    OperationalLimitSet --> Equipment : + Equipment
    ActivePowerLimit --> OperationalLimit : + ActivePowerLimit
    ApparentPowerLimit --> OperationalLimit : + ApparentPowerLimit
    CurrentLimit --> OperationalLimit : + CurrentLimit
    VoltageLimit --> OperationalLimit : + VoltageLimit
    ACDCTerminal --|> Terminal
    Equipment --|> PowerSystemResource

```

Figure 12: This diagram shows the CIM OperationalLimitSet-related classes forming the underlying information model for the LTDS profiles.

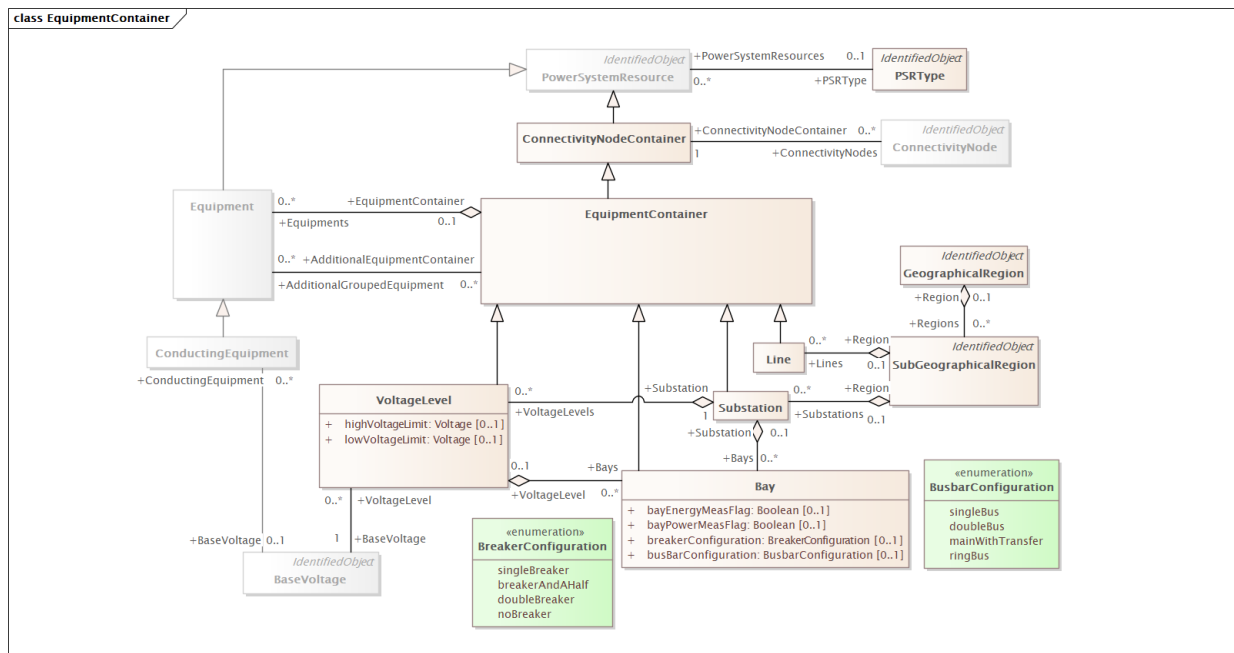


Figure 13 – Class diagram LTDSInformationModelDiagrams::EquipmentContainer

Figure 13: This diagram shows the CIM EquipmentContainer-related classes forming the underlying information model for the LTDS profiles.

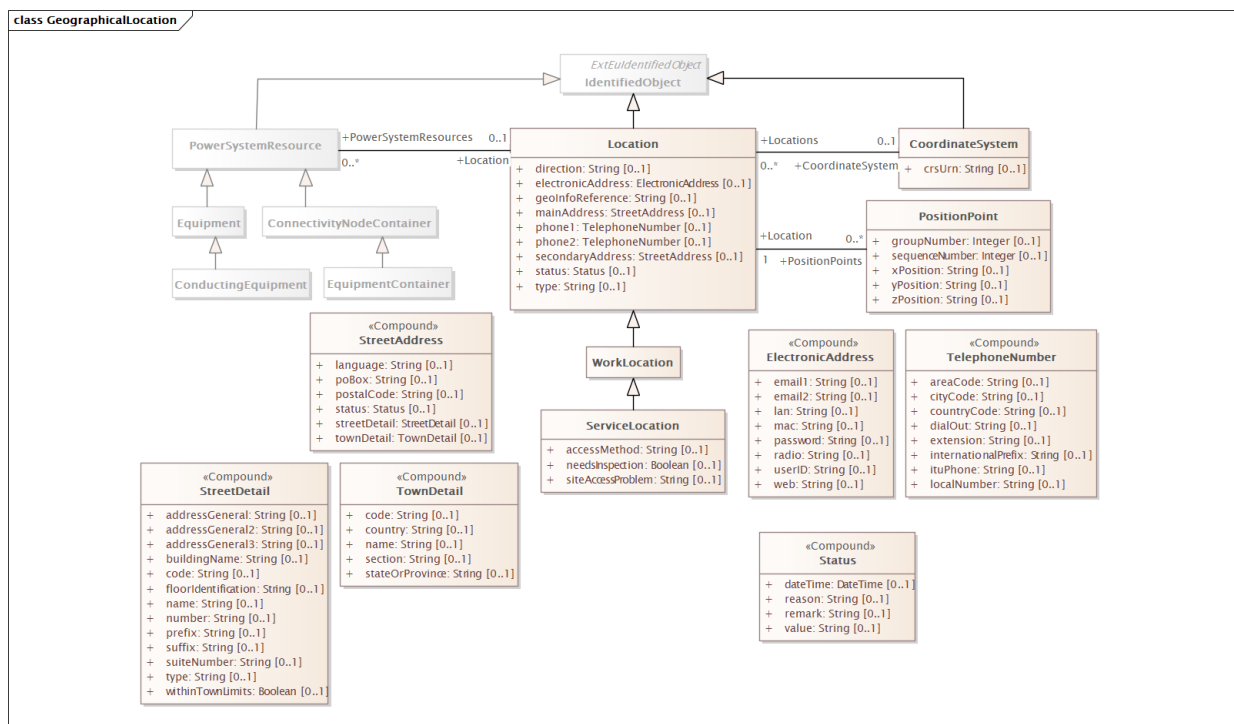


Figure 14 – Class diagram LTDSInformationModelDiagrams::GeographicalLocation

Figure 14: This diagram shows the CIM Location-related classes forming the underlying information model for the LTDS GeographicalLocation profile.

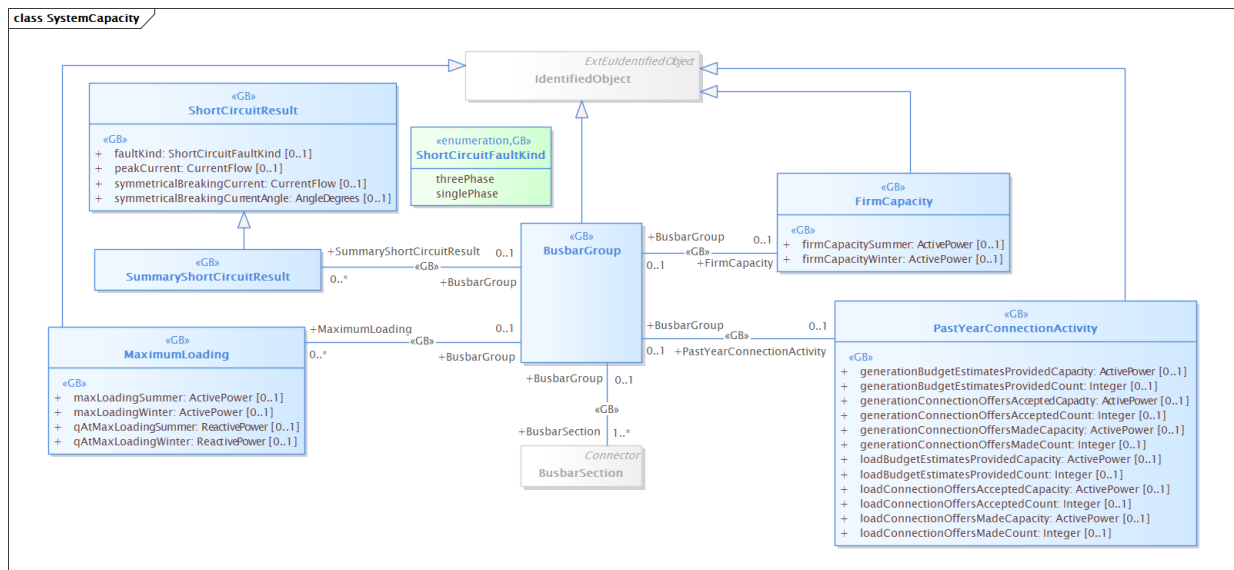


Figure 15 – Class diagram LTDSInformationModelDiagrams::SystemCapacity

Figure 15: This diagram shows the CIM classes forming the underlying information model for the LTDS SystemCapacity profile.

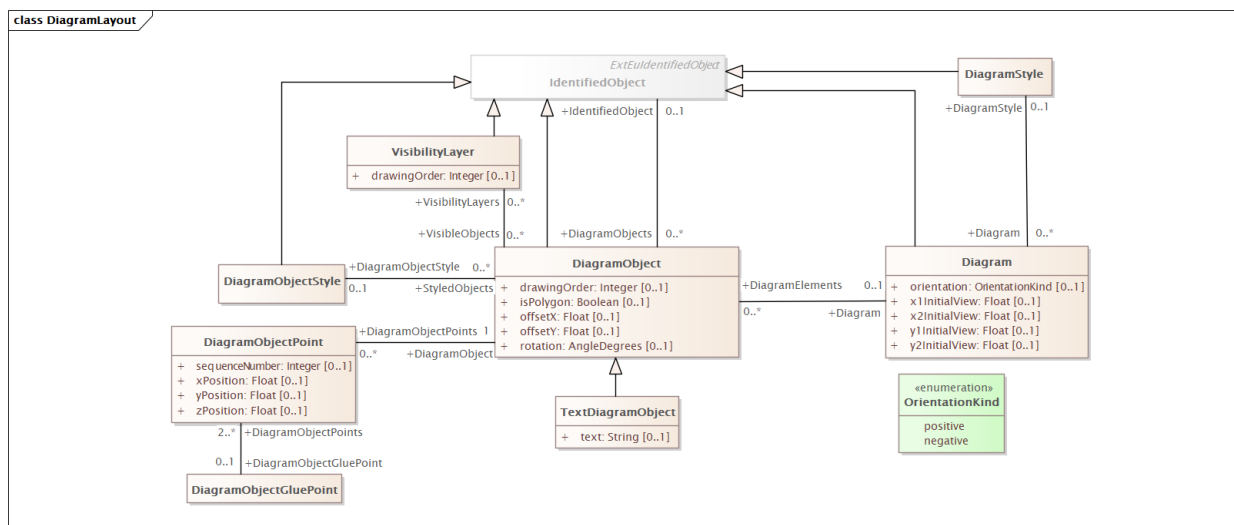


Figure 16 – Class diagram LTDSInformationModelDiagrams::DiagramLayout

Figure 16: This diagram shows the CIM Diagram-related classes forming the underlying information model for the LTDS DiagramLayout profile.

## 1.2 Extensions to CIM Production package

### 1.2.1 General

This package contains extensions related to generation.

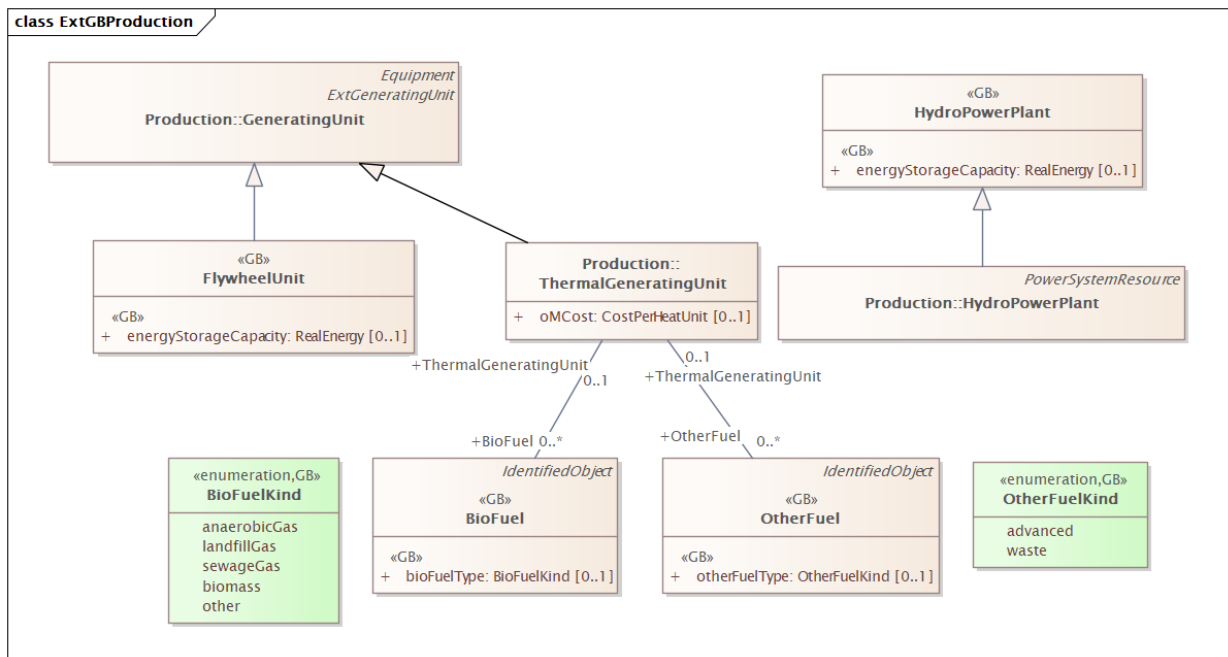


Figure 17 – Class diagram ExtGBProduction::ExtGBProduction

Figure 17: The diagram shows extensions related to generation.

### 1.2.2 (GB) BioFuel

Inheritance path = IdentifiedObject : ExtEuIdentifiedObject

The bio fuel consumed by the non-nuclear thermal generating unit.

Table 1 shows all attributes of BioFuel.

Table 1 – Attributes of ExtGBProduction::BioFuel

name	mult	type	description
bioFuelType	0..1	<a href="#">BioFuelKind</a>	(GB) The type of bio fuel.
aliasName	0..1	String	inherited from: IdentifiedObject
description	0..1	String	inherited from: IdentifiedObject
mRID	0..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject
energyIdentCodeEi	0..1	String	(European) inherited from: ExtEuIdentifiedObject
shortName	0..1	String	(European) inherited from: ExtEuIdentifiedObject

Table 2 shows all association ends of BioFuel with other classes.

Table 2 – Association ends of ExtGBProduction::BioFuel with other classes

mul t fro m	name	mul t to	type	description
0..*	ThermalGeneratingUnit	0..1	ThermalGeneratingUnit	The generating unit that has this bio fuel.
0..1	DiagramObjects	0..*	DiagramObject	inherited from: IdentifiedObject
0..1	Name	0..*	Name	(NC) inherited from: IdentifiedObject
0..1	ParameterEvent	0..*	ParameterEvent	inherited from: IdentifiedObject
0..1	AlternativeIdentifier	0..*	Name	(NC) inherited from: IdentifiedObject

### 1.2.3 (GB) FlywheelUnit

Inheritance path = GeneratingUnit : Equipment : PowerSystemResource : IdentifiedObject : ExtEuIdentifiedObject : ExtGeneratingUnit

A flywheel is a mechanical device which uses the conservation of angular momentum to store rotational energy. Therefore, it is a heavy wheel attached to a rotating shaft so as to smooth out delivery of power from a motor to a machine. The inertia of the flywheel opposes and moderates fluctuations in the speed of the engine and stores the excess energy for intermittent use.

Table 3 shows all attributes of FlywheelUnit.

*Table 3 – Attributes of ExtGBProduction::FlywheelUnit*

name	mul t	type	description
energyStorageCapacity	0..1	RealEnergy	(GB) The rated energy storage capacity. The attribute shall be a positive value.
allocSpinResP	0..1	ActivePower	inherited from: GeneratingUnit
autoCntrlMarginP	0..1	ActivePower	inherited from: GeneratingUnit
baseP	0..1	ActivePower	inherited from: GeneratingUnit
controlDeadband	0..1	ActivePower	inherited from: GeneratingUnit
controlPulseHigh	0..1	Seconds	inherited from: GeneratingUnit
controlPulseLow	0..1	Seconds	inherited from: GeneratingUnit
controlResponseRate	0..1	ActivePowerChangeRate	inherited from: GeneratingUnit
efficiency	0..1	PerCent	inherited from: GeneratingUnit



name	mult	type	description
genControlMode	0..1	GeneratorControlMode	inherited from: GeneratingUnit
genControlSource	0..1	GeneratorControlSource	inherited from: GeneratingUnit
governorMPL	0..1	PU	inherited from: GeneratingUnit
governorSCD	0..1	PerCent	inherited from: GeneratingUnit
highControlLimit	0..1	ActivePower	inherited from: GeneratingUnit
initialP	0..1	ActivePower	inherited from: GeneratingUnit
longPF	0..1	Float	inherited from: GeneratingUnit
lowControlLimit	0..1	ActivePower	inherited from: GeneratingUnit
lowerRampRate	0..1	ActivePowerChangeRate	inherited from: GeneratingUnit
maxEconomicP	0..1	ActivePower	inherited from: GeneratingUnit
maximumAllowableSpinningReserve	0..1	ActivePower	inherited from: GeneratingUnit
maxOperatingP	0..1	ActivePower	inherited from: GeneratingUnit
minEconomicP	0..1	ActivePower	inherited from: GeneratingUnit
minimumOffTime	0..1	Seconds	inherited from: GeneratingUnit
minOperatingP	0..1	ActivePower	inherited from: GeneratingUnit
modelDetail	0..1	Classification	inherited from: GeneratingUnit
nominalP	0..1	ActivePower	inherited from: GeneratingUnit
normalPF	0..1	Float	inherited from: GeneratingUnit
penaltyFactor	0..1	Float	inherited from: GeneratingUnit
raiseRampRate	0..1	ActivePowerChangeRate	inherited from: GeneratingUnit
ratedGrossMaxP	0..1	ActivePower	inherited from: GeneratingUnit
ratedGrossMinP	0..1	ActivePower	inherited from: GeneratingUnit
ratedNetMaxP	0..1	ActivePower	inherited from: GeneratingUnit
shortPF	0..1	Float	inherited from: GeneratingUnit
startupCost	0..1	Money	inherited from: GeneratingUnit
startupTime	0..1	Seconds	inherited from: GeneratingUnit
tieLinePF	0..1	Float	inherited from: GeneratingUnit
totalEfficiency	0..1	PerCent	inherited from: GeneratingUnit
variableCost	0..1	Money	inherited from: GeneratingUnit
aggregate	0..1	Boolean	inherited from: Equipment



name	mul t	type	description
inService	0..1	Boolean	inherited from: Equipment
networkAnalysisEnabled	0..1	Boolean	inherited from: Equipment
normallyInService	0..1	Boolean	inherited from: Equipment
aliasName	0..1	String	inherited from: IdentifiedObject
description	0..1	String	inherited from: IdentifiedObject
mRID	0..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject
energyIdentCodeEi c	0..1	String	(European) inherited from: ExtEuIdentifiedObject
shortName	0..1	String	(European) inherited from: ExtEuIdentifiedObject
shutdownTime	0..1	Seconds	(NC) inherited from: ExtGeneratingUnit
shutdownCost	0..1	Money	(NC) inherited from: ExtGeneratingUnit
maxStartupLoad	0..1	ActivePower	(NC) inherited from: ExtGeneratingUnit
participationFactor	0..1	Float	(NC) inherited from: ExtGeneratingUnit

Table 4 shows all association ends of FlywheelUnit with other classes.

*Table 4 – Association ends of ExtGBProduction::FlywheelUnit with other classes*

mul t fro m	name	mul t to	type	description
0..1	RotatingMachine	0..*	RotatingMachine	inherited from: GeneratingUnit
1..1	GenUnitOpCostCur ves	0..*	GenUnitOpCostCur ve	inherited from: GeneratingUnit
1..1	GenUnitOpSchedul e	0..1	GenUnitOpSchedul e	inherited from: GeneratingUnit
1..1	ControlAreaGenera tingUnit	0..*	ControlAreaGenera tingUnit	inherited from: GeneratingUnit

mul t fro m	name	mul t to	type	description
1..1	GrossToNetActivePowerCurves	0..*	GrossToNetActivePowerCurve	inherited from: GeneratingUnit
0..*	AggregatedEquipment	0..1	Equipment	(NC) inherited from: Equipment
0..1	OperationalLimitSet	0..*	OperationalLimitSet	inherited from: Equipment
1..1	ContingencyEquipment	0..*	ContingencyEquipment	inherited from: Equipment
0..*	EquipmentContainer	0..1	EquipmentContainer	inherited from: Equipment
0..1	Faults	0..*	Fault	inherited from: Equipment
0..*	AdditionalEquipmentContainer	0..*	EquipmentContainer	inherited from: Equipment
0..1	DetailedModelDynamics	0..*	DetailedModelDynamics	inherited from: Equipment
0..1	DetailedEquipment	0..*	Equipment	(NC) inherited from: Equipment
0..*	PSRType	0..1	PSRType	inherited from: PowerSystemResource
0..1	Controls	0..*	Control	inherited from: PowerSystemResource
0..1	Measurements	0..*	Measurement	inherited from: PowerSystemResource
1..1	OperatingShare	0..*	OperatingShare	inherited from: PowerSystemResource
0..*	ReportingGroup	0..*	ReportingGroup	inherited from: PowerSystemResource
0..1	DiagramObjects	0..*	DiagramObject	inherited from: IdentifiedObject
0..1	Name	0..*	Name	(NC) inherited from: IdentifiedObject
0..1	ParameterEvent	0..*	ParameterEvent	inherited from: IdentifiedObject
0..1	AlternativeIdentifier	0..*	Name	(NC) inherited from: IdentifiedObject

#### 1.2.4 (GB) HydroPowerPlant root class

Class that extends CIM HydroPowerPlant.

Table 5 shows all attributes of HydroPowerPlant.

*Table 5 – Attributes of ExtGBProduction::HydroPowerPlant*

name	mult	type	description
energyStorageCapacity	0..1	RealEnergy	(GB) The rated energy storage capacity. The attribute shall be a positive value.

### 1.2.5 (GB) OtherFuel

Inheritance path = IdentifiedObject : ExtEuIdentifiedObject

The other fuel consumed by the non-nuclear thermal generating unit.

Table 6 shows all attributes of OtherFuel.

*Table 6 – Attributes of ExtGBProduction::OtherFuel*

name	mult	type	description
otherFuelType	0..1	<a href="#">OtherFuelKind</a>	(GB) The type of other fuel.
aliasName	0..1	String	inherited from: IdentifiedObject
description	0..1	String	inherited from: IdentifiedObject
mRID	0..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject
energyIdentCodeEi	0..1	String	(European) inherited from: ExtEuIdentifiedObject
shortName	0..1	String	(European) inherited from: ExtEuIdentifiedObject

Table 7 shows all association ends of OtherFuel with other classes.

*Table 7 – Association ends of ExtGBProduction::OtherFuel with other classes*

mult from	name	mult to	type	description
0..*	ThermalGeneratingUnit	0..1	ThermalGeneratingUnit	The generating unit that has this fuel.
0..1	DiagramObjects	0..*	DiagramObject	inherited from: IdentifiedObject
0..1	Name	0..*	Name	(NC) inherited from: IdentifiedObject

mul t fro m	name	mul t to	type	description
0..1	ParameterEvent	0..*	ParameterEvent	inherited from: IdentifiedObject
0..1	AlternativeIdentifier	0..*	Name	(NC) inherited from: IdentifiedObject

### 1.2.6 (GB) BioFuelKind enumeration

Kinds of bio fuel.

Table 8 shows all literals of BioFuelKind.

*Table 8 – Literals of ExtGBProduction::BioFuelKind*

literal	value	description
anaerobicGas		Anaerobic gas.
landfillGas		Landfill gas.
sewageGas		Sewage gas.
biomass		Biomass.
other		Other.

### 1.2.7 (GB) OtherFuelKind enumeration

Kinds of other fuels.

Table 9 shows all literals of OtherFuelKind.

*Table 9 – Literals of ExtGBProduction::OtherFuelKind*

literal	value	description
advanced		Advanced fuel.
waste		Waste fuel.

## 1.3 Extensions to CIM OperationalLimits

### 1.3.1 General

This package contains extensions of operational limits.

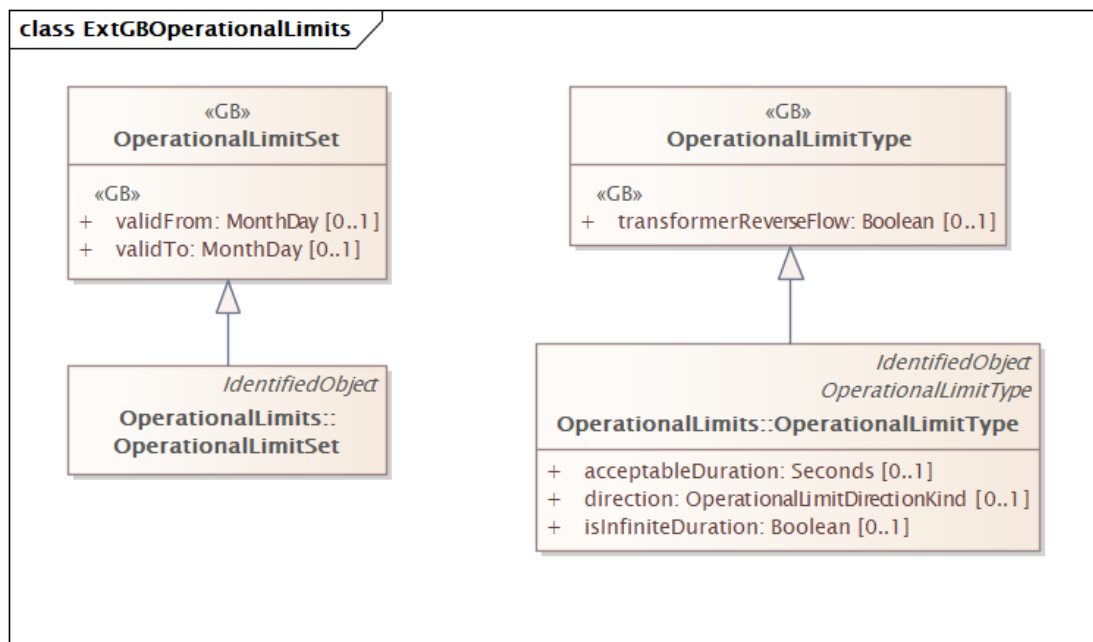


Figure 18 – Class diagram *ExtGBOperationalLimits::ExtGBOperationalLimits*

Figure 18: The diagram shows extensions related to operational limits.

### 1.3.2 (GB) OperationalLimitSet root class

Class that extends CIM OperationalLimitSet.

Table 10 shows all attributes of OperationalLimitSet.

Table 10 – Attributes of *ExtGBOperationalLimits::OperationalLimitSet*

name	mult	type	description
validFrom	0..1	MonthDay	(GB) Defines the beginning of the validity period of the operational limit set.
validTo	0..1	MonthDay	(GB) Defines the end of the validity period of the operational limit set. Used only in combination with validFrom and in case duration is not provided.

### 1.3.3 (GB) OperationalLimitType root class

Class that extends CIM OperationalLimitType.

Table 11 shows all attributes of OperationalLimitType.

Table 11 – Attributes of *ExtGBOperationalLimits::OperationalLimitType*

name	mult	type	description
transformerReverseFlow	0..1	Boolean	(GB) Limit applies to transformer flow in reverse of normal (high to low voltage level) direction. High is the winding that has TransformerEnd.endNumber equal to 1. If true, the OperationalLimitType defines a type for reverse limit.

## 1.4 Extensions related to Busbar results and capacities

### 1.4.1 General

This package includes extensions related to an exchange of summary results on short circuit and firm capacity.

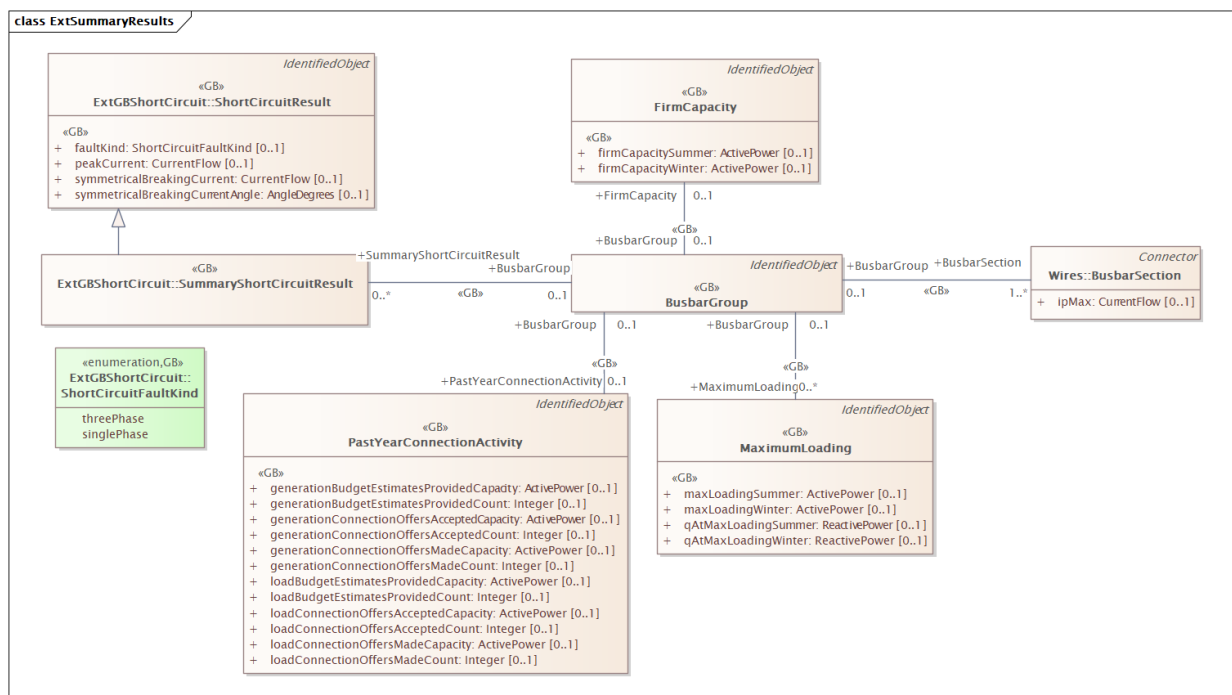


Figure 19 – Class diagram *ExtGBSummaryResults::ExtSummaryResults*

Figure 19: This diagram shows the model for summary results.

### 1.4.2 (GB) BusbarGroup

Inheritance path = IdentifiedObject : ExtEuIdentifiedObject

Collection of busbar sections for the purpose of reporting results applicable to the group.

Table 12 shows all attributes of BusbarGroup.

Table 12 – Attributes of *ExtGBSummaryResults::BusbarGroup*

name	mul t	type	description
aliasName	0..1	String	inherited from: IdentifiedObject
description	0..1	String	inherited from: IdentifiedObject
mRID	0..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject
energyIdentCodeEi c	0..1	String	(European) inherited from: ExtEuIdentifiedObject
shortName	0..1	String	(European) inherited from: ExtEuIdentifiedObject

Table 13 shows all association ends of BusbarGroup with other classes.

*Table 13 – Association ends of ExtGBSummaryResults::BusbarGroup with other classes*

mul t fro m	name	mul t to	type	description
0..1	BusbarSection	1..*	BusbarSection	(GB) The busbar section included in this busbar group.
0..1	SummaryShortCircuitResult	0..*	<a href="#">SummaryShortCircuitResult</a>	(GB) The summary of short circuit results related to this busbar group.
0..1	FirmCapacity	0..1	<a href="#">FirmCapacity</a>	(GB) The firm capacity that belongs to this busbar group.
0..1	MaximumLoading	0..*	<a href="#">MaximumLoading</a>	(GB) The maximum loading that is assigned to this busbar group.
0..1	PastYearConnectionActivity	0..1	<a href="#">PastYearConnectionActivity</a>	(GB) The part year connection activity that belongs to this busbar group.
0..1	DiagramObjects	0..*	DiagramObject	inherited from: IdentifiedObject
0..1	Name	0..*	Name	(NC) inherited from: IdentifiedObject
0..1	ParameterEvent	0..*	ParameterEvent	inherited from: IdentifiedObject
0..1	AlternativeIdentifier	0..*	Name	(NC) inherited from: IdentifiedObject

### 1.4.3 (GB) FirmCapacity

Inheritance path = IdentifiedObject : ExtEuIdentifiedObject

Seasonal busbar group firm capacity information.

Table 14 shows all attributes of FirmCapacity.

*Table 14 – Attributes of ExtGBSummaryResults::FirmCapacity*

name	mult	type	description
firmCapacitySummer	0..1	ActivePower	(GB) Summer firm capacity.
firmCapacityWinter	0..1	ActivePower	(GB) Winter firm capacity.
aliasName	0..1	String	inherited from: IdentifiedObject
description	0..1	String	inherited from: IdentifiedObject
mRID	0..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject
energyIdentCodeEi	0..1	String	(European) inherited from: ExtEuIdentifiedObject
shortName	0..1	String	(European) inherited from: ExtEuIdentifiedObject

Table 15 shows all association ends of FirmCapacity with other classes.

*Table 15 – Association ends of ExtGBSummaryResults::FirmCapacity with other classes*

mult from	name	mult to	type	description
0..1	BusbarGroup	0..1	<a href="#">BusbarGroup</a>	(GB) The busbar group that has this firm capacity.
0..1	DiagramObjects	0..*	DiagramObject	inherited from: IdentifiedObject
0..1	Name	0..*	Name	(NC) inherited from: IdentifiedObject
0..1	ParameterEvent	0..*	ParameterEvent	inherited from: IdentifiedObject
0..1	AlternativeIdentifier	0..*	Name	(NC) inherited from: IdentifiedObject

### 1.4.4 (GB) MaximumLoading

Inheritance path = IdentifiedObject : ExtEuIdentifiedObject



Information on maximum busbar group loading during summer and winter periods.

Information may be historic or forecast.

Table 16 shows all attributes of MaximumLoading.

*Table 16 – Attributes of ExtGBSummaryResults::MaximumLoading*

name	mult	type	description
maxLoadingSummer	0..1	ActivePower	(GB) Summer active power maximum loading.
qAtMaxLoadingSummer	0..1	ReactivePower	(GB) Reactive power at time of summer active power maximum loading.
maxLoadingWinter	0..1	ActivePower	(GB) Winter active power maximum loading.
qAtMaxLoadingWinter	0..1	ReactivePower	(GB) Reactive power at time of winter active power maximum loading.
aliasName	0..1	String	inherited from: IdentifiedObject
description	0..1	String	inherited from: IdentifiedObject
mRID	0..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject
energyIdentCodeEic	0..1	String	(European) inherited from: ExtEuIdentifiedObject
shortName	0..1	String	(European) inherited from: ExtEuIdentifiedObject

Table 17 shows all association ends of MaximumLoading with other classes.

*Table 17 – Association ends of ExtGBSummaryResults::MaximumLoading with other classes*

mult from	name	mult to	type	description
0..*	BusbarGroup	0..1	<a href="#">BusbarGroup</a>	(GB) The busbar group that has maximum loading.
0..1	DiagramObjects	0..*	DiagramObject	inherited from: IdentifiedObject
0..1	Name	0..*	Name	(NC) inherited from: IdentifiedObject
0..1	ParameterEvent	0..*	ParameterEvent	inherited from: IdentifiedObject

mult from	name	mult to	type	description
0..1	AlternativeIdentifier	0..*	Name	(NC) inherited from: IdentifiedObject

#### 1.4.5 (GB) PastYearConnectionActivity

Inheritance path = IdentifiedObject : ExtEuIdentifiedObject

A summary of load and generation connection activity over the last year related to a given busbar group. Counts and capacities of proposed connections, aggregated at the busbar group level, are provided for the following activities: budget estimates provided, connections offered and connection offers accepted.

Table 18 shows all attributes of PastYearConnectionActivity.

*Table 18 – Attributes of ExtGBSummaryResults::PastYearConnectionActivity*

name	mult	type	description
generationBudgetEstimatesProvidedCount	0..1	Integer	(GB) Count of generation connection requests associated with a busbar group for which budget estimates were provided in the last year.
generationBudgetEstimatesProvidedCapacity	0..1	ActivePower	(GB) Total active power capacity of connection requests counted by generationBudgetEstimatesProvidedCount.
generationConnectionOffersMadeCount	0..1	Integer	(GB) Count of generation connection requests associated with a busbar group for which connection offers were made in the last year.
generationConnectionOffersMadeCapacity	0..1	ActivePower	(GB) Total active power capacity of connection requests counted by generationConnectionOffersMadeCount.
generationConnectionOffersAcceptedCount	0..1	Integer	(GB) Count of generation connection requests associated with a busbar group for which connection offers were accepted in the last year.

name	mult	type	description
generationConnectionOffersAcceptedCapacity	0..1	ActivePower	(GB) Total active power capacity of connection requests counted by generationConnectionOffersAcceptedCount.
loadBudgetEstimatesProvidedCount	0..1	Integer	(GB) Count of load connection requests associated with a busbar group for which budget estimates were provided in the last year.
loadBudgetEstimatesProvidedCapacity	0..1	ActivePower	(GB) Total active power capacity of connection requests counted by loadBudgetEstimatesProvidedCount.
loadConnectionOffersMadeCount	0..1	Integer	(GB) Count of load connection requests associated with a busbar group for which connection offers were made in the last year.
loadConnectionOffersMadeCapacity	0..1	ActivePower	(GB) Total active power capacity of connection requests counted by loadConnectionOffersMadeCount.
loadConnectionOffersAcceptedCount	0..1	Integer	(GB) Count of load connection requests associated with the busbar group for which connection offers were accepted in the last year.
loadConnectionOffersAcceptedCapacity	0..1	ActivePower	(GB) Total active power capacity of connection requests counted by loadConnectionOffersAcceptedCount.
aliasName	0..1	String	inherited from: IdentifiedObject
description	0..1	String	inherited from: IdentifiedObject
mRID	0..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject
energyIdentCodeEic	0..1	String	(European) inherited from: ExtEuIdentifiedObject
shortName	0..1	String	(European) inherited from: ExtEuIdentifiedObject

Table 19 shows all association ends of PastYearConnectionActivity with other classes.

Table 19 – Association ends of ExtGBSummaryResults::PastYearConnectionActivity with other classes

mult from	name	mult to	type	description
0..1	BusbarGroup	0..1	<a href="#">BusbarGroup</a>	(GB) The busbar group that has this past year connection activity.
0..1	DiagramObjects	0..*	DiagramObject	inherited from: IdentifiedObject
0..1	Name	0..*	Name	(NC) inherited from: IdentifiedObject
0..1	ParameterEvent	0..*	ParameterEvent	inherited from: IdentifiedObject
0..1	AlternativeIdentifier	0..*	Name	(NC) inherited from: IdentifiedObject

## 1.5 Extensions to CIM Transformer model

### 1.5.1 General

This package contains extensions of transformer.

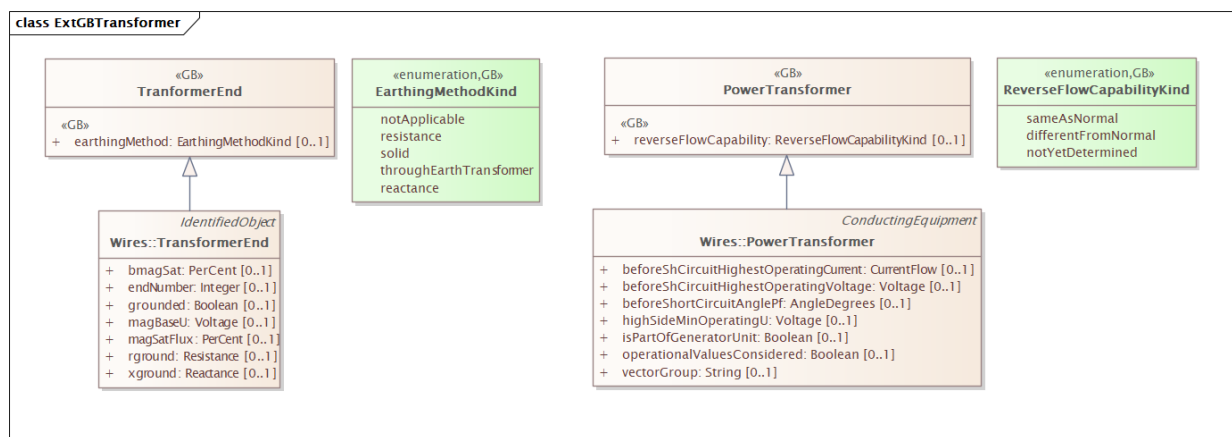


Figure 20 – Class diagram `ExtGBTransformer::ExtGBTransformer`

Figure 20: The diagram shows extensions related to transformer.

### 1.5.2 (GB) PowerTransformer root class

Class that extends CIM PowerTransformer.

Table 20 shows all attributes of PowerTransformer.

Table 20 – Attributes of `ExtGBTransformer::PowerTransformer`

name	mult	type	description
reverseFlowCapability	0..1	<a href="#">ReverseFlowCapabilityKind</a>	(GB) Nature of transformer's reverse flow capability.

### 1.5.3 (GB) TranformerEnd root class

Class that extends CIM TransformerEnd.

Table 21 shows all attributes of TranformerEnd.

*Table 21 – Attributes of ExtGBTransformer::TranformerEnd*

name	mult	type	description
earthingMethod	0..1	<a href="#">EarthingMethodKind</a>	(GB) Type of grounding.

### 1.5.4 (GB) EarthingMethodKind enumeration

The method of grounding employed on a transformer winding.

Table 22 shows all literals of EarthingMethodKind.

*Table 22 – Literals of ExtGBTransformer::EarthingMethodKind*

literal	value	description
throughEarthTransformer		Through earth transformer (LTDS), Through earthing transformer (GC0139).
solid		Solid grounding (LTDS), Solid (GC0139).
resistance		Resistance grounding (LTDS), Neutral grounding resistors (GC0139).
reactance		Reactance grounding (LTDS).
notApplicable		Not earthed.

### 1.5.5 (GB) ReverseFlowCapabilityKind enumeration

Describes the transformer's reverse flow capability with respect to its normal flow capability.

Table 23 shows all literals of ReverseFlowCapabilityKind.

*Table 23 – Literals of ExtGBTransformer::ReverseFlowCapabilityKind*

literal	value	description
sameAsNormal		Transformer's reverse flow capability is same as its normal direction flow capability.
differentFromNormal		Transformer's reverse flow capability is different from its normal direction flow capability.
notYetDetermined		Transformer's reverse flow capability is unknown.

## 1.6 Extensions related to Short Circuit

### 1.6.1 General

This package contains extension proposals to include an exchange of short circuit results.

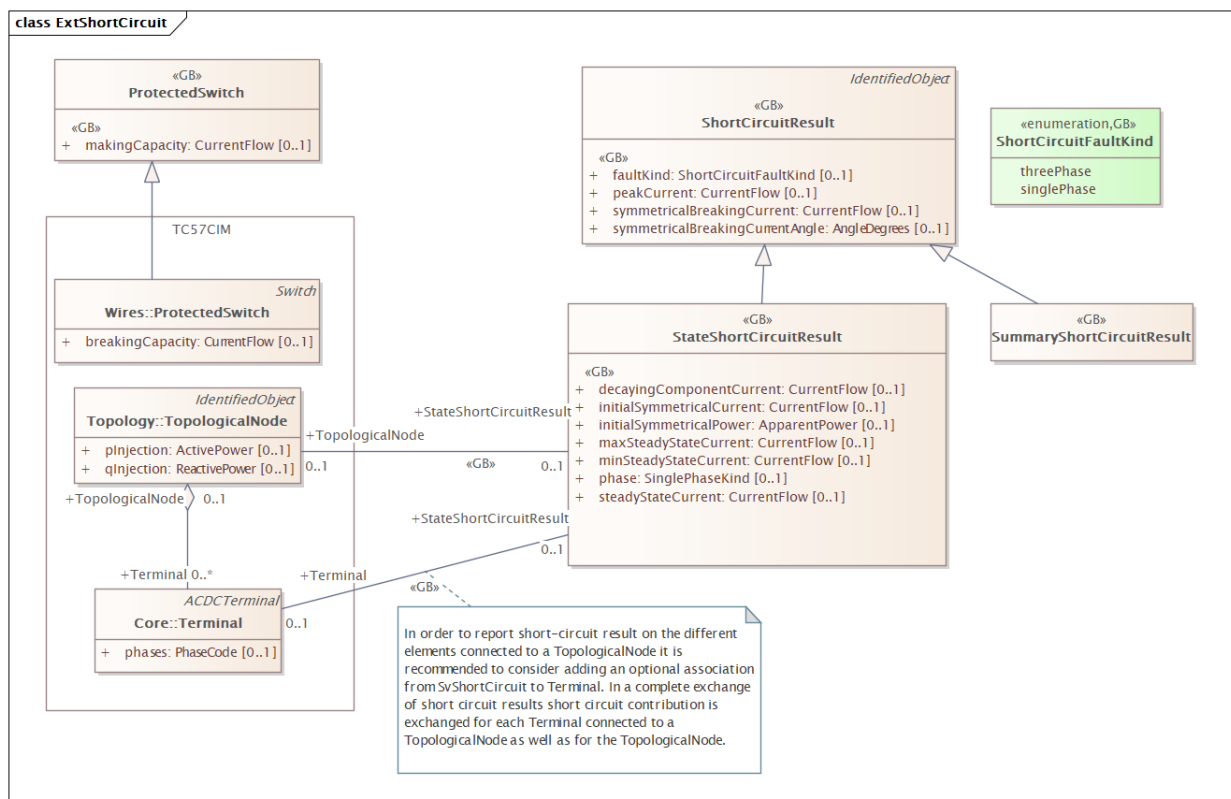


Figure 21 – Class diagram ExtGBShortCircuit::ExtShortCircuit

Figure 21: The diagram presents the extensions related to exchange of short circuit result.

### 1.6.2 (GB) ProtectedSwitch root class

Class that extends CIM ProtectedSwitch.

Table 24 shows all attributes of ProtectedSwitch.

Table 24 – Attributes of ExtGBShortCircuit::ProtectedSwitch

name	mult	type	description
makingCapacity	0..1	CurrentFlow	(GB) The making current of the circuit breaker is the maximum peak value of the current that the breaker can interrupt without any damage if the breaker is closed at fault.

### 1.6.3 (GB) ShortCircuitResult

Inheritance path = IdentifiedObject : ExtEuIdentifiedObject

Used to report on result of a short circuit calculation or an outcome of multiple calculations.

Table 25 shows all attributes of ShortCircuitResult.

*Table 25 – Attributes of ExtGBShortCircuit::ShortCircuitResult*

name	mult	type	description
faultKind	0..1	<a href="#">ShortCircuitFaultKind</a>	(GB)
peakCurrent	0..1	CurrentFlow	(GB) Peak short-circuit current. It is the maximum possible instantaneous value of prospective (available) short-circuit current. It is ip according to IEC 60909-0.
symmetricalBreakingCurrent	0..1	CurrentFlow	(GB) Symmetrical short-circuit breaking current. It is a root mean square value of an integral cycle of the symmetrical alternate current component of the prospective short-circuit current at the instant of contact separation of the first pole to open of a switching device. It is Ib according to IEC 60909-0.
symmetricalBreakingCurrentAngle	0..1	AngleDegrees	(GB) Symmetrical short-circuit breaking current angle. It is the angle of a root mean square value of an integral cycle of the symmetrical alternate current component of the prospective short-circuit current at

name	mul t	type	description
			the instant of contact separation of the first pole to open of a switching device.
aliasName	0..1	String	inherited from: IdentifiedObject
description	0..1	String	inherited from: IdentifiedObject
mRID	0..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject
energyIdentCodeEi c	0..1	String	(European) inherited from: ExtEuIdentifiedObject
shortName	0..1	String	(European) inherited from: ExtEuIdentifiedObject

Table 26 shows all association ends of ShortCircuitResult with other classes.

*Table 26 – Association ends of ExtGBShortCircuit::ShortCircuitResult with other classes*

mul t fro m	name	mul t to	type	description
0..1	DiagramObjects	0..*	DiagramObject	inherited from: IdentifiedObject
0..1	Name	0..*	Name	(NC) inherited from: IdentifiedObject
0..1	ParameterEvent	0..*	ParameterEvent	inherited from: IdentifiedObject
0..1	AlternativeIdentifie r	0..*	Name	(NC) inherited from: IdentifiedObject

#### 1.6.4 (GB) StateShortCircuitResult

Inheritance path = [ShortCircuitResult](#) : IdentifiedObject : ExtEuIdentifiedObject

Short-circuit result calculated on a power system state.

Table 27 shows all attributes of StateShortCircuitResult.

*Table 27 – Attributes of ExtGBShortCircuit::StateShortCircuitResult*

name	mul t	type	description
initialSymmetricalC urrent	0..1	CurrentFlow	(GB) Initial symmetrical short-circuit current. It is a root mean square value of the alternate current



name	mult	type	description
			symmetrical component of a prospective (available) short-circuit current, applicable at the instant of short circuit if the impedance remains at zero-time value. It is $I_k''$ according to IEC 60909-0.
steadyStateCurrent	0..1	CurrentFlow	(GB) Steady state short-circuit current. It is a root mean square value of the short-circuit current which remains after the decay of the transient phenomena. It is $I_k$ according to IEC 60909-0.
initialSymmetricalPower	0..1	ApparentPower	(GB) Initial symmetrical short-circuit power. It is a fictitious value determined as a product of the initial symmetrical short-circuit current, the nominal system voltage and the factor square root of 3. It is $S_k''$ according to IEC 60909-0.
decayingComponentCurrent	0..1	CurrentFlow	(GB) Decaying (aperiodic) component of short-circuit current. It is a mean value between the top and the bottom envelope of a short-circuit current decaying from an initial value to zero. It is $i_{dc}$ according to IEC 60909-0.
maxSteadyStateCurrent	0..1	CurrentFlow	(GB) Maximum steady state short-circuit current. It is $I_{kmax}$ according to IEC 60909-0.
minSteadyStateCurrent	0..1	CurrentFlow	(GB) Minimum steady state short-circuit current. It is $I_{kmin}$ according to IEC 60909-0.
phase	0..1	SinglePhaseKind	(GB) The terminal phase at which the short-circuit information is valid. If missing, the information is assumed to be three phase.

name	mul t	type	description
faultKind	0..1	<a href="#">ShortCircuitFaultKind</a>	(GB) inherited from: <a href="#">ShortCircuitResult</a>
peakCurrent	0..1	CurrentFlow	(GB) inherited from: <a href="#">ShortCircuitResult</a>
symmetricalBreakingCurrent	0..1	CurrentFlow	(GB) inherited from: <a href="#">ShortCircuitResult</a>
symmetricalBreakingCurrentAngle	0..1	AngleDegrees	(GB) inherited from: <a href="#">ShortCircuitResult</a>
aliasName	0..1	String	inherited from: IdentifiedObject
description	0..1	String	inherited from: IdentifiedObject
mRID	0..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject
energyIdentCodeEIC	0..1	String	(European) inherited from: ExtEuIdentifiedObject
shortName	0..1	String	(European) inherited from: ExtEuIdentifiedObject

Table 28 shows all association ends of StateShortCircuitResult with other classes.

*Table 28 – Association ends of ExtGBShortCircuit::StateShortCircuitResult with other classes*

mul t fro m	name	mul t to	type	description
0..1	Terminal	0..1	Terminal	(GB) The terminal to which the result is exchanged.
0..1	TopologicalNode	0..1	TopologicalNode	(GB) The TopologicalNode on which the short-circuit information is reported.
0..1	DiagramObjects	0..*	DiagramObject	inherited from: IdentifiedObject
0..1	Name	0..*	Name	(NC) inherited from: IdentifiedObject
0..1	ParameterEvent	0..*	ParameterEvent	inherited from: IdentifiedObject
0..1	AlternativeIdentifier	0..*	Name	(NC) inherited from: IdentifiedObject

### 1.6.5 (GB) SummaryShortCircuitResult

Inheritance path = [ShortCircuitResult](#) : IdentifiedObject : ExtEuIdentifiedObject

Short circuit result obtained from multiple short circuit calculations using different power system states.

Table 29 shows all attributes of SummaryShortCircuitResult.

Table 29 – Attributes of ExtGBShortCircuit::SummaryShortCircuitResult

name	mult	type	description
faultKind	0..1	<a href="#">ShortCircuitFaultKind</a>	(GB) inherited from: <a href="#">ShortCircuitResult</a>
peakCurrent	0..1	CurrentFlow	(GB) inherited from: <a href="#">ShortCircuitResult</a>
symmetricalBreakingCurrent	0..1	CurrentFlow	(GB) inherited from: <a href="#">ShortCircuitResult</a>
symmetricalBreakingCurrentAngle	0..1	AngleDegrees	(GB) inherited from: <a href="#">ShortCircuitResult</a>
aliasName	0..1	String	inherited from: IdentifiedObject
description	0..1	String	inherited from: IdentifiedObject
mRID	0..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject
energyIdentCodeEic	0..1	String	(European) inherited from: ExtEuIdentifiedObject
shortName	0..1	String	(European) inherited from: ExtEuIdentifiedObject

Table 30 shows all association ends of SummaryShortCircuitResult with other classes.

Table 30 – Association ends of ExtGBShortCircuit::SummaryShortCircuitResult with other classes

mult from	name	mult to	type	description
0..*	BusbarGroup	0..1	<a href="#">BusbarGroup</a>	(GB) The busbar group that has this short circuit result.
0..1	DiagramObjects	0..*	DiagramObject	inherited from: IdentifiedObject
0..1	Name	0..*	Name	(NC) inherited from: IdentifiedObject
0..1	ParameterEvent	0..*	ParameterEvent	inherited from: IdentifiedObject

mult from	name	mult to	type	description
0..1	AlternativeIdentifier	0..*	Name	(NC) inherited from: IdentifiedObject

#### 1.6.6 (GB) ShortCircuitFaultKind enumeration

Short circuit fault kind.

Table 31 shows all literals of ShortCircuitFaultKind.

*Table 31 – Literals of ExtGBShortCircuit::ShortCircuitFaultKind*

literal	value	description
threePhase		Three phase short circuit fault.
singlePhase		Single phase short circuit fault.